

State of Iowa Public Drinking Water Program 2006 Annual Compliance Report



Environmental Services Division
Water Quality Bureau
Water Supply Engineering
& Operations Sections

June 2007



Iowa Department of Natural Resources
Richard A. Leopold, Director



Table of Contents

Introduction	1
2006 Report Highlights	1
Compliance with Health-Based Standards	1
Compliance with Monitoring & Reporting Requirements	2
The National Public Drinking Water Program: An Overview	4
The IDNR Drinking Water Program Components	5
Iowa's Public Water Supply Systems	7
Definition of a PWS	7
Number of Iowa Systems	7
System Size	7
System Source Water	7
Population Served by Source Water Type	8
Maximum Contaminant Levels and Maximum Residual Disinfectant Levels	9
Acute Contaminants	9
Coliform Bacteria, including fecal and <i>E. coli</i>	9
Nitrate & Nitrite	10
Chlorine Dioxide	10
Chronic (non-acute) Contaminants	10
Total Coliform Bacteria	10
Inorganic Chemicals	11
Organic Chemicals	11
Radionuclides	12
Disinfectants	12
Action Level and Treatment Technique Requirements	13
Lead & Copper Action Levels	13
Treatment Techniques: Surface Water Treatment Rule, Interim & LT1 Enhanced SWTR	14
Turbidity	14
Residual Disinfectant (minimum)	14
CT Ratio	15
Disinfection Byproduct Precursor Removal	15
Violation Data for Health-Based Standards: MCL, MRDL, AL, and TT	16
Major Monitoring & Reporting Violations	19
Major Monitoring & Reporting Violation Data	20
Monitoring & Reporting Compliance Rates	21
Enforcement Actions	22
Variances & Exemptions	23
Public Notification, Lead Public Education, and Consumer Confidence Reporting	24
Operator Certification	25
Classification of Systems, Facilities, and Operators	25
Classification Grades	26
Enforcement & Certification Renewal	27
Abbreviations	28
Distribution of Report & Staff Contact Information	29
Appendix A: EPA Violations Summary Report	A-1
Appendix B: Iowa Public Water Supply Violation Data	B-1



Introduction

The Iowa Department of Natural Resources (IDNR) administers the Public Drinking Water Program in Iowa under delegation of authority from the United States Environmental Protection Agency (EPA). The 1996 re-authorized Safe Drinking Water Act (SDWA) requires that each state that has been granted primary implementation authority prepare an annual report on violations of national primary drinking water regulations within the state, make the report readily available to the public, and submit it to the EPA. This report fulfills this responsibility in Iowa for the 2006 calendar year, and includes violations of maximum contaminant levels, maximum residual disinfectant levels, treatment technique requirements, major monitoring or reporting requirements, action level exceedances, and operation certification requirements.

The 2006 Report Highlights


Compliance with Health-Based Standards

- No waterborne diseases or deaths were reported from Iowa public water supply systems (PWS) in 2006.
- Over 2.63 million people (of the 2.78M people served by PWS) regularly received water from systems meeting all health-based drinking water standards.

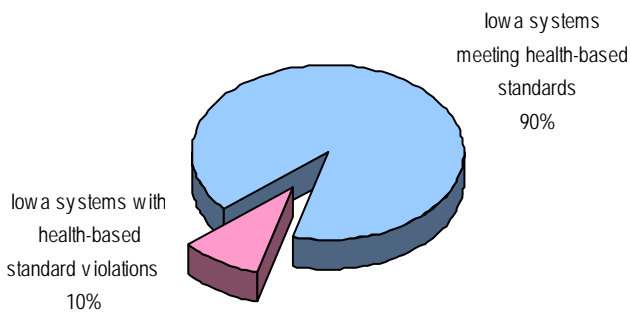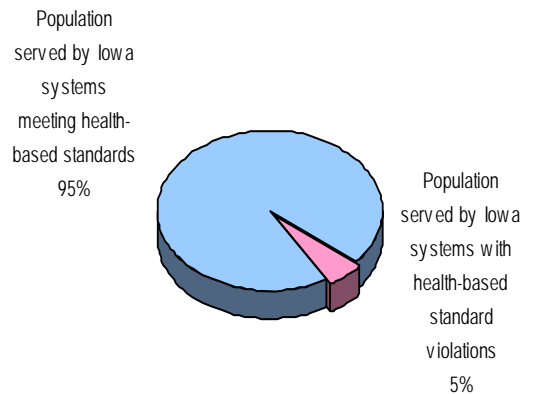


- Health-based drinking water standards were met by 90.4% of the 2,015 regulated public water supplies. There were 193 public water supplies that had 396 violations of a health-based drinking water standard: maximum contaminant level (MCL), maximum residual disinfectant level (MRDL), treatment technique (TT), or action level (AL).

- Sixteen of the more than 80 regulated contaminants were found at levels that exceeded the health-based standards during 2006. The top 11 contaminants are shown in the chart on the following page, along with the percentage each contributed to the total number of health-based standard violations. Five other health-based standards were each exceeded one time during the year: the maximum contaminant levels for benzene, di(2-ethylhexyl) phthalate, gross alpha radionuclides; and the treatment techniques for copper and lead.

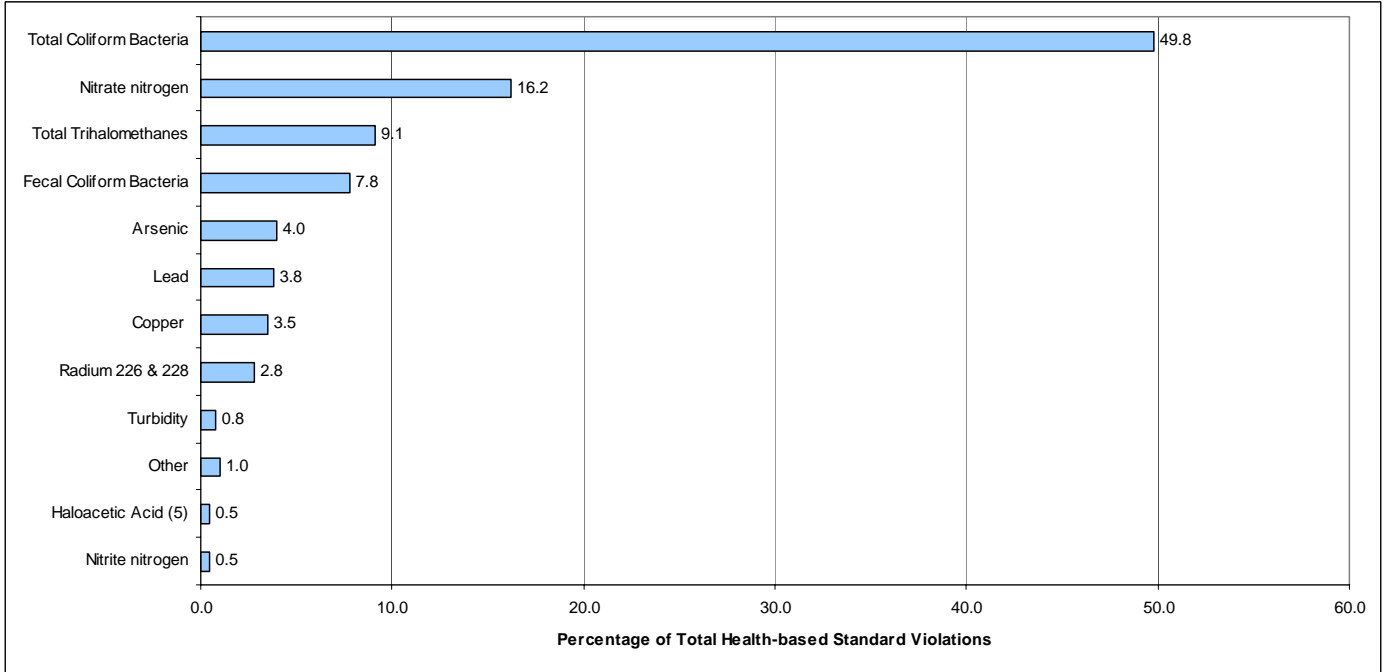

Compliance with Monitoring & Reporting Requirements


- Over 2.56 million people regularly received water from Iowa systems that complied with all major monitoring and reporting requirements.
- Major monitoring and reporting requirements were met by 79.5% of the 2,015 regulated public water supply systems.
- There were 921 major monitoring violations in 2006. A major monitoring violation is incurred when a sample is not collected for a specific contaminant. There were 332 systems that had at least one major monitoring violation in 2006. The contaminants for which at least one major monitoring violation was issued are listed below, along with the percentage each contributed to the total number of monitoring violations.

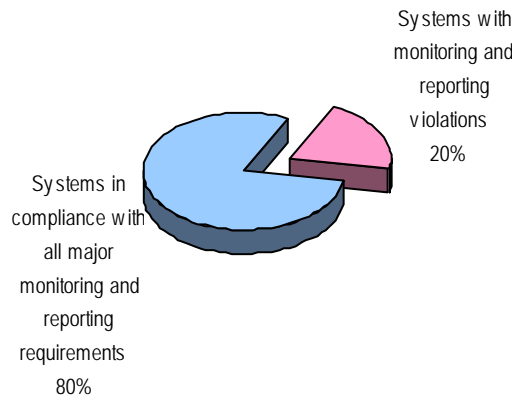

- | | |
|--|---|
| <ul style="list-style-type: none"> ▪ Coliform bacteria: 41.5% ▪ Nitrate: 16.3% ▪ Volatile Organic Compounds: 11.6% ▪ Synthetic Organic Compounds: 6.8% ▪ Chlorine: 5.6% | <ul style="list-style-type: none"> ▪ Metals: 5.5% ▪ Copper: 2.7% ▪ Lead: 2.7% ▪ Haloacetic Acids: 2.1% ▪ Total Trihalomethanes: 2.0% |
|--|---|

- Nitrite: 1.0%
- Other (5 other analytes): 2.2%
- At least one reporting violation was incurred by 142 systems, for a total of 167 reporting violations. These violations were comprised of the following (both the actual number of violations and the percentage of total reporting violations are listed):
 - Failure to submit the required monthly operation report: 63 (37.7%)
 - Failure to provide a consumer confidence report: 52 (31.1%)
 - Failure to obtain a certified operator: 31 (18.6%)
 - Failure to obtain a construction and/or operation permit: 15 (9.0%)
 - Other: 6 (3.9%)
- The top 15 categories of monitoring and reporting violations are shown in the chart below, along with the number each contributed to the total number of monitoring and reporting violations.

Monitoring & Reporting Violations in 2006

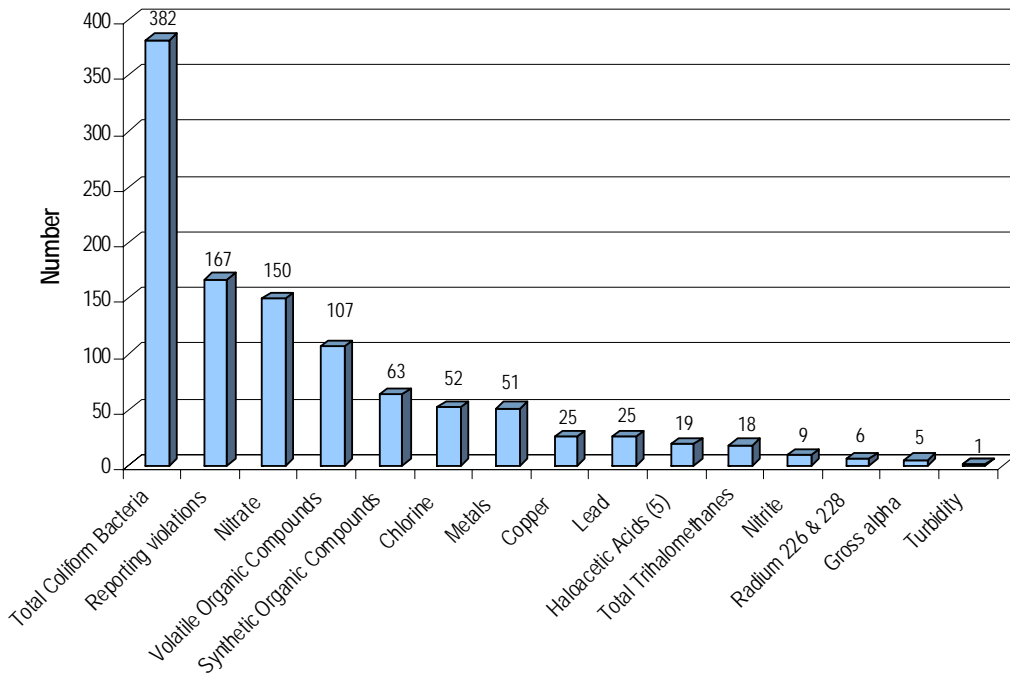

The National Public Drinking Water Program: An Overview

The United States Environmental Protection Agency (EPA) established the Public Water System Supervision Program under authority of the 1974 Safe Drinking Water Act (SDWA), which was most recently amended in 1996.

- To ensure the water is safe for human consumption, EPA sets national limits on allowable contaminant levels in public water supply systems. These limits are known as maximum contaminant levels and maximum residual disinfectant levels.
- Because certain contaminants are difficult to measure, EPA establishes treatment techniques or action levels in lieu of a maximum contaminant level to control unacceptable levels of those specific contaminants in public drinking water.
- EPA specifies how often systems must monitor for contaminants and requires those monitoring results be reported to the state. Generally, the larger the population, the more frequent the monitoring and reporting requirements.
- EPA requires systems to notify the public they serve when violations of the drinking water regulations occur. Public notification must include a clear and understandable explanation of the nature of the violation, potential adverse health effects resulting from the violation, steps the system is taking to correct the violation, and the availability and necessity of using alternative water supplies until the violation is corrected.
- EPA also has requirements for certification of water distribution and water treatment operators, environmental laboratory certification, and development of systems' technical, financial, and managerial capacity, to ensure that systems are properly operated.

The SDWA applies to all 50 States, the District of Columbia, Native American Indian Lands, Puerto Rico, the Virgin Islands, American Samoa, Guam, the Commonwealth of the Northern Mariana Islands and the Republic of Palau.


The SDWA allows States and Territories to seek EPA approval to administer the Public Water Supply Supervision Program within their state or territory, which is called primacy. To receive primacy, States must meet certain requirements set forth in the SDWA regulations, including adoption of drinking water regulations which are at least as stringent as federal regulations, and must demonstrate that the state or territory can enforce the program requirements. Of the states and territories, all but Wyoming and the District of Columbia have primacy. The EPA Regional Offices administer the PWSS programs within those two jurisdictions.

Native American tribes must meet the same requirements as a state in order to receive primacy. The three public water supplies operated by Native American tribes in Iowa have not received primacy and are overseen directly by EPA: Winn-A-Vegas Casino in Sloan; CasinOmaha in Onawa; and, the Sac & Fox Community in Tama.

EPA regional offices report to the states any enforcement actions taken by EPA within their jurisdiction. All SDWA data for a state is stored in an automated database called the Safe Drinking Water Information System (SDWIS). This database currently contains an inventory of public water supply systems and violation records.

The IDNR Drinking Water Program Components

The Iowa public drinking water program has the following responsibilities, conducted by staff located centrally in Des Moines (Water Supply and Region 5), as well as in six other cities around the state: Manchester (Region 1), Mason City (Region 2), Spencer (Region 3), Storm Lake (Satellite Office 3A), Atlantic (Region 4), and Washington (Region 6). The offices are shown on the map at the right.

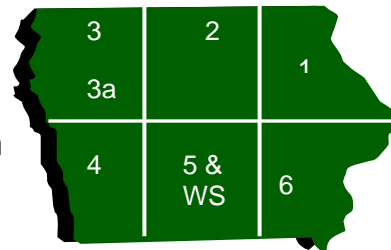

On-Site Inspection

- conducts site surveys for well and treatment facility placement,
- inspects every public water supply system in the state at least every five years (three years for surface water community water supply systems), which includes examination of the operation and maintenance of the entire system,
- provides technical assistance to water supply operators,
- responds to complaints from the public,
- provides emergency response to spills that may threaten water resources

Operation Permitting

- issues the operation permits for each system at least every three years, which lists the system-specific monitoring and operation requirements,
- monitors the compliance by each system with the drinking water program requirements,
- prepares violation notices, compliance schedules and enforcement actions

Construction Permitting

- issues construction permits for projects,
- reviews preliminary engineering reports, viability assessments and source water protection plans,
- assists systems and consulting engineers in selecting various treatment technologies for specific water quality problems.

Water Allocation and Use Permitting

- allocates and tracks the withdrawal of water from Iowa's aquifers and surface waters,
- issues and renews water use permits that are effective for ten years, and
- reviews water conservation plans.

Drinking Water Operator Certification

- evaluates applicants qualifications to determine eligibility for examination,
- certifies operators that successfully complete a written exam,
- renews certification of operators that earn continuing education units,

Environmental Laboratory Certification

- certifies laboratories that analyze samples,
- contracts with the University (of Iowa) Hygienic Laboratory to inspect environmental laboratories every two years and check the accuracy of annual proficiency testing samples.

Drinking Water State Revolving Loan Program


- makes loans to drinking water systems for construction of drinking water sources, treatment, storage and distribution systems to ensure public health and provide safe drinking water,
- makes loans for implementation of source water protection projects,
- scores and ranks applications based on whether the projects addresses health risks, rule compliance, infrastructure needs, and source water protection including criteria for loan eligibility.

Iowa also provides a variety of assistance to public water systems through the following four programs:

- **Capacity Development** The department continues to employ a capacity development strategy (also called viability assessment) to improve the financial, technical, and managerial capabilities of all water systems. New systems must be viable when they first serve water to the public. Existing systems are required to conduct self-assessments based upon various performance factors.
- **Source Water Protection** The first step in a multiple-barrier approach to drinking water protection is preventing contamination of drinking water sources. Iowa continues to perform source water assessments for new public water sources, but the primary emphasis of the Source Water Protection program focuses on the implementation of local and regional source water protection activities and projects. Iowa also coordinates with regional and local governmental and non-governmental entities to provide source water protection assistance and education to interested communities. All existing public water supplies had a source water delineation and contaminant source inventory completed by the IDNR's Geological Survey Section (groundwater systems) or other providers (for surface water systems) by July 2004. The systems then use this base document to develop their system-specific source water protection plans. As of April 2007, 135 community public water supply systems have approved final source water protection plans: 118 have partial or limited implementation of plans; and 17 have fully implemented plans.
- **Public Water System Security** The department provides information, consultation, and training to public water systems and operators regarding drinking water security.
- **Technical Assistance Contracts** The department administers contracts for projects that provide technical assistance to water operators and to systems serving fewer than 10,000 persons.

The number of public water supply systems in Iowa declined in 2006 from the previous year. Any system that was active for a single day during the year is included in that year's total.

Number of Regulated Iowa PWSs from 1997 - 2006

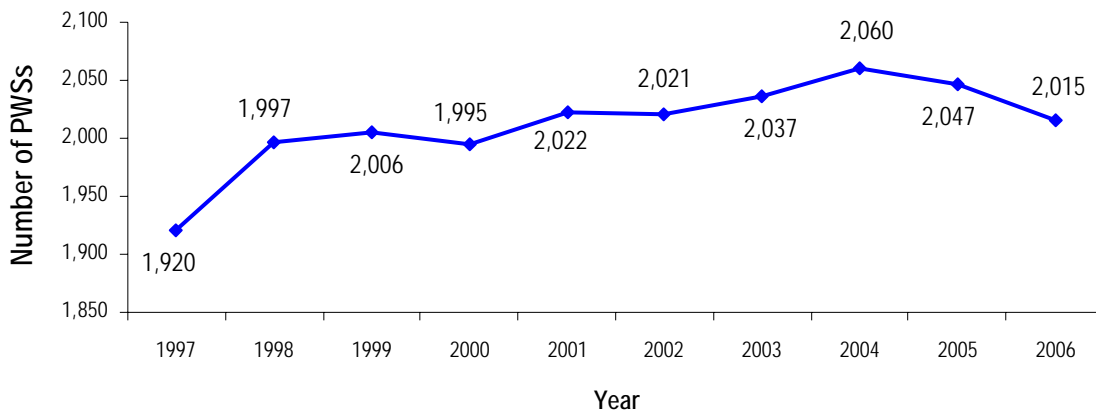

Iowa's Public Water Supply Systems

Definition of a PWS

A public water supply system is a system that provides water to the public for human consumption. The system must have at least 15 service connections or regularly serve an average of at least 25 individuals daily at least 60 days out of the year. An example of a system that is not a public water supply (a private water supply) would be a well serving a farmstead or rural home with 6 residents.

A public water supply system (PWS) is either a community water system, a non-transient non-community system, or a transient non-community system.

- A **community water system (CWS)** is a PWS that meets the above definition for year-round residents. Examples of CWSs include municipalities, subdivisions, and mobile home parks.
- A **non-transient non-community water system (NTNC)** is a PWS that regularly serves at least 25 of the same people four hours or more per day, for four or more days per week, for 26 or more weeks per year. Examples of these systems are schools, day-care centers, factories, and offices. Other service-oriented businesses, such as hotels, resorts, hospitals, and restaurants, are classified as NTNCs if they employ 25 or more people and are open for 26 or more weeks of the year.
- A **transient non-community water system (TNC)** is a PWS other than a CWS or NTNC that regularly serves at least 25 individuals daily at least 60 days out of the year. Examples of TNCs are convenience stores, bars, restaurants with fewer than 25 employees, golf courses, camps, parks, and recreation areas.

Public Water Supply Systems in Iowa

Number of Systems

In 2006, over 2.64 million Iowans were served by community public water supplies, or 90.3% of the total state population (2000 census), with the remaining 9.7% of the population served by private water supplies. Iowa's 2,015 public water supply systems in 2006 included 1,146 CWS, 138 NTNC, and 731 TNC systems.

System Size

Iowa is a small-system state, as indicated in the following table, with 94% of our systems each serving fewer than 3,300 people.

Population Served	EPA Classification	Number of PWS	Percentage of Total PWS
25 – 500	Very Small	1,439	71.4
501 – 3,300	Small	452	22.4
3,301 – 10,000	Medium	81	4.0
10,001 – 100,000	Large	40	2.0
Over 100,000	Very Large	3	0.2
Total		2,015	100.0

System Source Water

Iowa's drinking water is obtained from three sources:

- Groundwater from deep or shallow wells,
- Surface water from rivers, lakes, and reservoirs, and

- Groundwater that is under the direct influence of surface water as determined through testing by the presence of insects, bacteria, algae, pathogens, and/or significant and relatively rapid shifts in physical and chemical water characteristics.


Since a PWS can use any combination of water sources in its system, the PWS is classified by the source that is most vulnerable to contamination. Surface water systems are most vulnerable to contamination, followed by influenced groundwater systems. As indicated in the following tables, 92% Iowa's systems are served by groundwater sources, which serve 57% of the population. Surface water and influenced groundwater sources are used in the remaining 8% of systems, yet they serve 43% of the population.

Source of Water	Number of PWS	Percentage of Total PWS	Percentage of Total Population Served
Surface water	130	6.5	33.3
Influenced Groundwater	25	1.2	9.5
Groundwater	1,860	92.3	57.1

Systems using surface water or influenced groundwater sources have more complex operational and monitoring requirements than do groundwater systems, because of the greater treatment requirements of their source water.


System Source Water in Iowa:

The vast majority of Iowa's systems are supplied by groundwater.

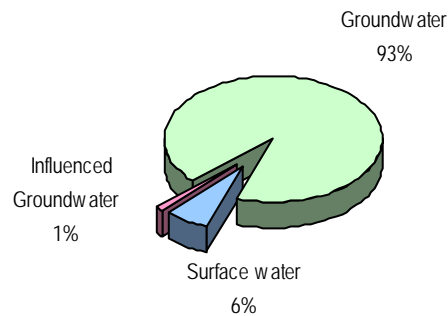

Population Served by the various Source Waters:

Even though 92% of Iowa's systems use groundwater, only 57% of the state's population is served by groundwater systems. The more populated areas of the state are generally served by surface water or influenced groundwater sources.

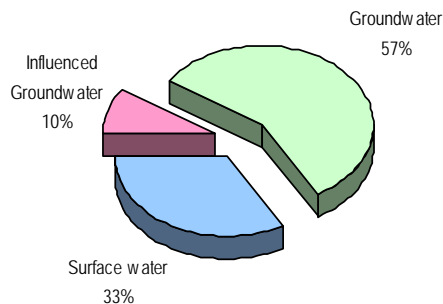

Maximum Contaminant Levels (MCLs) and Maximum Residual Disinfectant Levels (MRDLs)

All systems classified as public water supplies are required to test periodically for coliform bacteria, nitrate, and nitrite. Inorganic and organic chemical testing are only required in community and non-transient non-community systems. With the exception of chlorine, chloramines, and chlorine dioxide, the contaminants are regulated by a specific maximum contaminant level (MCL). An MCL is defined as the maximum permissible level of a contaminant in water that is delivered to any user of a PWS. Chlorine, chloramines, and chlorine dioxide are regulated by a maximum residual disinfectant level (MRDL), defined as the level of a disinfectant added for water treatment that may not be exceeded at the consumer's tap without an unacceptable possibility of adverse health effects.

With both the MCL and MRDL, if the drinking water meets that limit for a specific contaminant, it is considered to be safe.

In this section, the requirements for each group of contaminants are described, including the type of violation, common sources of contamination, specific health effects, how a violation is incurred, and how the system returns to compliance. The rules pertaining to MCLs and MRDLs are listed in the Iowa Administrative Code 567—Chapters 40, 41, 42, and 43.

Contaminants posing an immediate risk to human health (Acute)

There are five regulated contaminants that may pose an immediate, or acute, risk to human health if they are found in drinking water: fecal coliform bacteria, *E. coli*, nitrate, nitrite, or chlorine dioxide.

Coliform Bacteria, including fecal coliform bacteria and *E. coli*—567 IAC 41.2(1)

Sources of Contamination: Total coliform bacteria are common in the environment and are generally not harmful themselves. Fecal coliform bacteria and *E. coli* are generally not harmful themselves, but their presence in drinking water is serious because they usually are associated with sewage or animal waste. The presence of these bacteria in drinking water generally is a result of a problem with water treatment or the pipes which distribute the water, and indicates that the water may be contaminated with organisms that can cause disease (pathogens).

Health Effects: At greatest risk are children, pregnant women, infants, elderly persons, and persons with compromised immune systems. Disease symptoms may include diarrhea, cramps, nausea, headaches, and fatigue. Chlorinating the drinking water will provide disinfection. Boiling water in the home is also an effective method of sterilizing the drinking water.

Acute MCL: When total coliform bacteria are present in any sample, that sample is also analyzed for fecal coliform bacteria or *E. coli*. Any confirmed fecal coliform bacteria or *E. coli* sample is a violation of the MCL for total coliform bacteria. To meet this MCL, all drinking water samples must be free of these bacteria.

Violation: A PWS incurs a violation when the MCL is exceeded in any one monthly or quarterly compliance period. A violation of the acute coliform bacteria MCL is an acute violation and public notification must be started within 24 hours of notification of the violation.

Compliance Achieved: The system returns to compliance when all analytical results are below the MCL for a period of six consecutive months, and all required samples are collected as directed.



Nitrate and Nitrite—567 IAC 41.3

Source of Contamination: Nitrate and nitrite contamination can occur from several sources: the natural decay of organic materials such as leaves and crop residue, use of commercial fertilizers, contamination by human sewage and wastes from farm animals, and the nitrification of ammonia in the treatment and distribution system.

Health Effects: Excessive levels of nitrate and nitrite in drinking water can cause serious illness and sometimes death in infants less than six months of age. Nitrate converts to nitrite, which interferes with the oxygen-carrying capacity in the child's blood (methemoglobinemia or blue-baby syndrome). This is an acute disease because symptoms can develop rapidly in infants. In most cases, health deteriorates over a period of days. Symptoms include shortness of breath and blueness of the skin. Expert medical advice should be sought immediately if these symptoms occur. Boiling the water will only concentrate nitrates in drinking water, and should not be attempted. Alternative sources of water should be used, such as Food and Drug Administration (FDA) approved bottled drinking water with low levels of nitrate clearly listed on the packaging.



Acute MCL: The MCL for nitrate is 10 mg/L as N and the MCL for nitrite is 1.0 mg/L as N.

Violation: A system incurs a violation when the MCL is exceeded in any one compliance period, assigned either as a monthly, quarterly, or annual requirement. Violation of the nitrate or nitrite MCL is an acute violation.

Compliance Achieved: The system returns to compliance when all analytical results are below the MCL for a period of six consecutive months, and all required samples are collected as directed.

Chlorine Dioxide—567 IAC 41.6

Source: Chlorine dioxide is a chemical added to drinking water for the purposes of microbial disinfection and oxidation of dissolved organic carbon (to reduce formation of disinfection byproducts).

Health Effects: Some infants and young children who drink water containing chlorine dioxide in excess of the MRDL could experience nervous system effects. Similar effects may occur to the fetuses of pregnant women who drink water containing chlorine dioxide in excess of the MRDL. Some people may experience anemia. Violations of the chlorine dioxide standard within the distribution system may harm human health based on short-term exposures. Certain groups, including fetuses, infants, and young children, may be especially susceptible to nervous system effects from excessive chlorine dioxide exposure.

Acute MRDL: The MRDL for chlorine dioxide is 0.8 mg/L as ClO₂, and only applies to those systems using chlorine dioxide in their treatment processes. An acute MRDL occurs when too much of the chlorine dioxide is applied during the treatment process at the treatment plant.

Violation: A system incurs an acute violation when the daily monitoring results in the distribution system exceed the MRDL on the day following an elevated chlorine dioxide level at the entry to the distribution system.

Compliance Achieved: The system returns to compliance when the analytical results are below the MRDL for a period of six consecutive months, and all required samples are collected as directed.

Contaminants posing a long-term risk to human health (chronic or non-acute)

Total Coliform Bacteria—567 IAC 41.2(1)

Source of Contamination: Total coliform bacteria are common in the environment and are generally not harmful themselves, but their presence in drinking water is serious because it indicates a pathway of contamination. The presence of these bacteria in drinking water generally is a result of a problem with

water treatment or the pipes which distribute the water, and indicates that the water may be contaminated with organisms that can cause disease.

Health Effects: At greatest risk are children, pregnant women, infants, elderly persons, and persons with compromised immune systems. Disease symptoms may include diarrhea, cramps, nausea, headaches, and fatigue. Chlorinating the drinking water will provide disinfection. Boiling water in the home is also an effective method of sterilizing the drinking water.

Non-Acute MCL: Compliance with the MCL is determined by the presence or absence of total coliform bacteria in a sample. Any confirmed total coliform sample, with no detection of fecal coliform or *E. coli*, is a violation of the MCL for total coliform bacteria. To meet this MCL, all drinking water samples must be free of total coliform bacteria.

Violation: A system incurs a violation when the MCL is exceeded in any one compliance period assigned either as a monthly or quarterly requirement.

Compliance Achieved: The system is returned to compliance when all results are below the MCL for a period of six consecutive months, and all samples are collected as directed.

Inorganic Chemicals—567 IAC 41.3 (not including lead & copper)

Source of Contamination: Inorganic contaminants can leach into drinking water after dissolving from naturally-occurring minerals in the ground, or from runoff from industrial sources or landfills. Chlorite and bromate are byproducts of disinfection.

Health Effects: These contaminants may damage organs such as the kidneys and liver, damage the cardiovascular system and central nervous system, and are sometimes associated with high blood pressure and cancer. High levels of fluoride may cause dental and skeletal fluorosis.

Non-Acute MCL: Compliance with the MCL is determined based upon the sampling frequency:

- For systems collecting a sample every month or quarter, compliance with the MCL is determined using a running annual average.
- For systems collecting a sample annually or longer in frequency, compliance with the MCL is determined using the average of the initial sample and a confirmation sample.

Compliance with the chlorite requirements for systems using chlorine dioxide is determined from both source/entry point and distribution system samples.

Violation: A PWS incurs a violation when the MCL is exceeded in the average of the required samples.

Compliance Achieved: The system is returned to compliance when it has no monitoring or MCL violations for a period of six consecutive months.

Organic Chemicals—567 IAC 41.5

Organic chemicals are classified as a volatile organic chemical [VOC] or a synthetic organic chemical [SOC].

Sources of Contamination: Organic contaminants come from petroleum solvents, paint removers, degreasers, cleaning fluids, pesticides, gasoline, electrical transformers, manufacturing processes, chemical production, byproducts from disinfection, and the production of plastics. Agricultural runoff, improper waste disposal, and improper handling and storage techniques contribute to drinking water contamination via percolation of the contaminant through the soil into the groundwater.

Health Effects: These contaminants may damage organs such as the heart, liver, and kidneys, damage the central nervous and immune systems, and cause cancer.

Non-Acute MCL: Compliance with the MCL is determined based upon the sampling frequency:

- For systems collecting a sample annually or longer in frequency, compliance with the MCL is determined using the average of the initial sample and a confirmation sample.



- For systems collecting a sample every month or quarter, compliance with the MCL is determined using a running annual average.

For contaminants with an established Health Advisory (HA) level but no established MCL, the PWS is required to conduct public notification each quarter in which the HA is exceeded.

Violation: A PWS incurs a violation when the MCL is exceeded in the average of the required samples.

Compliance Achieved: The system is returned to compliance when it has no monitoring or MCL violations for a period of six consecutive months.

Radionuclides—567 IAC 41.8


Source of Contamination: Alpha emitters, which include radium and uranium, occur naturally in certain groundwaters in the state due to the geological formations, particularly in the deeper aquifers. Beta emitters are usually the result of manmade sources or activities.

Non-Acute MCL: Compliance with the MCL is determined from the annual average of four quarters of sampling, either four separately analyzed samples or four temporally composited aliquots.

Health Effects: Radionuclide contaminants may cause cancer.

Violation: A PWS incurs a violation when the MCL is exceeded in the average of the required samples.

Compliance Achieved: The system is returned to compliance when it has no monitoring or MCL violations for a period of six consecutive months.

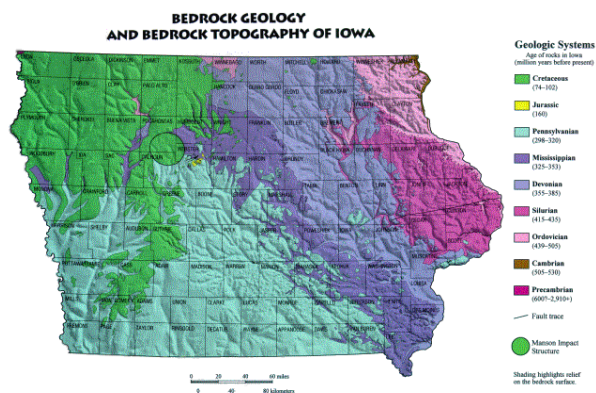

Map courtesy of IDNR Geological Survey

Disinfectants—567 IAC 43.6


Disinfectants are chemicals added to the drinking water during treatment to provide disinfection at the treatment plant and in the distribution system. They are regulated by a maximum residual disinfectant level, MRDL, which is the maximum amount of disinfectant allowed in the system.

Health Effects: Health effects for chlorine and chloramines include irritating effects to the eyes and nose, stomach discomfort, and (chloramine only) anemia. Chlorine dioxide can cause nervous system effects and anemia. Similar effects may occur in fetuses of pregnant women who drink water containing chlorine dioxide in excess of the MRDL.

Non-Acute MRDL: Compliance with the chlorine and chloramine maximum residual disinfectant level (MRDL) is determined from the annual average of twelve months of sampling. Compliance with the chlorine dioxide maximum residual disinfectant level is determined from the comparison of the source/entry point and distribution system samples to the MRDL. Chlorine dioxide can be either an acute (found in the distribution system above the MRDL) or a non-acute health risk (only found at the treatment plant above the MRDL), depending upon the duration and location of the elevated levels in the system.

Violation: A system incurs a violation for chlorine or chloramines when the MRDL is exceeded in the annual average of the required samples. A non-acute violation is incurred for chlorine dioxide when the source/entry point sample exceeds the MRDL for two consecutive days and the distribution system samples are all below the MRDL.

Compliance Achieved: The system is returned to compliance when all results are below the MRDL for a period of six consecutive months, and all samples are collected as directed.



Action Level and Treatment Technique Requirements

Certain systems are required to meet action level and treatment technique requirements. All NTNC and CWS systems are required to comply with the lead and copper action levels. All systems using surface water or influenced groundwater are required to comply with the treatment techniques.

In this section, the requirements for each group of contaminants are described, including the type of violation, common sources of contamination, specific health effects, how a violation is incurred, and how the system returns to compliance. If the drinking water from these systems meets the stated requirements, it is considered to be safe.

Action Level (AL) Requirements

Lead/Copper Action Levels—567 IAC 41.4

Action Level Exceedance: Lead and copper are regulated by action levels (AL) rather than MCL standards. Compliance with the action level is based upon the number of samples collected. The lead action level is exceeded if the concentration of lead in more than 10 percent of tap water samples collected during any monitoring period is greater than 0.015 mg/L (i.e., if the "90th percentile" lead level is greater than 0.015 mg/L). The copper action level is exceeded if the concentration of copper in more than 10 percent of tap water samples collected during any monitoring period is greater than 1.3 mg/L (i.e., if the "90th percentile" copper level is greater than 1.3 mg/L). If the action level at the 90th percentile is exceeded for either lead or copper, it represents a long-term risk to health.

Source of Contamination:

- Lead is a common metal found in lead-based paint, household dust, and certain types of pottery, porcelain, and pewter. It can be found in drinking water due to leaching from lead pipes, from lead solder on indoor plumbing, or from brass faucets and fixtures.
- Copper is often used to plumb residential and commercial structures that are connected to water distribution systems. Leaching of copper from these sources can result in contamination of the drinking water.



Health Effects: Lead builds up in the body over many years and can cause damage to red blood cells and kidneys, as well as damage to the brain, causing mental retardation. Copper at high levels can cause stomach and intestinal distress, liver and kidney damage, and anemia.

Violation: A PWS is out of compliance when the action level is exceeded for either lead or copper in any one compliance period, assigned either as a six-month, annual, or triennial requirement. Once the action level is exceeded, the PWS must collect water quality parameters, develop a corrosion control treatment study, implement steps to control the corrosion in the water, and collect additional samples to demonstrate return to compliance with the action level standard.

Compliance Achieved: A system is returned to compliance when the sample results for two compliance periods are below the action levels for both lead and copper. This can take several years to accomplish due to the time needed to refine corrosion control processes, which is then followed by a year of sampling. Those results must be below the action level before the violation is considered to be compliance achieved.

Treatment Technique Requirements (TT)

EPA established treatment techniques in lieu of MCLs to control unacceptable levels of some contaminants. If a system using surface water or influenced groundwater exceeds the turbidity limit, does not meet the residual disinfectant requirements, or does not meet the disinfection contact time ratio (CT), that system incurs a treatment technique violation. The violation could be either an acute or non-acute violation, depending upon the specific situation.

Surface Water Treatment Rule, Interim Enhanced Surface Water Treatment Rule, and Long-term 1 Enhanced Surface Water Treatment Rule—567 IAC 43.5, 43.9, and 43.10

This rule establishes criteria under which water systems supplied by surface water (SW) or groundwater under the direct influence of surface water (IGW), must filter and disinfect the water during the treatment process. These required treatment techniques are in addition to the other requirements of groundwater systems. All SW/IGW systems have filtration treatment in Iowa.



Treatment Techniques: For purposes of this report, treatment techniques are specified for SW/IGW systems to reduce or remove contaminants that must be monitored at the system and cannot be feasibly or economically measured in a laboratory. The definition of a treatment technique is a treatment process that leads to a reduction in the level of a contaminant sufficient to meet drinking water standards. Examples of treatment techniques for SW/IGW systems are turbidity removal, disinfectant residual maintenance, and sufficient disinfectant contact time.

Turbidity—567 IAC 43.5, 43.9, and 43.10

Treatment Technique: All SW/IGW systems, regardless of size, must meet the treatment techniques for turbidity. Turbidity (or cloudiness) of drinking water is a measure of the minute particles suspended in the water that can interfere with disinfection and testing for bacteria. It can also prevent maintenance of an effective disinfectant residual throughout the distribution system. Systems are required to remove 99% (2-log) of the *Cryptosporidium* oocysts through filtration. In addition, systems using conventional or direct filtration must meet the following two treatment techniques for turbidity:

- the turbidity level of representative samples of a system's filtered water must be less than or equal to 0.3 NTU in at least 95% of the measurements taken each month, and
- no single sample result may exceed 1 NTU.

Sources of Contamination: The major source of turbidity contamination is soil runoff.

Health Effects: Turbidity by itself has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms such as bacteria, viruses, and parasites such as *Giardia lamblia* and *Cryptosporidium* that can cause symptoms such as nausea, cramps, diarrhea, and associated headaches and can result in death.

Violation: A PWS incurs a treatment technique violation when either standard is exceeded in any month.

Compliance Achieved: A system is returned to compliance when turbidity results consistently meet the standards.

Residual Disinfectant (minimum)—567 IAC 43.5

All SW/IGW systems must provide disinfection to provide inactivation or removal of 99.9% *Giardia lamblia* cysts and 99.99% viruses. The chlorine residual in drinking water is a measure of the amount of available

chlorine in the water. It also allows the maintenance of an effective disinfectant agent throughout the distribution system.

- The disinfectant entering the distribution system cannot be lower than 0.3 mg/L free residual chlorine for more than four hours.
- The disinfectant within the distribution system, measured as total chlorine, combined chlorine, or chlorine dioxide, cannot be undetectable in more than 5% of the samples each month for any 2 consecutive months. This also applies to heterotrophic plate counts (HPC) which can be measured in lieu of disinfectant monitoring. The HPC must be less than or equal to 500 colony forming units per milliliter of sample in order to have acceptable disinfectant residual.

CT Ratio—567 IAC 43.5

All SW/IGW systems must determine their CT value on a daily basis.

- The CT in drinking water is determined by multiplying the disinfectant concentration by the amount of time that the disinfectant is in contact with the water. Each system must achieve a specific CT prior to the treated water entering the water distribution system. The amount of CT required depends on water quality parameters, which include the pH and temperature of the water.
- Insufficient CT can allow disease-causing organisms such as *Giardia lamblia* or viruses to survive and thereby be distributed throughout the system.

Health Effects: CT has no health effects, however, insufficient CT levels can allow disease-causing organisms that can cause symptoms such as nausea, cramps, diarrhea, and associated headaches to survive and enter the distribution system.

Violation: A system incurs a treatment technique violation when the CT ratio or residual disinfectant requirement is insufficient.

Compliance Achieved: A system is returned to compliance when the CT ratio is sufficient and the residual disinfectant requirements have been met. The violation could be returned to compliance in the following month, or the time period could be longer, depending upon the action needed to correct the violation.


Disinfection Byproduct Precursor Removal—567 IAC 43.6

All SW/IGW systems using conventional filtration treatment must determine the removal percentage of disinfection byproduct precursors (organic carbon) on a monthly basis. Failure to remove an adequate percentage is a treatment technique violation. There are alternative compliance criteria that may be used by the system if it is unable to remove the required percentage of total organic carbon. Compliance is determined on running annual average.

Health Effects: Total organic carbon has no health effects, however, it provides a medium for the formation of disinfection byproducts. These byproducts include trihalomethanes and haloacetic acids. Drinking water containing these byproducts in excess of the MCL may lead to adverse health effects, liver, or kidney problems, or nervous system effects, and may lead to an increased risk of getting cancer.

Violation: A system incurs a treatment technique violation when the precursor removal percentage is insufficient, and an alternative compliance criteria cannot be used.

Compliance Achieved: A system is returned to compliance when it can meet the precursor removal requirements.



Violation Data for Health-based Standards: MCL, MRDL, AL, and TT

In 2006, approximately 2.63 million people received water served by Iowa public water supply systems that complied with all health-based standards, including MCL, MRDL, AL, and TT standards. In 2006, 94.7% of the population served by community public water supply systems received water that met all drinking water standards adopted by the department. This was a 5.1% improvement from 2005, close to the 2005 goal of 95 percent.

Of the 2,015 regulated PWSs in Iowa, 90.4% were in compliance with all MCL, MRDL, AL, and TT standards. There were 193 PWSs that had at least one violation of an MCL, AL, or TT standard. There were no MRDL violations in 2006. There were 396 violations of thirteen contaminants and three treatment techniques in Iowa in 2006, as indicated in the following table. The most frequent standard that was not met in Iowa is coliform bacteria, which, because all systems must monitor for coliform bacteria at least each quarter, is also the most frequently sampled contaminant in the state.


Analyte	Number of PWS	Number of Violations	Percentage of the Total Number of Violations	Number of Samples Collected in 2006	System Population*
Arsenic	7	16	4.0	224	1,518
Total Coliform Bacteria	120	197	49.7	53,456	32,922
Fecal Coliform Bacteria	19	31	7.8	1,492	6,476
Benzene	1	1	0.2	733	1,898
Copper	12	14	3.5	5,223	5,380
Copper treatment technique	1	1	0.2	Not applicable	986
Di(2-ethylhexyl)phthalate	1	1	0.2	808	35
Gross alpha, excluding Rn & U	1	1	0.2	246	35
Haloacetic Acids 5 (HAA5)	2	2	0.5	1,246	5,773
Lead	14	15	3.8	5,221	64,466
Lead treatment technique	1	1	0.2	Not applicable	58,672
Nitrate nitrogen	19	64	16.2	3,941	4,513
Nitrite nitrogen	1	2	0.5	542	238
Radium 226 & 228	6	11	2.8	296	10,252
Total Trihalomethanes (TTHM)	18	36	9.1	1,252	24,904
Turbidity treatment technique	1	3	0.8	Not applicable	5,690
Total:	193**	396	100%		150,731**

* The population for a system with multiple violations in a single category was only included once in this total.

** Each PWS is only included once in the total, even though they may have multiple violations. Likewise, the population of a system is only included once in the system population, even though multiple violations may have occurred in a system.

The number of public water supply systems in compliance with all health-based standards continued a similar trend in 2006 as it has over the past decade, as shown in this chart, with the average compliance rate over the ten-year period at 91.1%. However, the number of regulations that the community systems are required to meet has increased substantially during that same time period.


**Percentage of PWS in Compliance with all MCL, AL, TT, & MRDL:
1997 - 2006**

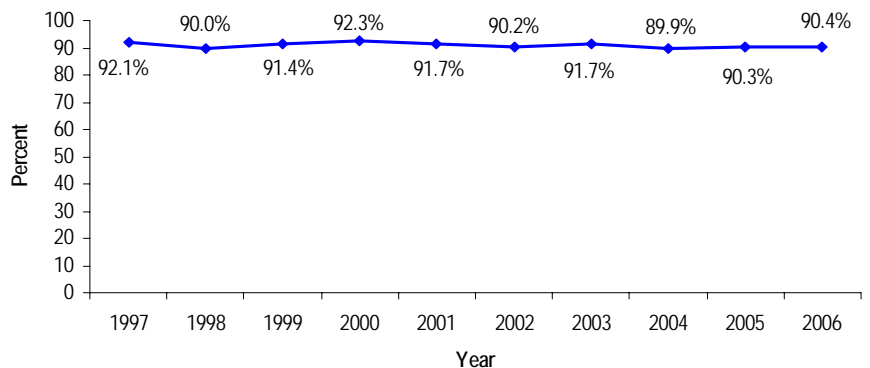

Violation Data: MCL, MRDL, AL, and TT


In 2006, the number of systems with violations of health-based standards slightly decreased while the number of violations increased from 2005. The majority of the violations occurred in coliform bacteria, nitrate, and disinfection byproducts standards, accounting for 83.3% of the violations.

Health-Based Standards Violations: 1997 - 2006

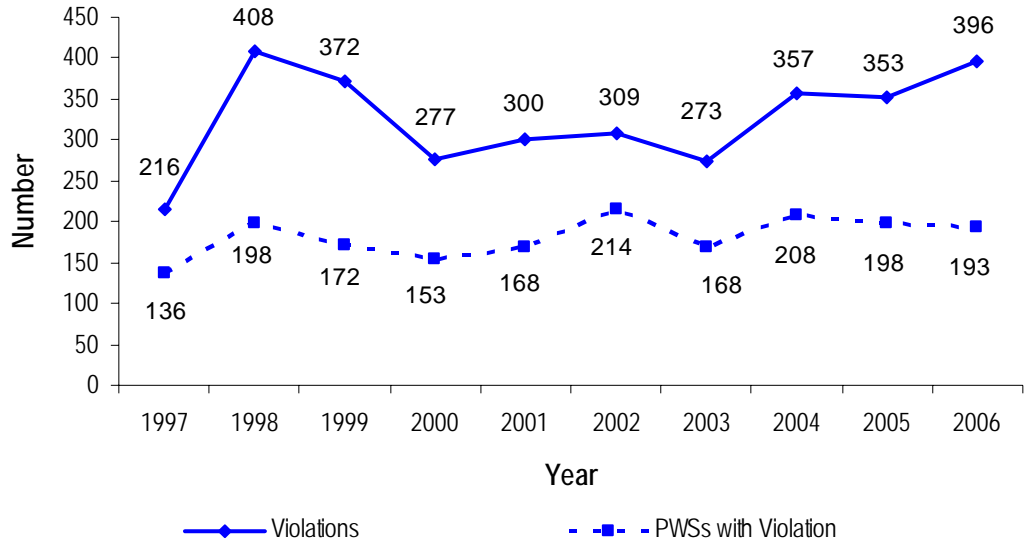


Coliform Bacteria MCL Violations: 1997 - 2006

Both the number of total coliform MCL violations and the number of systems with violations increased from 2005, although still below the 2004 levels. The number of acute (confirmed fecal positive) coliform bacteria violations and the number of systems with those violations increased over 2005.

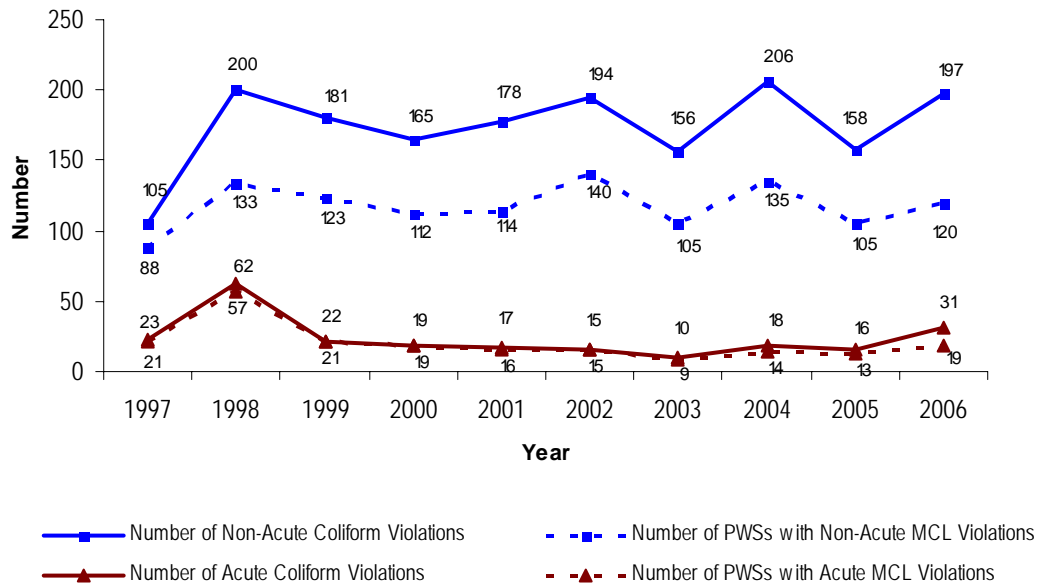

Nitrate MCL Violations: 1997 - 2006

The number of nitrate MCL violations increased from 2005, although the number of systems with violations remained static. In 2006, there were 4 CWS that had 17 violations; 2 NTNC with 6 violations; and 13 TNC with 41 violations.

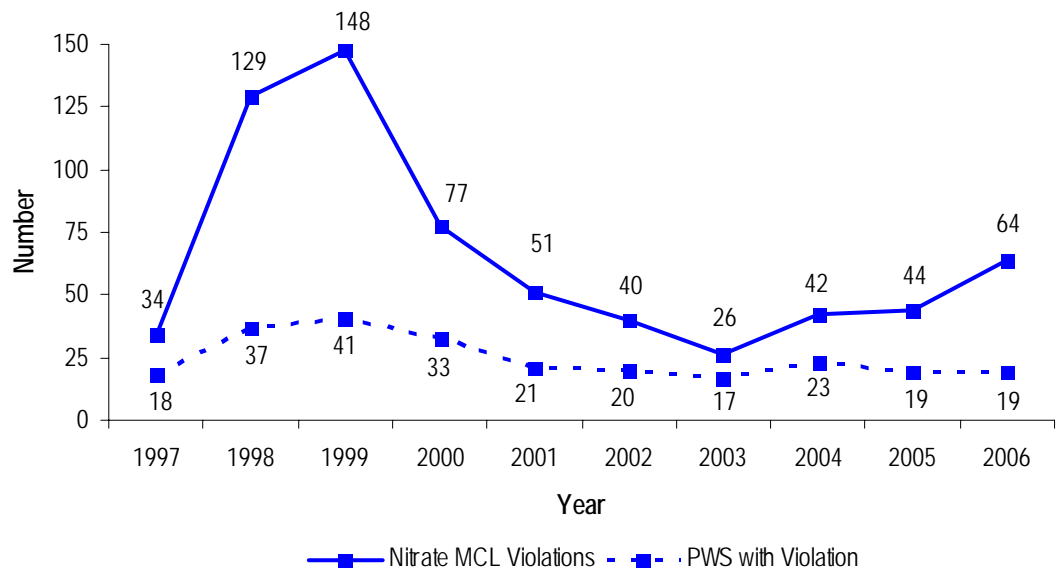

Major Monitoring & Reporting Violations

Monitoring and Reporting (M/R) violations for this report were based on the guidelines briefly described in the next table. EPA deems these violations to be classified as major violations. Minor monitoring violations are those in which at least some of the required monitoring was completed. They are not listed in this report. Systems are assigned the monitoring requirements for each contaminant in an operation permit that is issued at least every three years. The monitoring requirements vary by contaminant, from sampling every four hours (turbidity) to sampling once every nine years (inorganic chemicals). The specific requirements are listed in the Iowa Administrative Code (567) Chapters 41, 42, and 43.

Monitoring Guidelines by Rule:

Rule	Violation Type	Description
Total Coliform Rule	M/R, Routine Major	No samples collected during a compliance period
	M/R, Repeat Major	No follow-up samples collected after a positive sample
Surface Water Treatment Rule, Interim Enhanced Surface Water Treatment Rule, and Long-term 1 Enhanced Surface Water Treatment Rule	M/R, Routine Major	Collected less than 10% of samples required during a compliance period
Lead and Copper Rule	M/R Routine Tap	Failure to collect the initial tap samples followed by a failure to correct that omission within 3 months for large systems, 6 months for medium systems, and 12 months for small systems, or the failure to submit the associated report.
	M/R Routine Tap	Failure to collect any required samples.
Phase I, II, IIB, and V Rules (Inorganic and organic chemicals)	Regular Monitoring	Failure to collect any required samples
Stage 1 Disinfectants & Disinfection Byproducts Rule	M/R, Routine Major	Failure to collect any required samples
Radionuclides	M/R, Routine Major	Failure to collect any required samples
Any Inorganic or Organic Chemical	Confirmation/Check Major	Failure to collect the required confirmation sample.

Out of Compliance: A violation is incurred when the PWS fails to collect, have analyzed, and report the required number of samples in any one compliance period. One violation is issued for each analyte when samples are not collected, analyzed, and reported in accordance with the system's operation permit.

Compliance Achieved: A system is returned to compliance when the samples are collected and the results are reported to the IDNR.

Major Monitoring and Reporting (M/R) Violation Data

Over 2.56 million people received water served by Iowa's systems that met the major monitoring and reporting requirements. Of the 2,015 regulated PWSs in Iowa, 79.5% (1,602 PWSs) were in compliance with all major monitoring and reporting requirements. There were 413 PWSs serving a total population of 217,125 that incurred 1,088 monitoring and reporting violations in 2006. The IDNR assigns violations by contaminant for each system, which can result in a single system incurring several monitoring violations.

Listed below are the contaminants with a major monitoring or reporting violation in 2006. The majority of violations were for failure to collect coliform bacteria samples (41.5%), failure to collect nitrate samples (16.3%), and failure to collect VOC samples (11.6%). Coliform bacteria and nitrate are the two contaminants that are required to be sampled by all systems.

Contaminant or Reporting Requirement	Number of PWS	Number of Violations	Population Affected*
Monitoring			
Antimony	6	6	2,000
Arsenic	4	4	1,380
Barium	6	6	2,000
Cadmium	6	6	2,000
Total Organic Carbon	2	2	16,135
Chlorine (included MOR MON)	37	52	16,973
Chromium	6	6	2,000
Coliform Bacteria, Total	213	382	38,121
Copper	24	25	9,227
Fluoride	5	5	1,650
Gross alpha, excluding Rn & U	5	5	2,257
Haloacetic Acids (5)	19	19	21,790
Lead	24	25	9,227
Mercury	6	6	2,000
Nitrate	112	150	13,830
Nitrite	9	9	732
Radium 226 & 228	4	6	26,694
Selenium	6	6	2,000
Sodium	5	5	2,732
SOC	8	63	1,388
Turbidity	1	1	4,573
Thallium	6	6	2,000
Total Trihalomethanes	18	18	21,690
VOC	7	107	5,888
Water Quality Parameters (LCR)	1	1	57,686
Monitoring Total:	332*	921	191,751*
Reporting			
Failure to submit monthly operation report	53	63	10,804
Failure to provide consumer confidence report	52	52	9,629
Failure to obtain a construction or operation permit	13	15	9,416
Failure to obtain a certified operator	31	31	12,693
Failure to comply with a compliance schedule	1	1	502
Failure to conduct public notice	4	5	173
Reporting Total:	142*	167	38,523*
Monitoring & Reporting Total:	413**	1,088	217,215**

* The population of each PWS is only counted once for each contaminant.


**Each system with a violation is only included once in the number of systems total and the affected population total. To summarize, 413 systems had a total of 1,088 major monitoring or reporting violations, affecting a total population of 217,215.

Monitoring & Reporting Compliance Rates: 1997 - 2006


The number of public water supplies in compliance with all major monitoring and reporting requirements has fluctuated between 74.8% and 82.7% over the past nine years. The 1997 data only included major significantly non-compliant systems, which are a subset of the systems with a major monitoring and reporting violations, and is not fully comparable to the more inclusive data reported since 1998. This chart indicates the percentage of PWS in compliance with all major monitoring and reporting requirements, which was 79.5% in 2006.

In 2006, the number of systems with monitoring and reporting violations and the total number of violations increased from 2005. Although this can be influenced by the fluctuation of monitoring schedules over a several year period, the increase in 2006 can be partially attributed to an increase in reporting violations.

Percentage of PWS in Compliance with all Major Monitoring & Reporting Requirements: 1997 - 2006

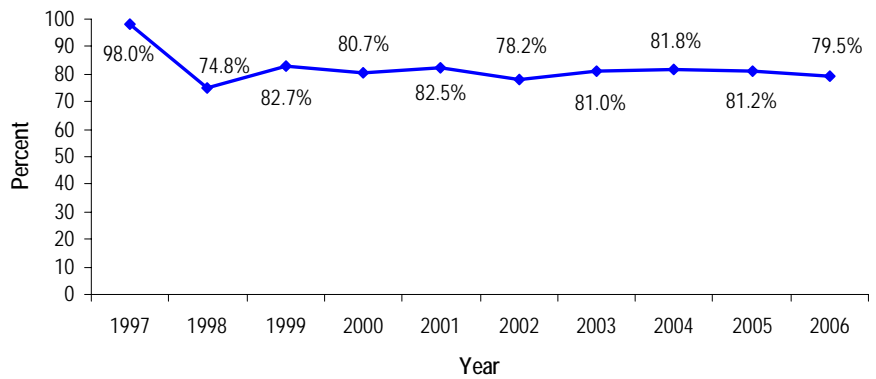

Monitoring & Reporting Violations: 1997 - 2006

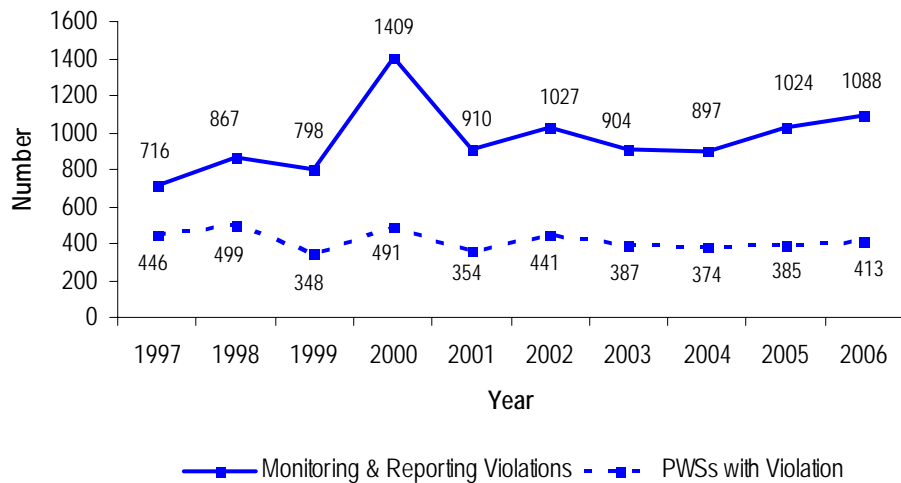

Enforcement Actions

Any time a system incurs a violation, enforcement actions are taken. All systems are issued a notice of violation (NOV), which requires that the public be notified about the violation and any possible health effects. Operation permits are used to list the monitoring and reporting requirements, and also any compliance schedule that the system must meet in order to remedy a violation. The operation permit is termed a "bilateral compliance agreement", because the system has a legal right to appeal the document for 30 days, after which time it is binding.

If a system is unable or unwilling to mitigate a violation, an administrative order (AO) is the next enforcement action. An AO may be issued with a monetary penalty, or more commonly, without a monetary penalty. The next level of escalation in enforcement actions is to refer the system to the Iowa Attorney General for enforcement.

All violations remain "open" until the system satisfies the requirements to return it to compliance. In the case of a monitoring violation, returning to compliance may be as simple as collecting the sample that was missed and conducting public notification. In the case where a system has an ongoing health-based standard violation, the system may have to install treatment processes to be able to successfully remove the contaminant from the water. These types of situations can take many months to remedy, and the system is required to conduct public notification at intervals throughout the time period when they are not in compliance with the health standard.

IDNR tracks the corrective actions for all violations at all PWSs. All violations and corrective actions are reported to EPA. When the criteria for compliance are met, the specific violation is coded "Compliance Achieved". Failure to achieve compliance in a timely manner may result in the issuance of an administrative order. These are the most commonly used enforcement actions:

- NOV issued: A notice of violation has been issued to the system by the department.
- PN requested: Public notification for the violation must be done by the system.
- PN received: Public notification has been done by the system and a copy has been received by the department.
- BCA issued: A bilateral compliance agreement between the system and the department has been issued.
- AO w/Penalty: An administrative order with a penalty has been issued by the department.
- AO w/o Penalty: An administrative order without a penalty has been issued by the department.
- AG Case Referred: The system has been referred to the Attorney General's Office for enforcement action.
- Compliance Achieved: The system is now in compliance and the specific violation is "closed".



Most violations have a predefined set of enforcement actions, which include the following four actions at a minimum: notice of violation issued, public notification requested, public notification received, and compliance achieved. Once the PWS has successfully met the compliance achieved criteria, the system is returned to compliance in the department's computer tracking system.

Variations and Exemptions

Iowa does not use the variance and exemption allowances from EPA.

Public Notification, Lead Public Education, and Consumer Confidence Report—567 IAC Chapter 42

The SDWA requires a system to notify both the people who consume the system's water and the department whenever the following violations occur:

- a Maximum Contamination Level (MCL) has been exceeded,
- a Maximum Residual Disinfectant Level (MRDL) has been exceeded,
- a required Treatment Technique (TT) has not been achieved,
- the lead action level is exceeded in at least 10 percent of the tap water samples,
- a Compliance Schedule has not been met,
- an EPA Lifetime Health Advisory (HA) has been exceeded,
- a waterborne emergency has occurred,
- a certified operator has not been retained for CWS and NTNC systems, or
- other situations where the department determines that public notification is needed.

MCL, MRDL, or Treatment Technique Violation

To comply with the MCL, MRDL, and TT public notification requirements, the PWS must:

- notify the department within 48 hours after the violation occurred (24 hours for acute violations);
- notify the consumers by the required public notification procedures; and
- provide proof of such public notice including a certification to the department.

Monitoring or Reporting Violation

All PWSs must issue public notification for failure to:

- monitor and report the required data to the department;
- comply with established testing procedures; or
- meet the public notification requirements.



Public Education for a Lead Action Level Exceedance

A PWS must notify the IDNR and the population served by the PWS when the 90th percentile exceeds the action level for lead. This lead public education requires that mandatory language be provided to the consumers every twelve months as long as the action level is exceeded, in the following forms:

- newspaper announcement;
- pamphlets and brochures to doctors, clinics, schools, daycare facilities, etc.;
- attachments to customers' water bills;
- a notice printed directly on the water bill; and
- a public service announcement must be issued to television and radio for broadcasting.

In addition to the annual notice, a public service announcement must be issued every six months to local television and radio broadcast outlets.

Consumer Confidence Reports

All CWS must notify the public by July 1 of every year with information on the quality of the water delivered by the system in the previous calendar year, and to characterize the risks (if any) from exposure to contaminants in the drinking water. This report, called a Consumer Confidence Report (CCR) or a Water Quality Report, must be prepared by each CWS and made available to their public. The CCR must include the following information:

- source water information;
- definitions of terms used in the report;
- information on detected contaminants (if any were detected), including mandatory language and additional health information where applicable; and,
- whether the system is not in compliance with any other requirement, including monitoring, public notification, operation, administrative order, or operator certification.



Each CWS must mail or otherwise directly deliver one copy of the report to each customer. Mailing waivers are issued to CWS having fewer than 10,000 persons, provided the system had no violations for the covered calendar year. A CWS serving fewer than 500 persons and having a mailing waiver is allowed to publicly post their CCR.



In 2006, 52 CWS failed to prepare and distribute their CCR for calendar year 2005. Each CWS received a reporting violation for this failure. The compliance rate for Iowa's CWS with the CCR requirements in 2006 was 95.5%.

Health Effects

If a public notification or public education requirement is not met, the public health is placed at risk because the public is unaware of the potential health effects of the water being consumed. Children, pregnant women, the elderly, and persons with compromised immune systems are at the greatest risk from most contaminants.

Public Notification or Public Education Violation

A system is in violation of the public notification or public education rules when it does not issue public notification specific to its violation and does not provide proof of notification to the IDNR. A system is returned to compliance when it publishes the appropriate public notification or public education language within the required amount of time and provides the proof to the IDNR.

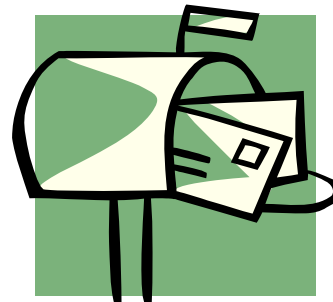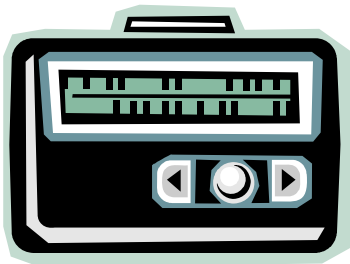

Operator Certification—567 IAC Chapter 81

All CWS and NTNC are required to have a certified operator in direct responsible charge of the water treatment and water distribution systems. The operators must be certified by the department at the same classification of the plant or water distribution system at a minimum.


The Iowa Operator Certification Program reporting time frame is July 1 through June 30. For the certification year of July 1, 2006 through June 30, 2007, the program efforts in drinking water included:

- implementation of a new web-based operator certification database, accessible to the DNR drinking water program staff, Iowa's certified operators, and the general public,
- continued implementation of the new certified operator requirements for community and nontransient noncommunity water supplies, and
- renewal of all water certificates.

Classification of Systems and Facilities

All CWS and NTNC were required in 2002 to designate a certified operator in direct responsible charge of the water treatment and water distribution systems. The facilities are classified according to complexity, with Grade 4 being the most complex. Listed below are the Iowa CWS and NTNC systems in all classification levels, as of June 27, 2007.

Treatment and Distribution System Classification of Iowa's PWS

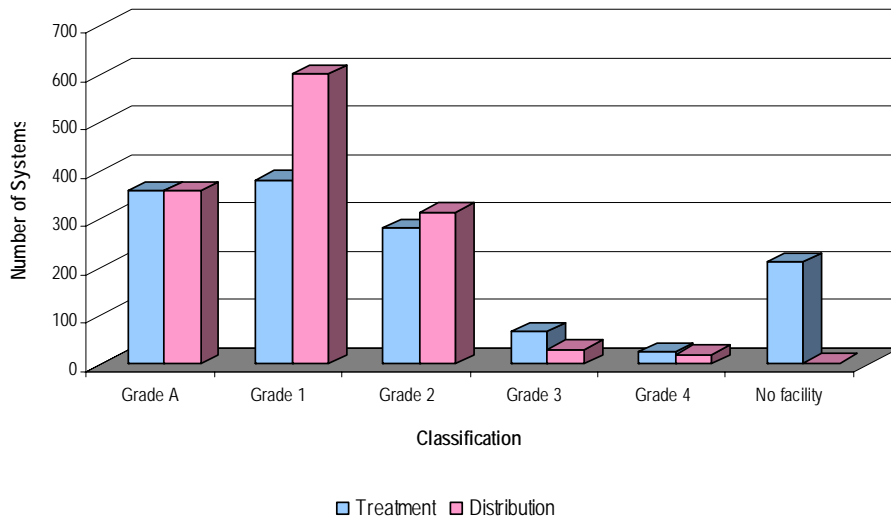

Classification	Treatment Facility	Distribution Facility
Grade A	359	359
Grade 1	381	602
Grade 2	282	314
Grade 3	67	30
Grade 4	25	20
No facility	211	0
Total	1325	1325

Classification Grades for Operator Certification

The Iowa Operator Certification program is predicated on three principles: Education, Experience, and Examination. A certified drinking water operator in Iowa must meet these requirements:


1. Meet the initial education and experience requirements and pay the examination fee
2. Successfully pass the examination for the specific type of certification
3. Maintain the certification by successfully attaining the required continuing education credits during each two-year certification period and paying the bi-annual certification fee

The requirements are based upon the level of complexity of the various facility grades, with Grade A being the least complex and Grade 4 being the most complex.

In 2006, there were 323 small system Grade A certifications, which continues the increasing trend from 2004 and 2005. Grade A certification includes both water treatment and water distribution. In this reporting period, there were 2,196 active Grades 1 – 4 water distribution certifications and 2,086 active Grades 1-4 water treatment certifications, both of which increased from 2005 levels.

Certification Grade	Number of certified Water Distribution Operators	Number of certified Water Treatment Operators
Grade A	323 (combined WT and WD)	
Grade 1	501	755
Grade 2	772	916
Grade 3	598	244
Grade 4	325	171

The following chart depicts the makeup of the two types of drinking water certifications. Note that Grade A is included in both certifications, since it is a combined water distribution and water treatment certification.

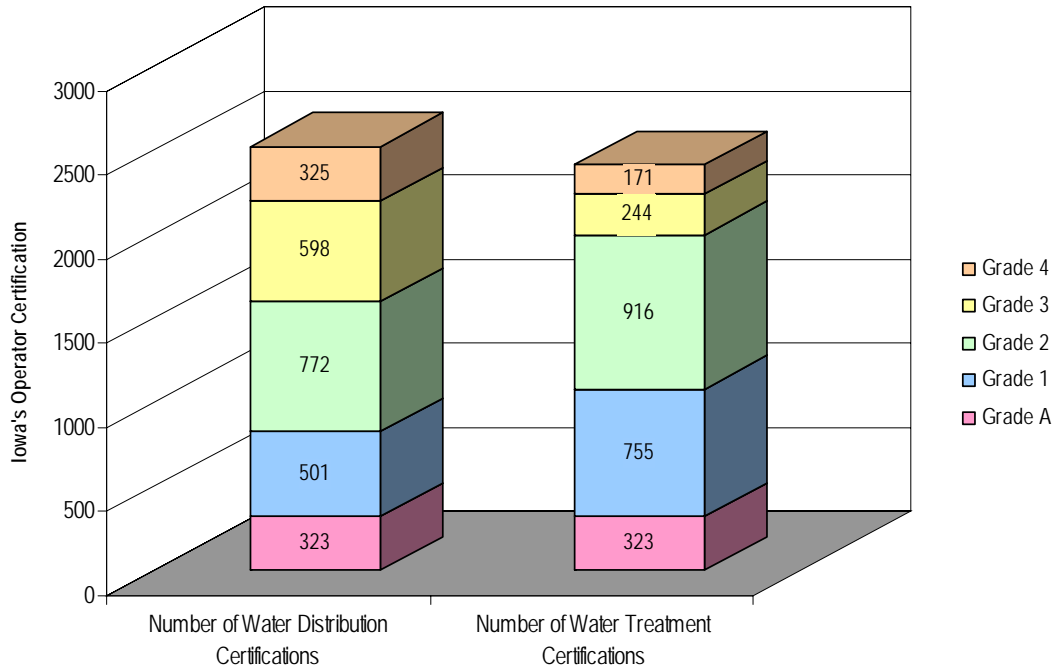

Enforcement

Compliance actions were directed at 31 public water supply systems that failed to have a certified operator in charge of their water supply. There were no certification revocations during this reporting period.

Certification Renewal

Operator certifications are renewed every two years, with the next renewal period ending in June 30, 2007. Continuing education requirements must have been met by March 31, 2007 in order for the operator to renew for the next period. Operators holding a Grade A, 1 or 2 certification are required to earn 1.0 continuing education unit (10 contact hours). Operators holding a Grade 3 or 4 certification must earn 2.0 continuing education units (20 contact hours).

Shown below are various components of water treatment and distribution systems in Iowa.



Pump & pipe gallery



Contact basin



Office with computerized remote system-wide monitoring capability (typically called a SCADA system, or *Supervisory Control And Data Acquisition* system).



Interior of an elevated water storage tower

Abbreviations

AG	Attorney General of Iowa
AL	action level
AOP	administrative order with penalty
AOWP	administrative order without penalty
BCA	bilateral compliance agreement
CCR	consumer confidence report
CT	contact time
Cu	chemical symbol for copper
CWS	community public water supply
EPA	U.S. Environmental Protection Agency
FDA	U.S. Food and Drug Administration
GW	groundwater
IGW	groundwater under the direct influence of surface water
HA	Health Advisory
HAA5	haloacetic acids (5)
HPC	heterotrophic plate count
IAC	Iowa Administrative Code
IDNR	Iowa Department of Natural Resources
IOC	inorganic chemical
LSL	lead service line
MCL	maximum contaminant level
mg/L	milligrams per liter
M/R	Monitoring and Reporting
MRDL	maximum residual disinfectant level
mrem/yr	millirems per year
NOV	Notice of Violation
NTNC	non-transient non-community public water supply
NTU	nephelometric turbidity units
Pb	chemical symbol for lead
pCi/L	picocuries per liter
PE	public education for Lead
PN	public notification
PWS	public water supply system
PWSS	Public Water System Supervision (EPA program)
Rn	chemical symbol for radon
SDWA	Safe Drinking Water Act
SDWIS/FED	Safe Drinking Water Information System/Federal (EPA's electronic database)
SOC	synthetic (nonvolatile) organic chemical
SW	surface water
SWTR	Surface Water Treatment Rule
TCR	Total Coliform Rule
TNC	transient non-community public water supply
TT	treatment technique
TTHM	total trihalomethanes
U	chemical symbol for uranium
V/E	variance or exemption
VOC	volatile organic chemical
WD	water distribution
WT	water treatment
WQP	water quality parameters

Distribution of this Report

The Safe Drinking Water Act requires both summary and detailed reports from the State be accessible to the U.S. EPA, the Governor of Iowa, and the public. The following options are utilized to make this report readily available to the public.

The IDNR sends the detailed report to the:

- EPA Headquarters in Washington, DC,
- EPA Region 7 Headquarters in Kansas City, KS, and
- Office of the Governor of Iowa.

The IDNR also:

- publishes an official notice of report availability,
- includes the report on the IDNR Internet website and makes it available for downloading, and
- makes the detailed and summary report available for individuals and organizations upon request.

Staff Contact Information:

Name	Telephone	Primary Responsibilities	Title
Diane Moles	515/725-0281	Rules and Policy Development	Executive Officer II
Hal Frank	515/725-0342	SDWIS Data Management	Environmental Specialist
Laurie Sharp	515/725-0284	Operator Certification Program	Program Planner 2
Dennis Alt	515/725-0275	Water Supply Engineering Section Supervisor	Env. Program Supervisor

Fax number for all of the above: 515/725-0348

E-mail addresses: *first name.last name@dnr.state.ia.us*

Mailing address:

Iowa Department of Natural Resources - Water Supply
401 SW 7th St., Suite M
Des Moines, IA 50309-4611

Photo attribution: All photos in this report were taken by IDNR Water Supply Sections Staff and, with the exception of the State Capitol on this page, are of systems that have participated in the Iowa Drinking Water State Revolving Loan Fund program.



APPENDIX A: EPA Violations Summary Report

The EPA Violations Summary Report listed in this appendix is a numerical total of the violations of each contaminant required under the SDWA and is a required report element. This report lists the number of violations of each contaminant categorized by both MCL/MRD/TT Violations and major federal Monitoring & Reporting Violations. State violations, such as failure to obtain an operation permit, are not included in this summary report.

Legend

Column (from left to right)	Description of Heading
1	The first column identifies the contaminant name
2	The second column identifies the MCL for that contaminant
3	The third column identifies the number of MCL violations for that contaminant
4	The fourth column identifies the number of PWSs with MCL violations for that contaminant
5	The fifth column identifies the number of TT violations
6	The sixth column identifies the number of PWSs with TT violations
7	The seventh column identifies the number of M/R violations for that contaminant
8	The eighth column identifies the number of PWSs with M/R violations for that contaminant



APPENDIX A: EPA VIOLATIONS SUMMARY REPORT

State: Iowa		Reporting Interval: January 1, 2006 through December 31, 2006					
Organic Contaminants	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations	Number of Violations	Number of Systems with Violations
1,1,1-Trichloroethane	0.2	0	0	0	0	5	5
1,1,2-Trichloroethane	0.005	0	0	0	0	5	5
1,1-Dichloroethylene	0.007	0	0	0	0	5	5
1,2,4-Trichlorobenzene	0.07	0	0	0	0	5	5
1,2-Dibromo-3-chloropropane (DBCP)	0.0002	0	0	0	0	0	0
1,2-Dichloroethane	0.005	0	0	0	0	5	5
1,2-Dichloropropane	0.005	0	0	0	0	5	5
2,3,7,8-TCDD (Dioxin)	0.00000008	0	0	0	0	0	0
2,4,5-TP (Silvex)	0.05	0	0	0	0	5	5
2,4-D	0.07	0	0	0	0	5	5
Acrylamide		0	0	0	0	0	0
Alachlor (Lasso)	0.002	0	0	0	0	5	5
Atrazine	0.003	0	0	0	0	5	5
Benzene	0.005	1	1	0	0	5	5
Benzo[a]pyrene	0.0002	0	0	0	0	5	5
Carbofuran	0.04	0	0	0	0	0	0
Carbon tetrachloride	0.005	0	0	0	0	5	5
Chlordane	0.002	0	0	0	0	0	0

Organic Contaminants, continued	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
cis-1,2-Dichloroethylene	0.07	0	0	0	0	5	5
Dalapon	0.2	0	0	0	0	5	5
Di(2-ethylhexyl)adipate	0.4	0	0	0	0	5	5
Di(2-ethylhexyl)phthalate	0.006	1	1	0	0	8	8
Dichloromethane	0.005	0	0	0	0	5	5
Dinoseb	0.007	0	0	0	0	5	5
Diquat	0.02	0	0	0	0	0	0
Endothall	0.1	0	0	0	0	0	0
Endrin	0.002	0	0	0	0	0	0
Epichlorohydrin		0	0	0	0	0	0
Ethylbenzene	0.7	0	0	0	0	5	5
Ethylene dibromide	0.00005	0	0	0	0	0	0
Glyphosate	0.7	0	0	0	0	0	0
Heptachlor	0.0004	0	0	0	0	0	0
Heptachlor epoxide	0.0002	0	0	0	0	0	0
Hexachlorobenzene	0.001	0	0	0	0	0	0
Hexachlorocyclopentadiene	0.05	0	0	0	0	0	0
Lindane	0.0002	0	0	0	0	0	0
Methoxychlor	0.04	0	0	0	0	0	0

Organic Contaminants, continued	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Monochlorobenzene	0.1	0	0	0	0	5	5
o-Dichlorobenzene	0.6	0	0	0	0	5	5
Oxamyl (Vydate)	0.2	0	0	0	0	0	0
para-Dichlorobenzene	0.075	0	0	0	0	5	5
Pentachlorophenol	0.001	0	0	0	0	5	5
Picloram	0.5	0	0	0	0	5	5
Simazine	0.004	0	0	0	0	5	5
Styrene	0.1	0	0	0	0	5	5
Tetrachloroethylene	0.005	0	0	0	0	5	5
Toluene	1	0	0	0	0	5	5
Total polychlorinated biphenyls	0.0005	0	0	0	0	0	0
Toxaphene	0.003	0	0	0	0	0	0
trans-1,2-Dichloroethylene	0.1	0	0	0	0	5	5
Trichloroethylene	0.005	0	0	0	0	5	5
Vinyl chloride	0.002	0	0	0	0	5	5
Xylenes (total)	10	0	0	0	0	7	7
Haloacetic acids	0.060	2	2	0	0	19	19
Total trihalomethanes	0.080	36	18	0	0	18	18

Inorganic Contaminants	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Antimony	0.006	0	0	0	0	6	6
Arsenic	0.010	16	7	0	0	4	4
Asbestos	7 million fibers/L (>10 µm in length)	0	0	0	0	0	0
Barium	2	0	0	0	0	6	6
Beryllium	0.004	0	0	0	0	0	0
Cadmium	0.005	0	0	0	0	6	6
Chromium	0.1	0	0	0	0	6	6
Cyanide (as free cyanide)	0.2	0	0	0	0	0	0
Fluoride	4.0	0	0	0	0	5	5
Mercury	0.002	0	0	0	0	6	6
Nitrate	10 (as Nitrogen)	64	19	0	0	150	112
Nitrite	1.0 (as Nitrogen)	2	1	0	0	9	9
Selenium	0.05	0	0	0	0	6	6
Sodium	not applicable	0	0	0	0	5	5
Thallium	0.002	0	0	0	0	6	6
Total nitrate and nitrite	10 (as Nitrogen)	NA	NA	NA	NA	NA	NA

Contaminant	MCL	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Radionuclide Contaminants							
Gross alpha	15 pCi/L	1	1	0	0	5	5
Radium-226 and radium-228	5 pCi/L	11	6	0	0	6	4
Gross beta	4 mrem/year	0	0	0	0	0	0
Uranium	30 µg/L	0	0	0	0	0	0
Subtotal		134	52*	0	0	433	154*

*: Each system is only counted once in the subtotal category (i.e., 52 systems had 134 MCL violations and 154 systems had 433 monitoring/reporting violations).

Contaminant	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Other Contaminants							
Acute Total Coliform Bacteria MCL violation	Presence	31	19	0	0	0	0
Non-acute Total Coliform Bacteria MCL violation	Presence	197	120	0	0	0	0
Major routine and follow up Total Coliform Bacteria monitoring violation		0	0	0	0	382	213
Sanitary survey		0	0	0	0	State initiates Sanitary survey	State initiates Sanitary survey
Subtotal		228	119*	0	0	382	213

*Each system is counted only once in the subtotal category, i.e., 119 systems had 228 acute and non-acute coliform bacteria violations.

Contaminant	MCL (mg/L)	MCLs		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Surface Water Treatment Rule, Interim Enhanced SWTR, & LT1 *							
Filtered systems *		0	0	0	0	0	0
Monitoring, routine/repeat		0	0	0	0	1	1
Treatment techniques		0	0	3	1	0	0
Unfiltered systems *		0	0	0	0	0	0
Monitoring, routine/repeat		0	0	0	0	0	0
Failure to filter		0	0	0	0	0	0
Subtotal		0	0	3	1	1	1

* All surface water and influenced groundwater systems in Iowa have filtration.

Contaminant	Action Level	Action Level Exceedance		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Lead and Copper Rule	Lead: 0.015 mg/L Copper: 1.3 mg/L	Lead: 15 Copper: 14	Lead: 14 Copper: 12	2	2	1	1
Initial lead and copper tap M/R		0	0	0	0	0	0
Follow-up or routine lead and copper tap M/R		0	0	0	0	Cu: 25 Pb: 25	Cu: 24 Pb: 24
Treatment installation		0	0	0	0	0	0
Public education		0	0	0	0	0	0
Subtotal		29	26*	2	2*	51	25*

*: Each system is only counted once in the subtotal category (i.e., 26 systems had 29 ALE and 25 systems had 51 monitoring/reporting violations).

Contaminant	MRDL or MCL	MRDL or MCL Violations		Treatment Techniques		Significant Monitoring/Reporting	
		Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations	Number of Violations	Number of Systems With Violations
Stage 1 DBPR (TTHM & HAA included under Organic Contaminants)							
Chlorine or chloramine residual	4.0	0	0	0	0	52 monitoring 63 reporting	37 monitoring 53 reporting
Chlorine dioxide	0.8 mg/L	0	0	0	0	0	0
Chlorite	1.0 mg/L	0	0	0	0	0	0
Bromate	0.010 mg/L	0	0	0	0	0	0
Total organic carbon (TOC)		0	0	0	0	2	2
Subtotal		0	0	0	0	117	83*


*: Each system is only counted once in the subtotal category (i.e., 83 systems had 117 monitoring/reporting violations).

APPENDIX B: Iowa Public Water Supply Violation Data

All public water supply systems that incurred one or more violations during 2006 are listed in the following appendix, including the most recent enforcement action. Systems that became "inactive" during the year because they no longer met the definition of a public water supply are denoted in boldface print on the table.

Legend

Item	Description
PWS Name	Business name of the Public Water System
Minimum Population Served	Population that could use the water, as reported to IDNR by the PWS. For municipal systems, it is the most recent official census.
County	County location of PWS
PWSID Number	Public Water System Identification number, a unique and dedicated number permanently assigned to each PWS
PWS Type	Classification type of PWS: community public water system (CWS), non-transient non-community system (NTNC), or transient non-community system (TNC)
Violation Number	A unique, dedicated identification number assigned to each violation as it occurs.
Analyte	The analyte that triggered the violation.
Compliance Period End Date	Date at the end of the compliance period in which the violation occurred.
Violation	The EPA-assigned text description of the violation.
Violation Type	The alphabetic code description of the violation.
Enforcement Action Date	Most recent action taken by the PWS or the IDNR in response to the violation. The final action for any violation is "Compliance Achieved", meaning the system is now in compliance.
Enforcement Action	Date the follow-up action or enforcement action occurred

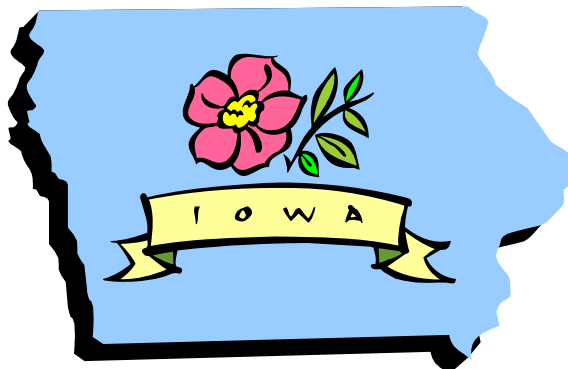

Iowa Public Water Supply System Violations in 2006

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
3RD BASE SPORTS PARK	400	LINN	IA5715204	TNC	2007-00844	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	4/10/2007	Compliance Achieved
59 SHORT STOP	52	MILLS	IA6520201	TNC	2007-00766	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/3/2006	Compliance Achieved
ABBE CENTER FOR COMMUNITY CARE	160	LINN	IA5700900	CWS	2007-01082	Chlorine	9/30/2006	Non-Reported Type	RPT	10/30/2006	NOV issued
ABBE CENTER FOR COMMUNITY CARE	160	LINN	IA5700900	CWS	2007-03610	Chlorine	12/31/2006	Non-Reported Type	RPT	1/22/2007	NOV issued
ABBE CENTER FOR COMMUNITY CARE	160	LINN	IA5700900	CWS	2007-03702	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	4/11/2006	NOV issued
AEROPLANE INN	25	POTTAWATTAMIE	IA7836201	TNC	2006-01807	Nitrate nitrogen	3/31/2006	Routine Major	MON	6/29/2006	Compliance Achieved
AGAPE CHRISTIAN FAMILY CHURCH	208	CERRO GORDO	IA1716802	TNC	2006-01979	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	6/29/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-00962	Nitrate nitrogen	9/30/2006	Routine Major	MON	11/1/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01062	Failure to meet Certified Operator Requirement	10/31/2006	Certified Operator Requirement	STA	11/20/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01704	1,2,4-Trichlorobenzene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01705	cis-1,2-Dichloroethylene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01706	Xylenes	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01707	Dichloromethane	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01708	o-Dichlorobenzene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01709	p-Dichlorobenzene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01710	Vinyl Chloride	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01711	1,1-Dichloroethylene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01712	trans-1,2-Dichloroethylene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01713	1,2-Dichloroethane	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01714	1,1,1-Trichloroethane	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01715	Carbon Tetrachloride	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01716	1,2-Dichloropropane	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01717	Trichloroethylene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01718	1,1,2-Trichloroethane	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01719	Tetrachloroethylene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01720	Monochlorobenzene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01721	Benzene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01722	Toluene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01723	Ethylbenzene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01724	Styrene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01725	Atrazine	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01726	Alachlor (Lasso)	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01727	2,4-D	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01728	2,4,5-TP (Silvex)	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01729	Benzo (a) Pyrene	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01730	Pentachlorophenol	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01731	Dalapon	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01732	Di(2-Ethylhexyl) Adipate	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01733	Simazine	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01734	Di(2-Ethylhexyl) Phthalate	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01735	Picloram	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01736	Dinoseb	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01737	Selenium	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01738	Arsenic	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01739	Barium	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01740	Cadmium	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01741	Chromium	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01742	Fluoride	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01743	Mercury	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01744	Sodium	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01745	Antimony	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AGRI PROCESSORS, INC.	780	ALLAMAKEE	IA0375180	NTNC	2007-01746	Thallium	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
AINSWORTH 4 CORNERS RESTAURANT	400	WASHINGTON	IA9203760	TNC	2006-02645	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/14/2006	Compliance Achieved
AIRLINE INN	53	DUBUQUE	IA3151201	TNC	2006-02909	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	12/7/2006	Compliance Achieved
AIRPORT LAKE PARK-CHICKASAW CCB	50	CHICKASAW	IA1970410	TNC	2006-01989	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/17/2006	Compliance Achieved
AIRPORT LAKE PARK-CHICKASAW CCB	50	CHICKASAW	IA1970410	TNC	2006-02615	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/8/2006	Compliance Achieved
AIRPORT LAKE PARK-CHICKASAW CCB	50	CHICKASAW	IA1970410	TNC	2006-02972	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/9/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
AIRPORT LAKE PARK-CHICKASAW CCB	50	CHICKASAW	IA1970410	TNC	2007-00806	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	4/26/2007	Compliance Achieved
AIRPORT NATIONAL PUBLIC GOLF COMPLEX	260	LINN	IA5715202	TNC	2006-02631	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
ALL GOLF CENTER	94	BLACK HAWK	IA0790201	TNC	2007-00938	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	12/19/2006	Compliance Achieved
ANAMOSA MUNICIPAL WATER SUPPLY	4173	JONES	IA5307048	CWS	2007-01101	Radium 226 & Radium 228	12/31/2006	MCL, Average	MCL	11/16/2006	NOV issued
ANAMOSA TRAVELMART	414	JONES	IA5322201	TNC	2006-02280	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	12/18/2006	Compliance Achieved
ANDREWS PRESTRESSED CONCRETE-OFFICE	65	CERRO GORDO	IA1716891	NTNC	2006-01314	Arsenic	3/31/2006	MCL, Average	MCL	9/12/2006	Compliance Achieved
ANDREWS PRESTRESSED CONCRETE-OFFICE	65	CERRO GORDO	IA1716891	NTNC	2006-01897	Arsenic	6/30/2006	MCL, Average	MCL	9/12/2006	Compliance Achieved
ANTHONY'S RESORT	50	DUBUQUE	IA3183877	TNC	2007-00818	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/20/2006	NOV issued
APOSTOLIC CHURCH	200	JONES	IA5307801	TNC	2006-01865	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/24/2006	Compliance Achieved
ARC CEDAR TERRACE	483	LINN	IA5700600	CWS	2006-02872	Chlorine	6/30/2006	Monitoring (DBP), Major	MON	6/1/2006	Compliance Achieved
ARC CEDAR TERRACE	483	LINN	IA5700600	CWS	2007-03701	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	6/1/2006	Compliance Achieved
ARC EWING TRACE	455	POLK	IA7727604	CWS	2007-00952	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	11/7/2006	NOV issued
ARC EWING TRACE	455	POLK	IA7727604	CWS	2007-00953	Total Trihalomethanes	8/31/2006	Routine Major	MON	11/7/2006	NOV issued
ARC MARION VILLAGE	1220	LINN	IA5751601	CWS	2006-02873	Chlorine	6/30/2006	Monitoring (DBP), Major	MON	7/27/2006	NOV issued
ARC MARION VILLAGE	1220	LINN	IA5751601	CWS	2007-03700	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	4/24/2006	NOV issued
ARC SOUTHRIDGE ESTATES	648	POLK	IA7727603	CWS	2007-01697	Copper	9/30/2006	Routine Tap	MON	11/29/2006	NOV issued
ARC SOUTHRIDGE ESTATES	648	POLK	IA7727603	CWS	2007-01698	Lead	9/30/2006	Routine Tap	MON	11/29/2006	NOV issued
ARC SUNRISE TERRACE	500	JASPER	IA5059601	CWS	2006-03260	Chlorine	7/31/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
ARC SUNRISE TERRACE	500	JASPER	IA5059601	CWS	2007-00954	Total Trihalomethanes	8/31/2006	Routine Major	MON	11/7/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ARC SUNRISE TERRACE	500	JASPER	IA5059601	CWS	2007-00955	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	11/7/2006	NOV issued
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2006-02860	Failure to meet Certified Operator Requirement	5/31/2006	Certified Operator Requirement	STA	5/17/2006	NOV issued
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2007-03616	Copper	12/31/2006	AL, 90th Percentile	MCL	2/1/2007	BCA issued
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2007-03618	Copper	12/31/2006	Treatment Technique (LCR)	TT	2/1/2007	NOV issued
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2007-03629	Chlorine	5/31/2006	Monitoring (DBP), Major	MON	11/30/2006	NOV issued
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2007-03630	Chlorine	6/30/2006	Monitoring (DBP), Major	MON	11/30/2006	NOV issued
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2007-03631	Chlorine	7/31/2006	Monitoring (DBP), Major	MON	11/30/2006	NOV issued
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2007-03632	Chlorine	8/31/2006	Monitoring (DBP), Major	MON	11/30/2006	NOV issued
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2007-03633	Chlorine	9/30/2006	Monitoring (DBP), Major	MON	11/30/2006	NOV issued
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2007-03634	Chlorine	10/31/2006	Monitoring (DBP), Major	MON	11/30/2006	NOV issued
ARMSTRONG WATER SUPPLY	986	EMMET	IA3203066	CWS	2007-03635	Chlorine	11/30/2006	Monitoring (DBP), Major	MON	11/30/2006	NOV issued
AURELIA WATER SUPPLY	1062	CHEROKEE	IA1803079	CWS	2006-03104	Gross Alpha, excluding Rn & U	6/30/2006	Routine Major	MON	9/14/2006	Compliance Achieved
AVALON SUPPER CLUB INC.	77	DUBUQUE	IA3128314	TNC	2007-00002	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	10/9/2006	NOV issued
AVALON SUPPER CLUB INC.	77	DUBUQUE	IA3128314	TNC	2007-01106	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	12/21/2006	Compliance Achieved
BAILEYS FORD PARK - DELAWARE CCB	25	DELAWARE	IA2839910	TNC	2007-00024	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	10/19/2006	NOV issued
BANCROFT WATER SUPPLY	808	KOSSUTH	IA5507085	CWS	2006-03242	Gross Alpha, excluding Rn & U	6/30/2006	Routine Major	MON	9/5/2006	Compliance Achieved
BANKSTON PUBLIC WATER SYSTEM	38	DUBUQUE	IA3109086	TNC	2007-03589	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
BAR-L-RANCH	56	GUTHRIE	IA3937444	TNC	2007-01114	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	12/4/2006	Compliance Achieved
BAR-L-RANCH	56	GUTHRIE	IA3937444	TNC	2007-01115	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	12/4/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BAR-L-RANCH	56	GUTHRIE	IA3937444	TNC	2007-01863	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	12/22/2006	NOV issued
BARN HAPPY	39	BLACK HAWK	IA0709209	TNC	2006-02760	Nitrite nitrogen	6/30/2006	Routine Major	MON	8/24/2006	Compliance Achieved
BARNES CITY WATER SUPPLY	201	POWESHIEK	IA7905088	CWS	2006-03261	Chlorine	7/31/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2006-01699	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	7/25/2006	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2006-01845	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	7/25/2006	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2006-02152	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	7/25/2006	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2006-02362	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	7/25/2006	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2006-02712	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	12/26/2006	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2006-02713	Nitrate nitrogen	6/30/2006	Routine Major	MON	12/26/2006	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2006-03489	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	10/23/2006	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2007-00923	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/23/2006	Compliance Achieved
BEACH GIRLS BAR	155	DALLAS	IA2509202	TNC	2007-01964	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/25/2006	Compliance Achieved
BEACHLAND INN	40	DELAWARE	IA2800622	CWS	2006-01571	Failure to meet Certified Operator Requirement	2/28/2006	Certified Operator Requirement	STA	12/1/2006	Compliance Achieved
BEACHLAND INN	40	DELAWARE	IA2800622	CWS	2007-03505	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
BEACON WATER SUPPLY	518	MAHASKA	IA6203093	CWS	2006-01790	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/4/2006	Compliance Achieved
BEACON WATER SUPPLY	518	MAHASKA	IA6203093	CWS	2007-01244	Total Haloacetic Acids	9/30/2006	Monitoring (DBP), Major	MON	12/5/2006	Compliance Achieved
BEACON WATER SUPPLY	518	MAHASKA	IA6203093	CWS	2007-01245	Total Trihalomethanes	9/30/2006	Routine Major	MON	12/5/2006	Compliance Achieved
BEAVER HILLS COUNTRY CLUB	107	BLACK HAWK	IA0709886	TNC	2006-01814	Nitrate nitrogen	3/31/2006	Routine Major	MON	4/25/2006	Compliance Achieved
BEAVER HILLS COUNTRY CLUB	107	BLACK HAWK	IA0709886	TNC	2006-01981	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/24/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BEAVER HILLS COUNTRY CLUB	107	BLACK HAWK	IA0709886	TNC	2006-02608	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/10/2006	Compliance Achieved
BEAVER HILLS COUNTRY CLUB	107	BLACK HAWK	IA0709886	TNC	2007-01175	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	12/4/2006	Compliance Achieved
BEAVER HILLS COUNTRY CLUB	107	BLACK HAWK	IA0709886	TNC	2007-01911	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/4/2006	Compliance Achieved
BEAVER HILLS COUNTRY CLUB	107	BLACK HAWK	IA0709886	TNC	2007-03588	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
BIG CANOE LUTHERAN CHURCH	103	WINNESHIEK	IA9630872	TNC	2007-03399	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	2/26/2007	Compliance Achieved
BIG CANOE LUTHERAN CHURCH	103	WINNESHIEK	IA9630872	TNC	2007-03439	Nitrate nitrogen	12/31/2006	Routine Major	MON	2/26/2007	Compliance Achieved
BIG CANOE LUTHERAN CHURCH	103	WINNESHIEK	IA9630872	TNC	2007-03440	Nitrite nitrogen	12/31/2006	Routine Major	MON	2/26/2007	Compliance Achieved
BIG CREEK BLUFFS	80	LINN	IA5784309	CWS	2007-01037	Chlorine	5/31/2006	Non-Reported Type	RPT	5/26/2006	NOV issued
BIG O MART	384	BUCHANAN	IA1003201	TNC	2006-02611	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	10/18/2006	Compliance Achieved
BIG O MART	384	BUCHANAN	IA1003201	TNC	2007-00793	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/18/2006	Compliance Achieved
BLACK DIAMOND ROADHOUSE	52	JOHNSON	IA5260202	TNC	2007-00944	Nitrate nitrogen	9/30/2006	Routine Major	MON	12/4/2006	Compliance Achieved
BLAKESBURG MUNICIPAL WATER WORKS	374	WAPELLO	IA9027014	CWS	2007-00875	Total Trihalomethanes	8/31/2006	Routine Major	MON	11/1/2006	NOV issued
BLAKESBURG MUNICIPAL WATER WORKS	374	WAPELLO	IA9027014	CWS	2007-00876	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	11/1/2006	NOV issued
BLUE GRASS WATER SUPPLY	1169	SCOTT	IA8215021	CWS	2006-01684	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/20/2006	Compliance Achieved
BLUE GRASS WATER SUPPLY	1169	SCOTT	IA8215021	CWS	2006-02996	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	9/19/2006	Compliance Achieved
BLUE GRASS WATER SUPPLY	1169	SCOTT	IA8215021	CWS	2006-03089	Nitrate nitrogen	7/31/2006	Routine Major	MON	8/31/2006	Compliance Achieved
BLUE GRASS WATER SUPPLY	1169	SCOTT	IA8215021	CWS	2007-03542	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/26/2007	Compliance Achieved
BLUFFTON STORE	43	WINNESHIEK	IA9630773	TNC	2007-03587	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2007-00822	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	10/19/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BOONDOCKS CAFÉ	959	HAMILTON	IA4070201	NTNC	2007-00823	Total Trihalomethanes	8/31/2006	Routine Major	MON	10/19/2006	NOV issued
BOWLAWAY LANES	30	CHICKASAW	IA1970204	TNC	2006-01835	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/4/2006	Compliance Achieved
BRADYVILLE WATER WORKS	176	PAGE	IA7324038	CWS	2007-03408	Nitrate nitrogen	12/31/2006	Routine Major	MON	2/1/2007	Compliance Achieved
BRADFORD HOUSE	50	CHICKASAW	IA1967222	TNC	2007-00803	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	2/5/2007	Compliance Achieved
BRADFORD HOUSE	50	CHICKASAW	IA1967222	TNC	2007-03414	Nitrate nitrogen	12/31/2006	Routine Major	MON	2/5/2007	Compliance Achieved
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2006-02321	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	7/12/2006	Compliance Achieved
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2006-02605	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/12/2006	Compliance Achieved
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2006-03443	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	5/7/2007	Referral for AO
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2007-00787	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	5/7/2007	Referral for AO
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2007-01171	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	5/7/2007	Referral for AO
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2007-01910	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	5/7/2007	Referral for AO
BRAINARDS COUNTRY CHANGE	76	CLAYTON	IA0375301	TNC	2007-03370	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	5/7/2007	Referral for AO
BRANDON WATER SUPPLY	311	BUCHANAN	IA1011001	CWS	2006-01932	Failure to meet Certified Operator Requirement	4/30/2006	Certified Operator Requirement	STA	5/9/2006	Compliance Achieved
BREWSKIS BAR AND GRILL	28	WINNESHIEK	IA9609774	TNC	2006-01799	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	2/8/2007	Compliance Achieved
BREWSKIS BAR AND GRILL	28	WINNESHIEK	IA9609774	TNC	2006-02646	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	2/13/2007	Compliance Achieved
BREWSKIS BAR AND GRILL	28	WINNESHIEK	IA9609774	TNC	2006-02673	Nitrate nitrogen	6/30/2006	Routine Major	MON	2/13/2007	Compliance Achieved
BREWSKIS BAR AND GRILL	28	WINNESHIEK	IA9609774	TNC	2007-00883	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	2/8/2007	Compliance Achieved
BREWSKIS BAR AND GRILL	28	WINNESHIEK	IA9609774	TNC	2007-03398	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	2/8/2007	Compliance Achieved
BRIARWOOD ESTATES	60	DUBUQUE	IA3170301	CWS	2006-02787	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	1/9/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02041	Dalapon	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02042	Di(2-Ethylhexyl) Adipate	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02043	Simazine	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02044	Di(2-Ethylhexyl) Phthalate	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02045	Picloram	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02046	Dinoseb	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02047	Atrazine	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02048	Alachlor (Lasso)	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02049	2,4-D	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02050	2,4,5-TP (Silvex)	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02051	Benzo (a) Pyrene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02052	Pentachlorophenol	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02053	Dichloromethane	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02054	o-Dichlorobenzene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02055	p-Dichlorobenzene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02056	Vinyl Chloride	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02057	1,1-Dichloroethylene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02058	trans-1,2-Dichloroethylene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02059	1,2-Dichloroethane	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02060	1,1,1-Trichloroethane	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02061	Carbon Tetrachloride	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02062	1,2-Dichloropropane	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02063	Trichloroethylene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02064	1,1,2-Trichloroethane	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02065	Tetrachloroethylene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02066	Monochlorobenzene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02067	Benzene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02068	Toluene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02069	Ethylbenzene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02070	Styrene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02071	1,2,4-Trichlorobenzene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02072	cis-1,2-Dichloroethylene	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROADVIEW TRAILER COURT	54	DUBUQUE	IA3100675	CWS	2006-02073	Xylenes	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
BROGANS PUB & GRUB	30	LINN	IA5765201	TNC	2006-01840	Nitrate nitrogen	3/31/2006	Routine Major	MON	4/25/2006	Compliance Achieved
BROGANS PUB & GRUB	30	LINN	IA5765201	TNC	2006-02333	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	2/27/2007	Compliance Achieved
BROGANS PUB & GRUB	30	LINN	IA5765201	TNC	2006-02916	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	2/27/2007	Compliance Achieved
BROOKHILL ESTATES	36	CLINTON	IA2330301	CWS	2006-01666	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/20/2006	Compliance Achieved
BROOKHILL ESTATES	36	CLINTON	IA2330301	CWS	2006-02680	Nitrate nitrogen	6/30/2006	Routine Major	MON	9/19/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
BROOKHILL ESTATES	36	CLINTON	IA2330301	CWS	2006-02973	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/31/2006	Compliance Achieved
BROOKHILL ESTATES	36	CLINTON	IA2330301	CWS	2007-03543	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/26/2007	Compliance Achieved
BUBBAS BAR & GRILL	25	HOWARD	IA4515782	TNC	2006-03556	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	10/9/2006	NOV issued
BUBBAS BAR & GRILL	25	HOWARD	IA4515782	TNC	2007-00022	Coliform Bacteria, Fecal	9/30/2006	MCL (TCR), Acute	MCL	10/9/2006	NOV issued
BUBBAS BAR & GRILL	25	HOWARD	IA4515782	TNC	2007-01118	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	11/30/2006	Compliance Achieved
BUDDES SHORT STOP	100	DUBUQUE	IA3126210	TNC	2006-01852	Nitrate nitrogen	3/31/2006	Routine Major	MON	5/31/2006	Compliance Achieved
BUFFALO CREEK - HICKORY HILL	25	LINN	IA5720975	TNC	2006-02805	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	8/2/2006	NOV issued
BUFFALO CREEK - HICKORY HILL	25	LINN	IA5720975	TNC	2006-03397	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	10/11/2006	Compliance Achieved
BUFFALO CREEK COUNTRY CLUB	60	BUCHANAN	IA1093897	TNC	2006-02323	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	7/6/2006	Compliance Achieved
BULGERS HOLLOW RECREATION AREA	77	CLINTON	IA4929901	TNC	2007-03388	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	4/25/2007	Compliance Achieved
BURDS GREEN ACRES SUBDIVISION	300	DUBUQUE	IA3170302	CWS	2007-01081	Chlorine	9/30/2006	Non-Reported Type	RPT	10/30/2006	NOV issued
BURR OAK MERCANTILE CO.	100	WINNESHIEK	IA9609865	TNC	2006-02708	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/22/2006	Compliance Achieved
BUSSEY WATER SUPPLY	792	MARION	IA6309061	CWS	2007-03925	Copper	9/30/2006	Routine Tap	MON	3/8/2007	NOV issued
BUSSEY WATER SUPPLY	792	MARION	IA6309061	CWS	2007-03926	Lead	9/30/2006	Routine Tap	MON	3/8/2007	NOV issued
BUZZYS	42	CLINTON	IA2391203	TNC	2006-01854	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/19/2006	Compliance Achieved
CAFE IGUANAS INC	32	JOHNSON	IA5221206	TNC	2006-03493	Nitrate nitrogen	8/31/2006	Routine Major	MON	9/5/2006	Compliance Achieved
CAFE IGUANAS INC	32	JOHNSON	IA5221206	TNC	2007-01641	Nitrate nitrogen	10/31/2006	Routine Major	MON	11/6/2006	Compliance Achieved
CAMBRIDGE WATER SUPPLY	819	STORY	IA8509069	CWS	2007-03503	Copper	12/31/2006	AL, 90th Percentile	MCL	1/23/2007	NOV issued
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2006-01614	Coliform Bacteria, Total	3/31/2006	MCL (TCR), Monthly	MCL	9/30/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CAMP COURAGEOUS OF IOWA	100	JONES	IA5343408	TNC	2006-01675	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/8/2006	Compliance Achieved
CAMP DODGE WATER SUPPLY	652	POLK	IA7700901	CWS	2006-01628	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	1/11/2006	BCA issued
CAMP DODGE WATER SUPPLY	652	POLK	IA7700901	CWS	2006-02824	Total Trihalomethanes	9/30/2006	MCL, Average	MCL	1/11/2006	BCA issued
CAMP EWALU - OUTPOST	27	CLAYTON	IA2279401	TNC	2006-02271	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	6/22/2006	NOV issued
CAMP EWALU - PIONEER	27	CLAYTON	IA2279402	TNC	2006-02272	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	8/16/2006	Compliance Achieved
CAMP EWALU - PIONEER	27	CLAYTON	IA2279402	TNC	2006-02470	Nitrate nitrogen	9/30/2006	MCL, Single	MCL	8/16/2006	Compliance Achieved
CAMP EWALU - PIONEER	27	CLAYTON	IA2279402	TNC	2006-02791	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	8/16/2006	Compliance Achieved
CAMP EWALU - PIONEER	27	CLAYTON	IA2279402	TNC	2007-03711	Failure to Obtain Construction Permit	6/30/2006	Construction without a permit	STA	8/16/2006	Compliance Achieved
CAMP SHALOM	120	JACKSON	IA4950401	TNC	2006-01864	Nitrate nitrogen	3/31/2006	Routine Major	MON	7/20/2006	Compliance Achieved
CAMP SHALOM	120	JACKSON	IA4950401	TNC	2006-01866	Nitrate nitrogen	3/31/2006	Routine Major	MON	7/20/2006	Compliance Achieved
CARLISLE WATER SUPPLY	3497	WARREN	IA9113071	CWS	2006-02858	Failure to submit Operation Permit Application	8/31/2006	Permit Application Submittal	RPT	8/9/2006	NOV issued
CASEYS STORE 2512	30	JOHNSON	IA5221210	TNC	2007-00939	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
CASTANA MUNICIPAL WATER SUPPLY	178	MONONA	IA6715083	CWS	2006-03004	Nitrate nitrogen	7/31/2006	Routine Major	MON	8/28/2006	Compliance Achieved
CASTANA MUNICIPAL WATER SUPPLY	178	MONONA	IA6715083	CWS	2006-03329	Nitrate nitrogen	8/31/2006	MCL, Single	MCL	4/4/2007	BCA issued
CASTANA MUNICIPAL WATER SUPPLY	178	MONONA	IA6715083	CWS	2006-03356	Nitrate nitrogen	9/30/2006	MCL, Single	MCL	4/4/2007	BCA issued
CEDAR RAPIDS HORSEMANS CLUB	60	LINN	IA5715210	TNC	2007-00971	Nitrite nitrogen	9/30/2006	Routine Major	MON	10/20/2006	NOV issued
CEDAR RAPIDS HORSEMANS CLUB	60	LINN	IA5715210	TNC	2007-03476	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	5/11/2007	Compliance Achieved
CEDAR VALLEY GOLF	27	CEDAR	IA1689202	TNC	2006-02739	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/15/2006	Compliance Achieved
CEDAR VALLEY PRODUCE AUCTION	42	HOWARD	IA4525202	TNC	2006-02952	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	9/25/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CEDARCREST GOLF & COUNTRY CLUB	146	LOUISA	IA5815825	TNC	2006-01917	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	5/8/2006	NOV issued
CEDARCREST GOLF & COUNTRY CLUB	146	LOUISA	IA5815825	TNC	2007-01046	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	11/3/2006	NOV issued
CENTRAL BAPTIST CHURCH	101	POTTAWATTAMIE	IA7820851	TNC	2006-02642	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/24/2006	Compliance Achieved
CENTRAL BAPTIST CHURCH	101	POTTAWATTAMIE	IA7820851	TNC	2007-03412	Nitrate nitrogen	12/31/2006	Routine Major	MON	4/26/2007	Compliance Achieved
CENTRAL IOWA WATER ASSN (WAVERLY)	25	BREMER	IA0990701	CWS	2006-01735	Construction contrary to permit	3/31/2006	Construction permit violation	STA	3/30/2006	NOV issued
CENTURY OAKS	99	SCOTT	IA8209303	CWS	2006-01683	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/20/2006	Compliance Achieved
CENTURY OAKS	99	SCOTT	IA8209303	CWS	2006-02995	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/29/2006	Compliance Achieved
CENTURY OAKS	99	SCOTT	IA8209303	CWS	2006-03543	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	4/10/2007	Compliance Achieved
CENTURY OAKS	99	SCOTT	IA8209303	CWS	2007-01022	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	11/13/2006	Compliance Achieved
CENTURY OAKS	99	SCOTT	IA8209303	CWS	2007-03544	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/26/2007	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-01747	Total Haloacetic Acids	3/31/2006	MCL, Average	MCL	8/25/2005	BCA issued
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-02392	Total Trihalomethanes	6/30/2006	MCL, Average	MCL	8/25/2005	BCA issued
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03105	1,2,4-Trichlorobenzene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03106	cis-1,2-Dichloroethylene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03107	Xylenes	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03108	Dichloromethane	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03109	o-Dichlorobenzene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03110	p-Dichlorobenzene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03111	Vinyl Chloride	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03112	1,1-Dichloroethylene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03113	trans-1,2-Dichloroethylene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03114	1,2-Dichloroethane	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03115	1,1,1-Trichloroethane	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03116	Carbon Tetrachloride	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03117	1,2-Dichloropropane	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03118	Trichloroethylene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03119	1,1,2-Trichloroethane	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03120	Tetrachloroethylene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03121	Monochlorobenzene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03122	Benzene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03123	Toluene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03124	Ethylbenzene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2006-03125	Styrene	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2007-00014	Total Trihalomethanes	9/30/2006	MCL, Average	MCL	8/25/2005	BCA issued
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2007-02021	Total Trihalomethanes	12/31/2006	MCL, Average	MCL	1/9/2007	NOV issued
CHARITON MUNICIPAL WATER WORKS	4573	LUCAS	IA5903011	CWS	2007-04395	Turbidity	2/28/2006	Monitoring (MOR)	MON	2/22/2006	NOV issued
CHERRY HILLS SUBDIVISION	47	JOHNSON	IA5225305	CWS	2006-01950	Chlorine	4/30/2006	Monitoring (DBP), Major	MON	4/9/2007	Compliance Achieved
CHESTER WATER SUPPLY	151	HOWARD	IA4509024	CWS	2007-02038	Failure to Obtain Construction Permit	3/31/2006	Construction without a permit	STA	6/6/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CHESTNUT RIDGE	50	LINN	IA5784312	CWS	2007-01036	Chlorine	5/31/2006	Non-Reported Type	RPT	5/26/2006	NOV issued
CHURDAN WATER SUPPLY	418	GREENE	IA3709001	CWS	2006-01736	Arsenic	3/31/2006	MCL, Average	MCL	12/6/2006	Compliance Achieved
CHURDAN WATER SUPPLY	418	GREENE	IA3709001	CWS	2006-02847	Arsenic	6/30/2006	MCL, Average	MCL	12/6/2006	Compliance Achieved
CHURDAN WATER SUPPLY	418	GREENE	IA3709001	CWS	2006-02848	Arsenic	9/30/2006	MCL, Average	MCL	12/6/2006	Compliance Achieved
CLARE WATER DEPARTMENT	190	WEBSTER	IA9420027	CWS	2007-00897	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/25/2006	Compliance Achieved
CLARE WATER DEPARTMENT	190	WEBSTER	IA9420027	CWS	2007-01465	Radium 226 & Radium 228	9/30/2006	Routine Major	MON	11/6/2006	Compliance Achieved
CLARE WATER DEPARTMENT	190	WEBSTER	IA9420027	CWS	2007-01466	Gross Alpha, excluding Rn & U	9/30/2006	Routine Major	MON	11/6/2006	Compliance Achieved
CLARENCE WATER SUPPLY	1008	CEDAR	IA1630028	CWS	2006-02864	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	5/7/2007	Compliance Achieved
CLARINDA TREATMENT COMPLEX	2500	PAGE	IA7329501	CWS	2006-01330	Nitrate nitrogen	2/28/2006	MCL, Single	MCL	8/31/2006	Compliance Achieved
CLARINDA WATER PLANT	5690	PAGE	IA7329029	CWS	2006-02434	Turbidity	6/30/2006	Monthly Filter Effluent (IESWTR)	TT	2/28/2007	Compliance Achieved
CLARINDA WATER PLANT	5690	PAGE	IA7329029	CWS	2006-03368	Turbidity	7/31/2006	Monthly Filter Effluent (IESWTR)	TT	2/28/2007	Compliance Achieved
CLARINDA WATER PLANT	5690	PAGE	IA7329029	CWS	2006-03523	Turbidity	8/31/2006	Monthly Filter Effluent (IESWTR)	TT	2/28/2007	Compliance Achieved
CLARION WATER SUPPLY	2968	WRIGHT	IA9909031	CWS	2006-01937	Coliform Bacteria, Total	5/31/2006	MCL (TCR), Monthly	MCL	11/7/2006	Compliance Achieved
CLAYTON CO LAW ENFORCEMENT CENTER	50	CLAYTON	IA2223905	CWS	2007-01701	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	11/1/2006	Compliance Achieved
CLAYTON CO LAW ENFORCEMENT CENTER	50	CLAYTON	IA2223905	CWS	2007-01978	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	11/1/2006	Compliance Achieved
CLEAR CREEK MHP	132	JOHNSON	IA5288601	CWS	2007-03898	Copper	12/31/2006	Routine Tap	MON	2/27/2007	NOV issued
CLEAR CREEK MHP	132	JOHNSON	IA5288601	CWS	2007-03899	Lead	12/31/2006	Routine Tap	MON	2/27/2007	NOV issued
CLIFFS PLACE INC	51	BREMER	IA0929200	TNC	2006-03102	Nitrate nitrogen	7/31/2006	Routine Major	MON	8/29/2006	Compliance Achieved
CLIFFS PLACE INC	51	BREMER	IA0929200	TNC	2007-00792	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/4/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CLIFFS PLACE INC	51	BREMER	IA0929200	TNC	2007-01464	Nitrate nitrogen	10/31/2006	Routine Major	MON	11/27/2006	Compliance Achieved
CLOVERLEAF COLD STORAGE	400	WOODBURY	IA9778101	NTNC	2006-01896	Lead	6/30/2006	AL, 90th Percentile	MCL	7/17//2006	Compliance Achieved
COACH ROAD WELL ASSOCIATION	40	CEDAR	IA1600301	CWS	2006-01620	Failure to meet Certified Operator Requirement	3/31/2006	Certified Operator Requirement	STA	3/16/2006	Compliance Achieved
COAL VALLEY WATER DISTRICT	100	BOONE	IA0819303	CWS	2007-00789	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	11/8/2006	NOV issued
CODY ELEMENTARY SCHOOL	295	SCOTT	IA8271565	NTNC	2006-01687	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/20/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-01355	Coliform Bacteria, Total	1/31/2006	Routine Major	MON	2/9/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-01495	Nitrate nitrogen	1/31/2006	Routine Major	MON	2/9/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-01767	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	5/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-01984	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02147	Nitrate nitrogen	4/30/2006	Routine Major	MON	5/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02171	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02248	Coliform Bacteria, Total	5/31/2006	MCL (TCR), Monthly	MCL	3/31/2006	BCA issued
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02250	Coliform Bacteria, Total	5/31/2006	MCL (TCR), Monthly	MCL	3/31/2006	BCA issued
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02419	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	3/31/2006	BCA issued
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02801	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	3/31/2006	BCA issued
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02892	Coliform Bacteria, Total	8/31/2006	Repeat Major	MON	8/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02894	Coliform Bacteria, Total	8/31/2006	Repeat Major	MON	8/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02895	Coliform Bacteria, Total	8/31/2006	Repeat Major	MON	8/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02896	Coliform Bacteria, Total	8/31/2006	Repeat Major	MON	8/30/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-02963	Coliform Bacteria, Total	8/31/2006	Repeat Major	MON	8/30/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-03336	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	3/31/2006	BCA issued
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-03337	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	3/31/2006	BCA issued
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2006-03552	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	3/31/2006	BCA issued
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2007-00026	Coliform Bacteria, Fecal	9/30/2006	MCL (TCR), Acute	MCL	3/31/2006	BCA issued
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2007-00045	Coliform Bacteria, Fecal	10/31/2006	MCL (TCR), Acute	MCL	3/31/2006	BCA issued
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2007-00046	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	3/31/2006	BCA issued
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2007-00059	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	9/7/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2007-00060	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	9/7/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2007-00061	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	9/7/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2007-00780	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	9/7/2006	Compliance Achieved
COLD SPRINGS STATE PK-CASS CONSERVAT	27	CASS	IA1535920	TNC	2007-00781	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	9/7/2006	Compliance Achieved
COLFAX WATER SUPPLY	2223	JASPER	IA5009056	CWS	2006-02979	Copper	6/30/2006	Routine Tap	MON	9/20/2006	Compliance Achieved
COLFAX WATER SUPPLY	2223	JASPER	IA5009056	CWS	2006-02980	Lead	6/30/2006	Routine Tap	MON	9/20/2006	Compliance Achieved
COLLEGE COMMUNITY SCHOOL DISTRICT	45	LINN	IA5715501	TNC	2006-02360	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	6/13/2006	Compliance Achieved
CONO CHRISTIAN SCHOOL	100	LINN	IA5792555	CWS	2006-02634	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/26/2006	Compliance Achieved
CONO CHRISTIAN SCHOOL	100	LINN	IA5792555	CWS	2007-01238	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	11/1/2006	Compliance Achieved
CORALVILLE LAKE MARINA	79	JOHNSON	IA5225201	TNC	2007-01063	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	4/10/2007	Compliance Achieved
CORALVILLE LAKE TERRACE	340	JOHNSON	IA5200817	CWS	2006-01588	Failure to meet Certified Operator Requirement	3/31/2006	Certified Operator Requirement	STA	3/7/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CORRIDOR RIDGE SUBDIVISION	28	JOHNSON	IA5280303	CWS	2006-02370	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	6/6/2006	Compliance Achieved
COUNTRY ESTATES	126	LINN	IA5784301	CWS	2006-02387	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	6/28/2006	NOV issued
COUNTRY ESTATES	126	LINN	IA5784301	CWS	2006-02460	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	7/14/2006	NOV issued
COUNTRY ESTATES	126	LINN	IA5784301	CWS	2006-02856	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	8/11/2006	NOV issued
COUNTRY ESTATES	126	LINN	IA5784301	CWS	2006-03315	Failure to Obtain Construction Permit	4/30/2006	Construction without a permit	STA	8/28/2006	NOV issued
COUNTRY ESTATES	126	LINN	IA5784301	CWS	2006-03316	Failure to Obtain Construction Permit	8/31/2006	Construction without a permit	STA	8/28/2006	NOV issued
COUNTRY ESTATES MOBILE HOME PARK	35	POTTAWATTAMIE	IA6500600	CWS	2007-01258	Copper	9/30/2006	Routine Tap	MON	12/6/2006	NOV issued
COUNTRY ESTATES MOBILE HOME PARK	35	POTTAWATTAMIE	IA6500600	CWS	2007-01259	Lead	9/30/2006	Routine Tap	MON	12/6/2006	NOV issued
COUNTRY HEIGHTS	91	MUSCATINE	IA7073301	CWS	2006-02875	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	3/14/2007	Compliance Achieved
COUNTRY HEIGHTS	91	MUSCATINE	IA7073301	CWS	2007-00044	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	3/14/2007	Compliance Achieved
COUNTRY MANOR ESTATES	228	LINN	IA5784307	CWS	2006-01333	Coliform Bacteria, Total	2/28/2006	MCL (TCR), Monthly	MCL	11/30/2006	Compliance Achieved
COUNTRY MANOR ESTATES	228	LINN	IA5784307	CWS	2006-02237	Chlorine	4/30/2006	Monitoring (DBP), Major	MON	5/25/2006	NOV issued
COUNTRY MANOR ESTATES	228	LINN	IA5784307	CWS	2007-01040	Chlorine	5/31/2006	Non-Reported Type	RPT	11/30/2006	Compliance Achieved
COUNTRY MANOR ESTATES	228	LINN	IA5784307	CWS	2007-01073	Copper	9/30/2006	Routine Tap	MON	11/6/2006	NOV issued
COUNTRY MANOR ESTATES	228	LINN	IA5784307	CWS	2007-01074	Lead	9/30/2006	Routine Tap	MON	11/6/2006	NOV issued
COUNTRY VIEW PUBLIC GOLF COURSE	26	WINNESHIEK	IA9630203	TNC	2007-00884	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/20/2006	NOV issued
CRESCENT SKI HILLS	119	POTTAWATTAMIE	IA7822842	TNC	2006-01796	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/25/2006	Compliance Achieved
CRESCENT SKI HILLS	119	POTTAWATTAMIE	IA7822842	TNC	2007-03395	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/21/2007	Compliance Achieved
CRESCO GOLF AND COUNTRY CLUB	36	HOWARD	IA4515778	TNC	2007-03585	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
CREST MOTEL	32	IOWA	IA4884724	TNC	2007-00020	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	10/25/2006	Compliance Achieved
CRESTWOOD ACRES	142	LINN	IA5784314	CWS	2007-01032	Chlorine	5/31/2006	Non-Reported Type	RPT	5/26/2006	NOV issued
CUTTYS OKOBOJI RESORT CLUB	285	DICKINSON	IA3070434	TNC	2006-01763	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/25/2006	Compliance Achieved
D & M ADDITION	80	LINN	IA5784318	CWS	2007-01033	Chlorine	5/31/2006	Non-Reported Type	RPT	5/26/2006	NOV issued
DAKOTA MHP	32	JOHNSON	IA5200618	CWS	2006-01738	Coliform Bacteria, Total	3/31/2006	MCL (TCR), Monthly	MCL	10/17/2006	Compliance Achieved
DAKOTA MHP	32	JOHNSON	IA5200618	CWS	2006-01914	Failure to meet Certified Operator Requirement	3/31/2006	Certified Operator Requirement	STA	10/17/2006	Compliance Achieved
DAKOTA MHP	32	JOHNSON	IA5200618	CWS	2006-01923	Coliform Bacteria, Fecal	3/31/2006	MCL (TCR), Acute	MCL	10/17/2006	Compliance Achieved
DAKOTA MHP	32	JOHNSON	IA5200618	CWS	2007-00835	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/17/2006	Compliance Achieved
DANVILLE WATER SUPPLY	914	DES MOINES	IA2915000	CWS	2006-01590	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	9/14/2006	Compliance Achieved
DANVILLE WATER SUPPLY	914	DES MOINES	IA2915000	CWS	2006-02246	Total Trihalomethanes	6/30/2006	MCL, Average	MCL	9/14/2006	Compliance Achieved
DAWSON WATER WORKS	155	DALLAS	IA2525010	CWS	2007-01094	Copper	9/30/2006	Routine Tap	MON	11/14/2006	NOV issued
DAWSON WATER WORKS	155	DALLAS	IA2525010	CWS	2007-01095	Lead	9/30/2006	Routine Tap	MON	11/14/2006	NOV issued
DECOSTER FARMS FEED MILL	50	WRIGHT	IA9932104	TNC	2006-02584	Coliform Bacteria, Total	6/30/2006	Repeat Major	MON	9/5/2006	Compliance Achieved
DECOSTER FARMS FEED MILL	50	WRIGHT	IA9932104	TNC	2006-02945	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	9/5/2006	Compliance Achieved
DECOSTER FARMS FEED MILL	50	WRIGHT	IA9932104	TNC	2006-03342	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	2/19/2007	Compliance Achieved
DECOSTER FARMS FEED MILL	50	WRIGHT	IA9932104	TNC	2007-00926	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/25/2006	Compliance Achieved
DECOSTER FARMS FEED MILL	50	WRIGHT	IA9932104	TNC	2007-03606	Coliform Bacteria, Total	9/30/2006	Non-Reported Type	PN	2/1/2007	Compliance Achieved
DEEP RIVER WATER SUPPLY	288	POWESHIEK	IA7915017	CWS	2007-00862	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	10/20/2006	NOV issued
DEEP RIVER WATER SUPPLY	288	POWESHIEK	IA7915017	CWS	2007-00863	Total Trihalomethanes	8/31/2006	Routine Major	MON	10/20/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2006-02836	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	11/7/2006	BCA issued
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2006-02886	Coliform Bacteria, Fecal	8/31/2006	MCL (TCR), Acute	MCL	11/7/2006	BCA issued
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2006-02887	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	11/7/2006	BCA issued
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2006-03348	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	11/7/2006	BCA issued
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2007-00760	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	12/26/2006	Compliance Achieved
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2007-00761	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	12/26/2006	Compliance Achieved
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2007-01015	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	11/7/2006	BCA issued
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2007-01160	Coliform Bacteria, Total	11/30/2006	Repeat Major	MON	12/26/2006	Compliance Achieved
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2007-01161	Coliform Bacteria, Total	11/30/2006	Repeat Major	MON	12/26/2006	Compliance Achieved
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2007-01900	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/19/2006	Compliance Achieved
DEERFIELD HEIGHTS ASSOCIATION	31	WINNESHIEK	IA9630316	CWS	2007-03601	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	5/2/2007	Compliance Achieved
DELHI LAKEVIEW ESTATES	30	DELAWARE	IA2817456	TNC	2007-01190	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	5/16/2007	Compliance Achieved
DELHI LAKEVIEW ESTATES	30	DELAWARE	IA2817456	TNC	2007-03451	Nitrate nitrogen	12/31/2006	Routine Major	MON	1/24/2007	Compliance Achieved
DELHI LAKEVIEW ESTATES	30	DELAWARE	IA2817456	TNC	2007-03583	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2007-01536	Selenium	9/30/2006	Routine Major	MON	1/16/2007	Compliance Achieved
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2007-01537	Barium	9/30/2006	Routine Major	MON	1/16/2007	Compliance Achieved
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2007-01538	Cadmium	9/30/2006	Routine Major	MON	1/16/2007	Compliance Achieved
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2007-01539	Chromium	9/30/2006	Routine Major	MON	1/16/2007	Compliance Achieved
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2007-01540	Fluoride	9/30/2006	Routine Major	MON	1/16/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2007-01541	Mercury	9/30/2006	Routine Major	MON	1/16/2007	Compliance Achieved
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2007-01542	Antimony	9/30/2006	Routine Major	MON	1/16/2007	Compliance Achieved
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2007-01543	Thallium	9/30/2006	Routine Major	MON	1/16/2007	Compliance Achieved
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2007-01856	Failure to submit Monthly Operation Report	8/31/2006	Monthly Operation Report	RPT	12/31/2006	Compliance Achieved
DELOIT MUNI WATER SUPPLY	288	CRAWFORD	IA2421025	CWS	2007-03523	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	12/27/2006	Compliance Achieved
DENVER HILLS SUBDIVISION	50	BREMER	IA0915301	CWS	2006-02852	Lead	6/30/2006	AL, 90th Percentile	MCL	8/8/2006	NOV issued
DENVER HILLS SUBDIVISION	50	BREMER	IA0915301	CWS	2006-03240	Gross Alpha, excluding Rn & U	6/30/2006	Routine Major	MON	1/23/2007	Compliance Achieved
DENVER HILLS SUBDIVISION	50	BREMER	IA0915301	CWS	2006-03241	Radium 226 & Radium 228	6/30/2006	Routine Major	MON	1/23/2007	Compliance Achieved
DENVER HILLS SUBDIVISION	50	BREMER	IA0915301	CWS	2007-01078	Chlorine	9/30/2006	Non-Reported Type	RPT	10/30/2006	NOV issued
DENVER HILLS SUBDIVISION	50	BREMER	IA0915301	CWS	2007-03609	Chlorine	12/31/2006	Non-Reported Type	RPT	1/22/2007	NOV issued
DES MOINES REGENCY MANOR LLC	763	POLK	IA7727602	CWS	2006-01541	Coliform Bacteria, Total	1/31/2006	Routine Major	MON	3/5/2007	Compliance Achieved
DES MOINES REGENCY MANOR LLC	763	POLK	IA7727602	CWS	2006-01561	Chlorine	1/31/2006	Monitoring (DBP), Major	MON	3/5/2007	Compliance Achieved
DES MOINES REGENCY MANOR LLC	763	POLK	IA7727602	CWS	2006-01860	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	3/5/2007	Compliance Achieved
DES MOINES REGENCY MANOR LLC	763	POLK	IA7727602	CWS	2006-02162	Total Haloacetic Acids	3/31/2006	Monitoring (DBP), Major	MON	3/5/2007	Compliance Achieved
DES MOINES REGENCY MANOR LLC	763	POLK	IA7727602	CWS	2006-02163	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	3/5/2007	Compliance Achieved
DES MOINES REGENCY MANOR LLC	763	POLK	IA7727602	CWS	2006-02235	Chlorine	4/30/2006	Monitoring (DBP), Major	MON	3/5/2007	Compliance Achieved
DES MOINES REGENCY MANOR LLC	763	POLK	IA7727602	CWS	2006-02259	Total Trihalomethanes	3/31/2006	Routine Major	MON	3/5/2007	Compliance Achieved
DES MOINES REGENCY MANOR LLC	763	POLK	IA7727602	CWS	2006-02371	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	3/5/2007	Compliance Achieved
DEUCES	43	POTTAWATTAMIE	IA7820203	TNC	2006-01795	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
DEUCES	43	POTTAWATTAMIE	IA7820203	TNC	2006-01805	Nitrate nitrogen	3/31/2006	Routine Major	MON	4/27/2006	Compliance Achieved
DEUCES	43	POTTAWATTAMIE	IA7820203	TNC	2007-03394	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/30/2007	Compliance Achieved
DEUCES	43	POTTAWATTAMIE	IA7820203	TNC	2007-03403	Nitrate nitrogen	12/31/2006	Routine Major	MON	1/25/2007	Compliance Achieved
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2006-02399	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	12/20/2006	Compliance Achieved
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2006-02400	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	7/3/2006	NOV issued
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2006-02842	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	11/29/2006	NOV issued
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2006-03092	Radium 226 & Radium 228	6/30/2006	Routine Major	MON	11/27/2006	Compliance Achieved
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2006-03093	Radium 226 & Radium 228	6/30/2006	Routine Major	MON	11/27/2006	Compliance Achieved
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2007-00005	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	10/2/2006	NOV issued
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2007-00093	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	12/13/2006	Compliance Achieved
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2007-01146	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	12/20/2006	Compliance Achieved
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2007-01149	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	12/14/2006	Compliance Achieved
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2007-01150	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	12/18/2006	Compliance Achieved
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2007-01151	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	12/14/2006	Compliance Achieved
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2007-01152	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	12/14/2006	Compliance Achieved
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2007-01873	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	12/18/2006	NOV issued
DEVILS CREEK ESTATES HOME ASSOC	145	SCOTT	IA8218301	CWS	2007-03548	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
DIXON MEMORIAL PARK	30	SCOTT	IA8225495	TNC	2006-01930	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	7/13/2006	NOV issued
DIXON WATER WORKS	276	SCOTT	IA8225043	CWS	2007-03549	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
DOLLIVER MUNI WATER SUPPLY	77	EMMET	IA3215044	CWS	2007-00998	Di(2-Ethylhexyl) Phthalate	9/30/2006	Routine Major	MON	10/16/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-01315	Nitrate nitrogen	1/31/2006	MCL, Single	MCL	12/4/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-01329	Nitrate nitrogen	2/28/2006	MCL, Single	MCL	12/4/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-01617	Nitrate nitrogen	3/31/2006	MCL, Single	MCL	12/4/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-01751	Nitrate nitrogen	4/30/2006	MCL, Single	MCL	12/4/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-02228	Nitrate nitrogen	5/31/2006	MCL, Single	MCL	12/4/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-02389	Nitrate nitrogen	6/30/2006	MCL, Single	MCL	12/4/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-02485	Nitrate nitrogen	7/31/2006	MCL, Single	MCL	12/4/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2006-03255	Nitrate nitrogen	8/31/2006	MCL, Single	MCL	12/4/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2007-00015	Nitrate nitrogen	10/31/2006	MCL, Single	MCL	12/4/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2007-01939	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/11/2006	Compliance Achieved
DOON WATER SUPPLY	533	LYON	IA6015047	CWS	2007-01991	Chlorine	11/30/2006	Monitoring (DBP), Major	MON	12/21/2006	NOV issued
DRY DOCK SPORTS BAR & GRILL	29	JOHNSON	IA5280201	TNC	2006-02707	Nitrate nitrogen	6/30/2006	Routine Major	MON	9/6/2006	Compliance Achieved
DUBUQUE REGIONAL AIRPORT	420	DUBUQUE	IA3126013	NTNC	2007-01193	Copper	9/30/2006	Routine Tap	MON	11/28/2006	NOV issued
DUBUQUE REGIONAL AIRPORT	420	DUBUQUE	IA3126013	NTNC	2007-01194	Lead	9/30/2006	Routine Tap	MON	11/28/2006	NOV issued
DUBUQUE SHOOTING SOCIETY	85	DUBUQUE	IA3126882	TNC	2006-01815	Nitrate nitrogen	3/31/2006	Routine Major	MON	5/25/2006	Compliance Achieved
DUBUQUE SHOOTING SOCIETY	85	DUBUQUE	IA3126882	TNC	2007-00895	Nitrate nitrogen	9/30/2006	Routine Major	MON	11/27/2006	Compliance Achieved
DUBUQUE SPORTS COMPLEX	400	DUBUQUE	IA3126208	TNC	2006-01841	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/7/2006	Compliance Achieved
DUBUQUE SPORTS COMPLEX	400	DUBUQUE	IA3126208	TNC	2007-03432	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/2/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
DUBUQUE SPORTS COMPLEX	400	DUBUQUE	IA3126208	TNC	2007-03433	Nitrate nitrogen	12/31/2006	Routine Major	MON	1/2/2007	Compliance Achieved
DUBUQUE WATER WORKS	57686	DUBUQUE	IA3126052	CWS	2006-03526	Failure to monitor Water Quality Parameters	6/30/2006	Monitoring (MOR)	MON	9/21/2006	NOV issued
DUBUQUE WATER WORKS	57686	DUBUQUE	IA3126052	CWS	2006-03528	Lead	9/30/2006	Treatment Technique (LCR)	TT	9/21/2006	NOV issued
DUBUQUE WATER WORKS	57686	DUBUQUE	IA3126052	CWS	2006-03538	Lead	9/30/2006	AL, 90th Percentile	MCL	9/22/2006	BCA issued
DUBUQUE YMCA CAMP	60	DUBUQUE	IA3126489	TNC	2007-00816	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/20/2006	NOV issued
DUBUQUE YMCA CAMP	60	DUBUQUE	IA3126489	TNC	2007-03584	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
DYERSVILLE GOLF AND COUNTRY CLUB	40	DUBUQUE	IA3130883	TNC	2006-02036	Nitrate nitrogen	4/30/2006	Routine Major	MON	4/2/2007	Compliance Achieved
DYERSVILLE GOLF AND COUNTRY CLUB	40	DUBUQUE	IA3130883	TNC	2006-02342	Nitrate nitrogen	5/31/2006	Routine Major	MON	4/2/2007	Compliance Achieved
DYERSVILLE GOLF AND COUNTRY CLUB	40	DUBUQUE	IA3130883	TNC	2006-02659	Nitrate nitrogen	6/30/2006	Routine Major	MON	4/2/2007	Compliance Achieved
DYERSVILLE GOLF AND COUNTRY CLUB	40	DUBUQUE	IA3130883	TNC	2006-03091	Nitrate nitrogen	7/31/2006	Routine Major	MON	4/2/2007	Compliance Achieved
DYERSVILLE GOLF AND COUNTRY CLUB	40	DUBUQUE	IA3130883	TNC	2006-03474	Nitrate nitrogen	8/31/2006	Routine Major	MON	4/2/2007	Compliance Achieved
DYERSVILLE GOLF AND COUNTRY CLUB	40	DUBUQUE	IA3130883	TNC	2007-00817	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	4/2/2007	Compliance Achieved
DYERSVILLE GOLF AND COUNTRY CLUB	40	DUBUQUE	IA3130883	TNC	2007-00892	Nitrate nitrogen	9/30/2006	Routine Major	MON	4/2/2007	Compliance Achieved
DYERSVILLE GOLF AND COUNTRY CLUB	40	DUBUQUE	IA3130883	TNC	2007-03582	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2006-01582	Nitrate nitrogen	3/31/2006	MCL, Single	MCL	4/27/2007	Compliance Achieved
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2006-02220	Nitrate nitrogen	4/30/2006	Routine Major	MON	5/31/2006	Compliance Achieved
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2006-02266	Nitrate nitrogen	5/31/2006	MCL, Single	MCL	4/27/2007	Compliance Achieved
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2006-02414	Nitrate nitrogen	6/30/2006	MCL, Single	MCL	4/27/2007	Compliance Achieved
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2006-02757	Nitrite nitrogen	6/30/2006	Routine Major	MON	4/27/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2006-02843	Nitrate nitrogen	8/31/2006	MCL, Single	MCL	4/27/2007	Compliance Achieved
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2006-03245	Nitrate nitrogen	7/31/2006	Routine Major	MON	8/3/2006	Compliance Achieved
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2006-03347	Nitrate nitrogen	9/30/2006	MCL, Single	MCL	4/27/2007	Compliance Achieved
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2007-01057	Nitrate nitrogen	10/31/2006	MCL, Single	MCL	4/27/2007	Compliance Achieved
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2007-01851	Nitrate nitrogen	11/30/2006	MCL, Single	MCL	4/27/2007	Compliance Achieved
DYERSVILLE IMPLEMENT INC	32	DUBUQUE	IA3130801	TNC	2007-02005	Nitrate nitrogen	12/31/2006	MCL, Single	MCL	4/27/2007	Compliance Achieved
DYERSVILLE MUNICIPAL WATER CO	4035	DUBUQUE	IA3130091	CWS	2007-01102	Radium 226 & Radium 228	12/31/2006	MCL, Average	MCL	2/22/2007	BCA issued
DYSART WATER SUPPLY	1303	TAMA	IA8627095	CWS	2007-00871	Total Trihalomethanes	8/31/2006	Routine Major	MON	10/20/2006	NOV issued
DYSART WATER SUPPLY	1303	TAMA	IA8627095	CWS	2007-00872	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	10/20/2006	NOV issued
ECONOLOGDE	95	IOWA	IA4884726	TNC	2006-01861	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/5/2006	Compliance Achieved
ECONOLOGDE	95	IOWA	IA4884726	TNC	2006-01913	Chlorine Residual	3/31/2006	Routine Major	MON	1/29/2007	Compliance Achieved
ECONOLOGDE	95	IOWA	IA4884726	TNC	2006-02663	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/3/2006	Compliance Achieved
EDEN PRESBYTERIAN CHURCH	87	MITCHELL	IA6658801	TNC	2006-01349	Coliform Bacteria, Total	1/31/2006	Repeat Major	MON	2/21/2006	Compliance Achieved
EDEN PRESBYTERIAN CHURCH	87	MITCHELL	IA6658801	TNC	2006-01734	Coliform Bacteria, Total	3/31/2006	MCL (TCR), Monthly	MCL	3/28/2007	Compliance Achieved
EDEN PRESBYTERIAN CHURCH	87	MITCHELL	IA6658801	TNC	2006-01934	Coliform Bacteria, Total	5/31/2006	MCL (TCR), Monthly	MCL	3/28/2007	Compliance Achieved
EDEN PRESBYTERIAN CHURCH	87	MITCHELL	IA6658801	TNC	2006-03366	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	3/28/2007	Compliance Achieved
EDGEWATER GOLF COURSE	41	FAYETTE	IA3300769	TNC	2006-02622	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/6/2006	Compliance Achieved
EDGEWATER GOLF COURSE	41	FAYETTE	IA3300769	TNC	2007-00001	Nitrate nitrogen	9/30/2006	MCL, Single	MCL	10/2/2006	NOV issued
EDGEWATER GOLF COURSE	41	FAYETTE	IA3300769	TNC	2007-01302	Nitrate nitrogen	10/31/2006	Routine Major	MON	4/30/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
EDGEWATER GOLF COURSE	41	FAYETTE	IA3300769	TNC	2007-03381	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	9/8/2006	Compliance Achieved
EFFIGY MOUNDS NATIONAL MONUMENT	328	CLAYTON	IA2258494	TNC	2007-03581	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2006-02077	Nitrate nitrogen	4/30/2006	Routine Major	MON	5/25/2006	Compliance Achieved
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2006-02679	Nitrate nitrogen	6/30/2006	Routine Major	MON	7/18/2006	Compliance Achieved
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2006-02974	Copper	6/30/2006	Routine Tap	MON	8/22/2006	NOV issued
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2006-02975	Lead	6/30/2006	Routine Tap	MON	8/22/2006	NOV issued
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2007-01501	Nitrate nitrogen	10/31/2006	Routine Major	MON	11/29/2006	Compliance Achieved
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2007-03377	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	3/29/2007	Compliance Achieved
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2007-03416	Nitrate nitrogen	12/31/2006	Routine Major	MON	3/29/2007	Compliance Achieved
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2007-03644	Failure to submit Monthly Operation Report	12/31/2006	Monthly Operation Report	RPT	2/9/2007	Compliance Achieved
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2007-03740	Copper	12/31/2006	Routine Tap	MON	2/23/2007	NOV issued
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2007-03741	Lead	12/31/2006	Routine Tap	MON	2/23/2007	NOV issued
EIP MANUFACTURING, LLC	92	DELAWARE	IA2825101	NTNC	2007-03816	Sodium	12/31/2006	Routine Major	MON	2/23/2007	NOV issued
ELDON WATER SUPPLY	998	WAPELLO	IA9053004	CWS	2006-02339	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	6/22/2006	Compliance Achieved
ELDRED SHERWOOD PARK	45	HANCOCK	IA4135492	TNC	2006-02624	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/7/2006	Compliance Achieved
ELGIN MUNICIPAL WATER SUPPLY	676	FAYETTE	IA3338010	CWS	2007-03507	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/16/2007	Compliance Achieved
ELK RUN HEIGHTS WATER SUPPLY	1052	BLACK HAWK	IA0721014	CWS	2007-03508	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
ELLIOTT WATER SUPPLY	402	MONTGOMERY	IA6915015	CWS	2006-01793	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/25/2006	Compliance Achieved
ELLIOTT WATER SUPPLY	402	MONTGOMERY	IA6915015	CWS	2006-01801	Nitrate nitrogen	3/31/2006	Routine Major	MON	4/25/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ELLSWORTH PUBLIC WATER SUPPLY	531	HAMILTON	IA4009016	CWS	2006-01564	Arsenic	3/31/2006	MCL, Average	MCL	2/15/2007	BCA issued
ELLSWORTH PUBLIC WATER SUPPLY	531	HAMILTON	IA4009016	CWS	2006-02232	Arsenic	6/30/2006	MCL, Average	MCL	2/15/2007	BCA issued
ELLSWORTH PUBLIC WATER SUPPLY	531	HAMILTON	IA4009016	CWS	2006-03361	Arsenic	9/30/2006	MCL, Average	MCL	2/15/2007	BCA issued
ELLSWORTH PUBLIC WATER SUPPLY	531	HAMILTON	IA4009016	CWS	2007-03627	Arsenic	12/31/2006	MCL, Average	MCL	2/15/2007	BCA issued
F W KENT PARK	1169	JOHNSON	IA5260966	TNC	2006-03330	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	4/26/2007	Compliance Achieved
F W KENT PARK	1169	JOHNSON	IA5260966	TNC	2006-03340	Coliform Bacteria, Fecal	8/31/2006	MCL (TCR), Acute	MCL	4/26/2007	Compliance Achieved
F W KENT PARK	1169	JOHNSON	IA5260966	TNC	2006-03544	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	4/26/2007	Compliance Achieved
FAIRWAY OAKS	92	MUSCATINE	IA7048306	CWS	2007-04354	Copper	9/30/2006	AL, 90th Percentile	MCL	4/24/2007	BCA issued
FAR HORIZONS SUBDIVISION	80	JOHNSON	IA5225386	CWS	2006-02422	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	12/20/2006	Compliance Achieved
FAR HORIZONS SUBDIVISION	80	JOHNSON	IA5225386	CWS	2007-02019	Copper	9/30/2006	Routine Tap	MON	1/9/2007	BCA issued
FAR HORIZONS SUBDIVISION	80	JOHNSON	IA5225386	CWS	2007-02020	Lead	9/30/2006	Routine Tap	MON	1/9/2007	BCA issued
FAR HORIZONS SUBDIVISION	80	JOHNSON	IA5225386	CWS	2007-03550	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/14/2007	Compliance Achieved
FELLOWSHIP OF FAITH CHRISTIAN CENTER	303	POTTAWATTAMIE	IA7856801	TNC	2006-01498	Coliform Bacteria, Total	1/31/2006	Routine Major	MON	3/14/2006	Compliance Achieved
FELLOWSHIP OF FAITH CHRISTIAN CENTER	303	POTTAWATTAMIE	IA7856801	TNC	2006-02153	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/2/2006	Compliance Achieved
FERGUSON WATER SUPPLY	126	MARSHALL	IA6432043	CWS	2007-01254	Copper	9/30/2006	Routine Tap	MON	11/29/2006	NOV issued
FERGUSON WATER SUPPLY	126	MARSHALL	IA6432043	CWS	2007-01255	Lead	9/30/2006	Routine Tap	MON	11/29/2006	NOV issued
FILL AND FOOD #7	51	POTTAWATTAMIE	IA7849202	TNC	2006-01604	Coliform Bacteria, Total	3/31/2006	MCL (TCR), Monthly	MCL	9/30/2006	Compliance Achieved
FILL AND FOOD #7	51	POTTAWATTAMIE	IA7849202	TNC	2006-01943	Coliform Bacteria, Total	3/31/2006	Non-Reported Type	PN	5/12/2006	Compliance Achieved
FIVE STAR COOPERATIVE	66	CHICKASAW	IA1970208	TNC	2006-02453	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	8/7/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
FIVE STAR COOPERATIVE	66	CHICKASAW	IA1970208	TNC	2006-03439	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	10/27/2006	Compliance Achieved
FORT ATKINSON WATER WORKS	389	WINNESHIEK	IA9641049	CWS	2007-03710	Failure to Obtain Construction Permit	6/30/2006	Construction without a permit	STA	6/22/2006	NOV issued
FORT DODGE WATER SUPPLY	26309	WEBSTER	IA9433050	CWS	2006-02112	Radium 226 & Radium 228	3/31/2006	Routine Major	MON	7/24/2006	Compliance Achieved
FORT DODGE WATER SUPPLY	26309	WEBSTER	IA9433050	CWS	2006-02113	Radium 226 & Radium 228	3/31/2006	Routine Major	MON	7/24/2006	Compliance Achieved
FOUNTAIN SPRINGS PARK - DELAWARE C.C.B.	25	DELAWARE	IA2839907	TNC	2006-02327	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	6/20/2006	Compliance Achieved
FOUNTAIN SPRINGS PARK - DELAWARE C.C.B.	25	DELAWARE	IA2839907	TNC	2006-02363	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	6/20/2006	Compliance Achieved
FOUNTAIN SPRINGS PARK - DELAWARE C.C.B.	25	DELAWARE	IA2839907	TNC	2007-00025	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	10/19/2006	NOV issued
FREDERIKAS STEIN & DINE	53	BREMER	IA0922729	TNC	2006-03483	Nitrate nitrogen	8/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
FREDERIKAS STEIN & DINE	53	BREMER	IA0922729	TNC	2007-00791	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/10/2006	Compliance Achieved
FRIENDLY FAIRWAYS	28	HARDIN	IA4283810	TNC	2006-01920	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	4/19/2007	Compliance Achieved
FRONTIER NATURAL PRODUCTS COOP	240	BENTON	IA0656101	NTNC	2006-02607	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/5/2006	Compliance Achieved
FRONTIER NATURAL PRODUCTS COOP	240	BENTON	IA0656101	NTNC	2006-02742	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/5/2006	Compliance Achieved
FRONTIER NATURAL PRODUCTS COOP	240	BENTON	IA0656101	NTNC	2006-03309	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	1/17/2007	Compliance Achieved
FRONTIER NATURAL PRODUCTS COOP	240	BENTON	IA0656101	NTNC	2006-03371	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	1/17/2007	Compliance Achieved
FRONTIER NATURAL PRODUCTS COOP	240	BENTON	IA0656101	NTNC	2007-00890	Nitrate nitrogen	9/30/2006	Routine Major	MON	1/17/2007	Compliance Achieved
FRONTIER NATURAL PRODUCTS COOP	240	BENTON	IA0656101	NTNC	2007-01047	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	1/17/2007	Compliance Achieved
FRONTIER NATURAL PRODUCTS COOP	240	BENTON	IA0656101	NTNC	2007-01070	Copper	9/30/2006	Routine Tap	MON	1/17/2007	Compliance Achieved
FRONTIER NATURAL PRODUCTS COOP	240	BENTON	IA0656101	NTNC	2007-01071	Lead	9/30/2006	Routine Tap	MON	1/17/2007	Compliance Achieved
FRONTIER NATURAL PRODUCTS COOP	240	BENTON	IA0656101	NTNC	2007-01846	Coliform Bacteria, Total	11/30/2006	MCL (TCR), Monthly	MCL	1/17/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
FRYTOWN WATER COOP	87	JOHNSON	IA5291301	CWS	2006-03300	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	2/21/2007	Compliance Achieved
FT MADISON MUNI WATER WORKS	11476	LEE	IA5625062	CWS	2007-01004	Total Organic Carbon	9/30/2006	Monitoring (DBP), Major	MON	10/10/2006	Compliance Achieved
GADDIS ESTATES HOA	153	LINN	IA5731302	CWS	2007-03509	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
GALLERY ACRES WEST	50	JOHNSON	IA5282306	CWS	2006-01837	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/4/2006	Compliance Achieved
GALLERY ACRES WEST	50	JOHNSON	IA5282306	CWS	2007-03551	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/14/2007	Compliance Achieved
GALLERY ACRES WEST	50	JOHNSON	IA5282306	CWS	2007-03605	Arsenic	12/31/2006	MCL, Average	MCL	1/26/2007	BCA issued
GALT MUNICIPAL WATER SUPPLY	30	WRIGHT	IA9932071	CWS	2006-01898	Arsenic	6/30/2006	MCL, Average	MCL	7/31/2006	Compliance Achieved
GATEWAY DEVELOPMENT	400	JOHNSON	IA5225312	NTNC	2006-02629	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	4/20/2007	Compliance Achieved
GATEWAY DEVELOPMENT	400	JOHNSON	IA5225312	NTNC	2007-00838	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	4/20/2007	Compliance Achieved
GATEWAY DEVELOPMENT	400	JOHNSON	IA5225312	NTNC	2007-03389	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	4/20/2007	Compliance Achieved
GATEWAY DEVELOPMENT	400	JOHNSON	IA5225312	NTNC	2007-03423	Nitrate nitrogen	12/31/2006	Routine Major	MON	1/24/2007	NOV issued
GEORGIA PACIFIC CORP GYPSUM DIV.	160	WEBSTER	IA9433188	NTNC	2007-00879	Total Trihalomethanes	8/31/2006	Routine Major	MON	10/19/2006	NOV issued
GEORGIA PACIFIC CORP GYPSUM DIV.	160	WEBSTER	IA9433188	NTNC	2007-00880	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	10/19/2006	NOV issued
GILBERT WATER SUPPLY	987	STORY	IA8531083	CWS	2007-00037	Copper	6/30/2006	AL, 90th Percentile	MCL	10/12/2006	NOV issued
GILBERT WATER SUPPLY	987	STORY	IA8531083	CWS	2007-03924	Copper	12/31/2006	AL, 90th Percentile	MCL	3/8/2007	NOV issued
GILLETT GROVE WATER SUPPLY	55	CLAY	IA2127085	CWS	2006-02866	Failure to meet Certified Operator Requirement	6/30/2006	Certified Operator Requirement	STA	8/22/2006	Compliance Achieved
GILLETT GROVE WATER SUPPLY	55	CLAY	IA2127085	CWS	2006-03512	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	3/19/2007	Compliance Achieved
GLENN OAKS ADDITION	88	LINN	IA5784313	CWS	2007-01035	Chlorine	5/31/2006	Non-Reported Type	RPT	5/26/2006	NOV issued
GOULDSBURG PARK	30	FAYETTE	IA3383903	TNC	2006-02277	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	6/21/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
GRANADA MOBILE HOME PARK	100	DUBUQUE	IA3100605	CWS	2006-01358	Coliform Bacteria, Total	1/31/2006	Routine Major	MON	2/24/2006	Compliance Achieved
GRANADA MOBILE HOME PARK	100	DUBUQUE	IA3100605	CWS	2006-01562	Chlorine	1/31/2006	Monitoring (DBP), Major	MON	2/24/2006	Compliance Achieved
GRAND VIEW RESORT	35	PALO ALTO	IA2100625	TNC	2006-02745	Nitrate nitrogen	6/30/2006	Routine Major	MON	6/26/2006	Compliance Achieved
GRANDMAS SNACK SHOP	46	BUTLER	IA1211821	TNC	2006-02675	Nitrate nitrogen	6/30/2006	Routine Major	MON	12/7/2006	Compliance Achieved
GREELEY COMMERCIAL CLUB	75	DELAWARE	IA2831202	TNC	2007-00050	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	1/8/2007	BCA issued
GREELEY COMMERCIAL CLUB	75	DELAWARE	IA2831202	TNC	2007-00920	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	1/8/2007	BCA issued
GREELEY COMMERCIAL CLUB	75	DELAWARE	IA2831202	TNC	2007-01072	Coliform Bacteria, Total	11/30/2006	MCL (TCR), Monthly	MCL	1/8/2007	BCA issued
GREELEY COMMERCIAL CLUB	75	DELAWARE	IA2831202	TNC	2007-01989	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	1/8/2007	BCA issued
GREEN BRIER SUBDIVISION	47	DUBUQUE	IA3126307	CWS	2006-02820	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	1/30/2007	Compliance Achieved
GUTTENBERG WATER UTILITY CITY	1987	CLAYTON	IA2242018	CWS	2006-03310	Failure to submit Monthly Operation Report	5/31/2006	Monthly Operation Report	RPT	10/16/2006	Compliance Achieved
GUTTENBERG WATER UTILITY CITY	1987	CLAYTON	IA2242018	CWS	2006-03314	Chlorine	6/30/2006	Non-Reported Type	RPT	8/28/2006	NOV issued
GUTTENBERG WATER UTILITY CITY	1987	CLAYTON	IA2242018	CWS	2006-03510	Failure to meet Certified Operator Requirement	9/30/2006	Certified Operator Requirement	STA	10/30/2006	Compliance Achieved
GUTTENBERG WATER UTILITY CITY	1987	CLAYTON	IA2242018	CWS	2007-03699	Chlorine	7/31/2006	Monitoring (DBP), Major	MON	7/28/2006	NOV issued
HAESSLER SUBDIVISION HOA #8	27	SCOTT	IA8245302	CWS	2006-01851	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/24/2006	Compliance Achieved
HAESSLER SUBDIVISION HOA #8	27	SCOTT	IA8245302	CWS	2006-02807	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	1/30/2007	Compliance Achieved
HALVORSON PARK	50	MITCHELL	IA6673401	TNC	2006-02786	Nitrate nitrogen	7/31/2006	MCL, Single	MCL	5/14/2007	Compliance Achieved
HANLONTOWN WATER SUPPLY SYSTEM	229	WORTH	IA9830001	CWS	2007-03520	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/5/2007	Compliance Achieved
HANSELL WATER DEPARTMENT	96	FRANKLIN	IA3549026	CWS	2006-02677	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/15/2006	Compliance Achieved
HART RIDGE GOLF COURSE	167	DELAWARE	IA2839203	TNC	2006-02343	Nitrate nitrogen	5/31/2006	Routine Major	MON	6/13/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
HARTWICK POINT WELL	120	DELAWARE	IA2817860	TNC	2006-02037	Nitrate nitrogen	4/30/2006	Routine Major	MON	5/9/2006	Compliance Achieved
HARTWICK POINT WELL	120	DELAWARE	IA2817860	TNC	2006-03475	Nitrate nitrogen	8/31/2006	Routine Major	MON	9/25/2006	Compliance Achieved
HASTINGS WATER SUPPLY	214	MILLS	IA6527038	CWS	2006-01293	Nitrate nitrogen	1/31/2006	MCL, Single	MCL	10/31/2006	Compliance Achieved
HASTINGS WATER SUPPLY	214	MILLS	IA6527038	CWS	2006-01579	Nitrate nitrogen	2/28/2006	MCL, Single	MCL	10/31/2006	Compliance Achieved
HASTINGS WATER SUPPLY	214	MILLS	IA6527038	CWS	2006-01721	Nitrate nitrogen	3/31/2006	MCL, Single	MCL	10/31/2006	Compliance Achieved
HASTINGS WATER SUPPLY	214	MILLS	IA6527038	CWS	2006-01755	Nitrate nitrogen	4/30/2006	MCL, Single	MCL	10/31/2006	Compliance Achieved
HASTINGS WATER SUPPLY	214	MILLS	IA6527038	CWS	2007-01996	Nitrate nitrogen	12/31/2006	MCL, Single	MCL	3/27/2007	BCA issued
HAVELOCK WATER SUPPLY	177	POCAHONTAS	IA7609039	CWS	2006-01899	Chlorine	2/28/2006	Monitoring (DBP), Major	MON	3/31/2007	Compliance Achieved
HAVELOCK WATER SUPPLY	177	POCAHONTAS	IA7609039	CWS	2006-01901	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	3/31/2007	Compliance Achieved
HAWARDEN WATER SUPPLY	2478	SIoux	IA8434040	CWS	2006-01798	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/11/2006	Compliance Achieved
HAWARDEN WATER SUPPLY	2478	SIoux	IA8434040	CWS	2006-01912	Chlorine	4/30/2006	Monitoring (DBP), Major	MON	4/30/2007	Compliance Achieved
HENNESSY SCHOOL (PETERSBURG)	81	DUBUQUE	IA3130809	NTNC	2007-03489	Di(2-Ethylhexyl) Phthalate	12/31/2006	Routine Major	MON	1/30/2007	Compliance Achieved
HERITAGE UNITED METHODIST CHURCH	200	BREMER	IA0990808	TNC	2006-02254	Nitrate nitrogen	6/30/2006	MCL, Single	MCL	12/27/2006	Compliance Achieved
HI POINT GOLF COURSE	153	JOHNSON	IA5225802	TNC	2006-02402	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	5/31/2007	Compliance Achieved
HICKORY GROVE (GOLF COURSE)	28	FAYETTE	IA3353746	TNC	2006-02146	Nitrate nitrogen	4/30/2006	Routine Major	MON	5/30/2006	Compliance Achieved
HICKORY GROVE (GOLF COURSE)	28	FAYETTE	IA3353746	TNC	2007-03676	Chlorine	12/31/2006	Monitoring (MOR)	MON	1/26/2007	NOV issued
HIDDEN ACRES COUNTRY CLUB	100	PLYMOUTH	IA9778840	TNC	2006-01968	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	6/5/2006	Compliance Achieved
HIDDEN ACRES SUBDIVISION	104	JOHNSON	IA5282308	CWS	2006-03548	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	4/5/2007	Compliance Achieved
HIDDEN ACRES SUBDIVISION	104	JOHNSON	IA5282308	CWS	2007-01061	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	4/5/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
HIGHLAND GENERAL STORE & CAMPGROUND	59	WINNESHIEK	IA9656401	TNC	2006-02738	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/10/2006	Compliance Achieved
HIGHLAND GENERAL STORE & CAMPGROUND	59	WINNESHIEK	IA9656401	TNC	2007-03471	Nitrate nitrogen	12/31/2006	Routine Major	MON	3/13/2007	Compliance Achieved
HIGHLAND HIGH SCHOOL	305	WASHINGTON	IA9260528	NTNC	2006-03470	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	9/19/2006	Compliance Achieved
HILLS COMMUNITY BUILDING	27	JOHNSON	IA5221901	TNC	2006-03535	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	1/30/2007	Compliance Achieved
HILLSIDE GOLF	62	HANCOCK	IA5592893	TNC	2006-01638	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	4/5/2006	Compliance Achieved
HILLTOP SOUTH HOA	55	MUSCATINE	IA7048308	CWS	2007-01614	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	11/7/2006	Compliance Achieved
HINTON WATER SUPPLY	810	PLYMOUTH	IA7528051	CWS	2006-03252	Failure to meet Certified Operator Requirement	8/31/2006	Certified Operator Requirement	STA	9/20/2006	Compliance Achieved
HITCHCOCK NATURE CENTER	32	POTTAWATTAMIE	IA7836445	TNC	2006-02746	Nitrate nitrogen	6/30/2006	Routine Major	MON	7/25/2006	Compliance Achieved
HOLDENS FOUNDATION SEEDS # 3	110	IOWA	IA4884834	TNC	2006-02627	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/17/2006	Compliance Achieved
HOLDENS FOUNDATION SEEDS # 3	110	IOWA	IA4884834	TNC	2006-02684	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/17/2006	Compliance Achieved
HOLDENS FOUNDATION SEEDS # 3	110	IOWA	IA4884834	TNC	2006-02718	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/17/2006	Compliance Achieved
HOLDENS FOUNDATION SEEDS # 3	110	IOWA	IA4884834	TNC	2006-02719	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/17/2006	Compliance Achieved
HOLDENS FOUNDATION SEEDS INC #4	34	IOWA	IA4884835	TNC	2006-00991	Coliform Bacteria, Total	1/31/2006	Repeat Major	MON	1/31/2006	Compliance Achieved
HOLDENS FOUNDATION SEEDS INC #4	34	IOWA	IA4884835	TNC	2006-00992	Coliform Bacteria, Total	1/31/2006	Repeat Major	MON	1/31/2006	Compliance Achieved
HOLDENS FOUNDATION SEEDS INC #4	34	IOWA	IA4884835	TNC	2006-01078	Coliform Bacteria, Total	1/31/2006	Repeat Major	MON	1/31/2006	Compliance Achieved
HOLDENS FOUNDATION SEEDS INC #4	34	IOWA	IA4884835	TNC	2006-02687	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/17/2006	Compliance Achieved
HONEY CREEK CAMPGROUNDS	51	POTTAWATTAMIE	IA7822443	TNC	2007-00902	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/10/2006	Compliance Achieved
HOOTERS HAVEN	27	JACKSON	IA4934201	TNC	2006-01873	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/30/2006	Compliance Achieved
HOOTERS HAVEN	27	JACKSON	IA4934201	TNC	2007-00961	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/18/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
HORSTMANN GENERAL STORE	28	SCOTT	IA8212201	TNC	2006-02393	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	12/19/2006	Compliance Achieved
HOWARD RESIDENTIAL CARE FACILITY	145	HOWARD	IA4500901	CWS	2006-01672	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/6/2006	Compliance Achieved
HOWARD RESIDENTIAL CARE FACILITY	145	HOWARD	IA4500901	CWS	2006-01706	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/6/2006	Compliance Achieved
HUNTS CEDAR RIVER CAMPGROUND	42	CEDAR	IA1689411	TNC	2007-03372	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	4/27/2007	Compliance Achieved
INTERSTATE PARK	50	MITCHELL	IA6663903	TNC	2006-02792	Coliform Bacteria, Fecal	9/30/2006	MCL (TCR), Acute	MCL	8/31/2006	BCA issued
INTERSTATE PARK	50	MITCHELL	IA6663903	TNC	2006-02793	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	8/31/2006	BCA issued
INTERSTATE PARK	50	MITCHELL	IA6663903	TNC	2006-03327	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	8/31/2006	BCA issued
IOWA ARMY AMMUNITION PLANT	900	DES MOINES	IA2900900	NTNC	2006-01727	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	8/23/2005	BCA issued
IOWA ARMY AMMUNITION PLANT	900	DES MOINES	IA2900900	NTNC	2006-02433	Total Trihalomethanes	6/30/2006	MCL, Average	MCL	8/23/2005	BCA issued
IOWA CITY REGENCY MOBILE HOME COMMUNITY	700	JOHNSON	IA5225673	CWS	2006-03276	Radium 226 & Radium 228	9/30/2006	MCL, Average	MCL	4/9/2007	BCA issued
IOWA CITY REGENCY MOBILE HOME COMMUNITY	700	JOHNSON	IA5225673	CWS	2006-03317	Lead	6/30/2006	AL, 90th Percentile	MCL	6/29/2006	BCA issued
IOWA CITY REGENCY MOBILE HOME COMMUNITY	700	JOHNSON	IA5225673	CWS	2007-01850	Radium 226 & Radium 228	12/31/2006	MCL, Average	MCL	4/9/2007	BCA issued
IOWA CITY REHABILITATION & HEALTH CARE C	128	JOHNSON	IA5200847	CWS	2006-02379	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	8/31/2006	Compliance Achieved
IOWA FEED & GRAIN COMPANY	316	POTTAWATTAMIE	IA7822701	TNC	2006-03461	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	9/5/2006	Compliance Achieved
IOWA STATE PENITENTIARY	1200	LEE	IA5600947	CWS	2007-04356	Total Trihalomethanes	12/31/2006	MCL, Average	MCL	4/25/2007	NOV issued
IOWA STATE PENITENTIARY	1200	LEE	IA5600947	CWS	2007-04357	Total Haloacetic Acids	12/31/2006	MCL, Average	MCL	4/25/2007	NOV issued
IOWA STATE PENITENTIARY FARM 3	100	LEE	IA5600964	CWS	2006-01363	Coliform Bacteria, Total	1/31/2006	Routine Major	MON	2/21/2006	Compliance Achieved
IOWA TRUCK STOP #385	27	CERRO GORDO	IA1716202	TNC	2007-00921	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/25/2006	Compliance Achieved
IOWA TRUCK STOP #385	27	CERRO GORDO	IA1716202	TNC	2007-00922	Nitrate nitrogen	9/30/2006	Routine Major	MON	1/29/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
IRA WATER ASSOCIATION	70	JASPER	IA5031301	CWS	2006-03262	Chlorine	7/31/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
IRISH SHANTI LLC	25	CLAYTON	IA0375838	TNC	2006-02344	Nitrate nitrogen	5/31/2006	Routine Major	MON	6/20/2006	Compliance Achieved
IZAAK WALTON LEAGUE-DAVENPORT	50	SCOTT	IA8222801	TNC	2006-02825	Coliform Bacteria, Fecal	9/30/2006	MCL (TCR), Acute	MCL	8/24/2006	Compliance Achieved
IZAAK WALTON LEAGUE-DAVENPORT	50	SCOTT	IA8222801	TNC	2006-02826	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	8/24/2006	Compliance Achieved
IZAAK WALTON LEAGUE-IOWA CITY	34	JOHNSON	IA5225803	TNC	2006-03280	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	5/10/2007	Compliance Achieved
IZAAK WALTON LEAGUE-IOWA CITY	34	JOHNSON	IA5225803	TNC	2007-00075	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/6/2006	Compliance Achieved
IZAAK WALTON LEAGUE-IOWA CITY	34	JOHNSON	IA5225803	TNC	2007-03415	Nitrate nitrogen	12/31/2006	Routine Major	MON	5/10/2007	Compliance Achieved
JACKSON HEIGHTS GOLF COURSE	27	WINNESHIEK	IA9661201	TNC	2007-03430	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	5/14/2007	Compliance Achieved
JACKSON HEIGHTS GOLF COURSE	27	WINNESHIEK	IA9661201	TNC	2007-03431	Nitrate nitrogen	12/31/2006	Routine Major	MON	5/14/2007	Compliance Achieved
JAEGER PLUMBING & PUMP, INC.	50	DUBUQUE	IA3126713	TNC	2006-02244	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	2/21/2007	Compliance Achieved
JERICO JOS	28	CHICKASAW	IA1951201	TNC	2007-03580	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
JEWELS SKATE COUNTRY	104	WINNESHIEK	IA9630204	TNC	2006-03297	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	8/25/2006	NOV issued
JMD OIL INC	450	CEDAR	IA1600605	CWS	2007-03552	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/7/2007	NOV issued
JOHNSTON MUNICIPAL WATER SUPPLY	13596	POLK	IA7740011	CWS	2006-02012	Total Haloacetic Acids	3/31/2006	Monitoring (DBP), Major	MON	8/29/2006	Compliance Achieved
JOHNSTON MUNICIPAL WATER SUPPLY	13596	POLK	IA7740011	CWS	2006-02013	Total Trihalomethanes	3/31/2006	Routine Major	MON	8/29/2006	Compliance Achieved
JOS LONGBRANCH	27	HOWARD	IA4515202	TNC	2006-02695	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/31/2006	NOV issued
JOS LONGBRANCH	27	HOWARD	IA4515202	TNC	2006-02696	Nitrate nitrogen	6/30/2006	Routine Major	MON	7/31/2006	NOV issued
JOS LONGBRANCH	27	HOWARD	IA4515202	TNC	2007-00910	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/20/2006	NOV issued
JOS LONGBRANCH	27	HOWARD	IA4515202	TNC	2007-00911	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/20/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
JOS LONGBRANCH	27	HOWARD	IA4515202	TNC	2007-03425	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/22/2007	NOV issued
JOS LONGBRANCH	27	HOWARD	IA4515202	TNC	2007-03426	Nitrate nitrogen	12/31/2006	Routine Major	MON	1/22/2007	NOV issued
JOS LONGBRANCH	27	HOWARD	IA4515202	TNC	2007-03646	Chlorine	12/31/2006	Monitoring (MOR)	MON	1/26/2007	NOV issued
K & S QUASKY MART & DELI, LLC	103	BUCHANAN	IA1074203	TNC	2006-01816	Nitrate nitrogen	3/31/2006	Routine Major	MON	5/1/2006	Compliance Achieved
K&K GAS & FOOD INC	50	JACKSON	IA3198799	TNC	2006-03451	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	9/20/2006	Compliance Achieved
KAMMERER MOBILE HOME PARK	100	MUSCATINE	IA7000686	CWS	2006-03551	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	9/28/2006	NOV issued
KAY ENTERPRISES INC	35	BLACK HAWK	IA0932101	NTNC	2006-02408	Nitrate nitrogen	6/30/2006	MCL, Single	MCL	9/5/2006	BCA issued
KAY ENTERPRISES INC	35	BLACK HAWK	IA0932101	NTNC	2006-02835	Nitrate nitrogen	7/31/2006	MCL, Single	MCL	9/5/2006	BCA issued
KAY ENTERPRISES INC	35	BLACK HAWK	IA0932101	NTNC	2006-03332	Nitrate nitrogen	8/31/2006	MCL, Single	MCL	9/5/2006	BCA issued
KAY ENTERPRISES INC	35	BLACK HAWK	IA0932101	NTNC	2007-00964	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/30/2006	Compliance Achieved
KAY ENTERPRISES INC	35	BLACK HAWK	IA0932101	NTNC	2007-01060	Nitrate nitrogen	10/31/2006	MCL, Single	MCL	9/5/2006	BCA issued
KAY ENTERPRISES INC	35	BLACK HAWK	IA0932101	NTNC	2007-01995	Nitrate nitrogen	12/31/2006	MCL, Single	MCL	9/5/2006	BCA issued
KELLERTON WATER SUPPLY	372	RINGGOLD	IA8040015	CWS	2007-01945	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/12/2006	Compliance Achieved
KELLERTON WATER SUPPLY	372	RINGGOLD	IA8040015	CWS	2007-01993	Chlorine	11/30/2006	Monitoring (DBP), Major	MON	12/12/2006	Compliance Achieved
KELSIES	52	DUBUQUE	IA3126204	TNC	2006-01773	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	5/8/2006	Compliance Achieved
KELSIES	52	DUBUQUE	IA3126204	TNC	2006-01811	Nitrate nitrogen	3/31/2006	Routine Major	MON	5/8/2006	Compliance Achieved
KELSIES	52	DUBUQUE	IA3126204	TNC	2007-03380	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	3/20/2007	Compliance Achieved
KELSIES	52	DUBUQUE	IA3126204	TNC	2007-03586	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
KENDALLVILLE PARK	50	WINNESHIEK	IA9615901	TNC	2006-01967	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	9/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
KENSETT FABRICATORS INC	26	WORTH	IA9840896	NTNC	2006-03281	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	3/8/2007	Compliance Achieved
KESWICK WATER SYSTEM	295	KEOKUK	IA5442029	CWS	2007-00842	Total Trihalomethanes	8/31/2006	Routine Major	MON	11/1/2006	NOV issued
KESWICK WATER SYSTEM	295	KEOKUK	IA5442029	CWS	2007-00843	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	11/1/2006	NOV issued
KESWICK WATER SYSTEM	295	KEOKUK	IA5442029	CWS	2007-01867	Failure to meet Certified Operator Requirement	10/31/2006	Certified Operator Requirement	STA	5/23/2007	Compliance Achieved
KEVINGTON LANE	30	FREMONT	IA3600901	NTNC	2006-03349	Copper	9/30/2006	AL, 90th Percentile	MCL	9/27/2006	BCA issued
KIRACOFE STATION	24	JOHNSON	IA5285204	TNC	2006-03369	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	12/4/2006	Compliance Achieved
KLEMME WATER WORKS	593	HANCOCK	IA4155035	CWS	2006-02238	Radium 226 & Radium 228	6/30/2006	MCL, Average	MCL	9/14/2006	BCA issued
KLEMME WATER WORKS	593	HANCOCK	IA4155035	CWS	2006-03328	Radium 226 & Radium 228	9/30/2006	MCL, Average	MCL	9/14/2006	BCA issued
KLEMME WATER WORKS	593	HANCOCK	IA4155035	CWS	2007-02034	Radium 226 & Radium 228	12/31/2006	MCL, Average	MCL	9/14/2006	BCA issued
KNAPP MOBILE HOME COURT NO 4	87	DUBUQUE	IA3100602	CWS	2006-03545	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	10/4/2006	NOV issued
KNAPP MOBILE HOME COURT NO 4	87	DUBUQUE	IA3100602	CWS	2007-01105	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	11/12/2006	Compliance Achieved
KNIERIM WATER SUPPLY	70	CALHOUN	IA1340001	CWS	2006-02483	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	1/10/2007	Compliance Achieved
KOCHIES	29	FAYETTE	IA3383202	TNC	2007-00934	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	11/1/2006	Compliance Achieved
KOCHS MEADOW LAKE CAMPGROUNDS	200	CEDAR	IA1600624	TNC	2006-02462	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	4/30/2007	Compliance Achieved
KUM & GO STORE #443	162	IOWA	IA4884784	TNC	2007-00829	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	1/4/2007	Compliance Achieved
KUM & GO STORE #443	162	IOWA	IA4884784	TNC	2007-03386	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/4/2007	Compliance Achieved
KUM & GO STORE #443	162	IOWA	IA4884784	TNC	2007-03417	Nitrate nitrogen	12/31/2006	Routine Major	MON	2/21/2007	Compliance Achieved
LA CABANA	98	MUSCATINE	IA7016778	TNC	2007-00057	Failure to submit Operation Permit Application	10/31/2006	Permit Application Submittal	RPT	1/4/2007	Compliance Achieved
LA PORTE GOLF COURSE	40	BLACK HAWK	IA0743888	TNC	2006-02660	Nitrate nitrogen	6/30/2006	Routine Major	MON	4/5/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
LACINA MEADOWS RESIDENTIAL SUBDIVISION	35	JOHNSON	IA5225328	CWS	2006-02257	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	12/13/2006	Compliance Achieved
LACINA MEADOWS RESIDENTIAL SUBDIVISION	35	JOHNSON	IA5225328	CWS	2006-02859	Di(2-Ethylhexyl) Phthalate	9/30/2006	MCL, Average	MCL	8/2/2006	BCA issued
LACINA MEADOWS RESIDENTIAL SUBDIVISION	35	JOHNSON	IA5225328	CWS	2007-02007	Gross Alpha, excluding Rn & U	12/31/2006	MCL, Average	MCL	1/2/2007	BCA issued
LACINA MEADOWS RESIDENTIAL SUBDIVISION	35	JOHNSON	IA5225328	CWS	2007-02008	Radium 226 & Radium 228	12/31/2006	MCL, Average	MCL	1/2/2007	BCA issued
LACONA WATER SUPPLY	360	WARREN	IA9138041	CWS	2006-02876	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	3/13/2007	Compliance Achieved
LACONA WATER SUPPLY	360	WARREN	IA9138041	CWS	2006-03279	Coliform Bacteria, Fecal	8/31/2006	MCL (TCR), Acute	MCL	3/13/2007	Compliance Achieved
LACONA WATER SUPPLY	360	WARREN	IA9138041	CWS	2007-03528	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
LAKE CREST MANOR HOA # 1	35	JOHNSON	IA5200899	CWS	2006-01782	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/4/2006	Compliance Achieved
LAKE CREST MANOR HOA # 1	35	JOHNSON	IA5200899	CWS	2007-03553	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/14/2007	Compliance Achieved
LAKE MACBRIDE HEIGHTS HOA	60	JOHNSON	IA5282305	CWS	2006-01785	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/4/2006	Compliance Achieved
LAKE MACBRIDE HEIGHTS HOA	60	JOHNSON	IA5282305	CWS	2006-02831	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	2/28/2007	Compliance Achieved
LAKE MACBRIDE HEIGHTS HOA	60	JOHNSON	IA5282305	CWS	2006-03341	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	2/28/2007	Compliance Achieved
LAKE MACBRIDE HEIGHTS HOA	60	JOHNSON	IA5282305	CWS	2007-03555	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/14/2007	Compliance Achieved
LAKE MACBRIDE STATE PARK-EAST	27	JOHNSON	IA5282941	TNC	2006-02274	Coliform Bacteria, Fecal	6/30/2006	MCL (TCR), Acute	MCL	1/8/2007	Compliance Achieved
LAKE MACBRIDE STATE PARK-EAST	27	JOHNSON	IA5282941	TNC	2006-02275	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	1/8/2007	Compliance Achieved
LAKE MACBRIDE STATE PARK-EAST	27	JOHNSON	IA5282941	TNC	2006-02480	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	1/8/2007	Compliance Achieved
LAKE MACBRIDE STATE PARK-NORTH	25	JOHNSON	IA5200912	TNC	2006-02276	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	2/27/2007	Compliance Achieved
LAKE MACBRIDE STATE PARK-NORTH	25	JOHNSON	IA5200912	TNC	2006-02475	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	2/27/2007	Compliance Achieved
LAKE MACBRIDE STATE PARK-NORTH	25	JOHNSON	IA5200912	TNC	2006-03278	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	2/27/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
LAKE ODESSA CABIN OWNERS ASSOC.	41	LOUISA	IA5879424	TNC	2006-02692	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/2/2006	Compliance Achieved
LAKE RIDGE, INCORPORATED	900	JOHNSON	IA5225315	CWS	2007-01220	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	12/28/2006	Compliance Achieved
LAKE RIDGE, INCORPORATED	900	JOHNSON	IA5225315	CWS	2007-01868	Failure to meet Certified Operator Requirement	10/31/2006	Certified Operator Requirement	STA	1/16/2007	Compliance Achieved
LAKE RIDGE, INCORPORATED	900	JOHNSON	IA5225315	CWS	2007-01935	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/28/2006	Compliance Achieved
LAKE VISTA SUBDIVISION	141	JOHNSON	IA5282302	CWS	2006-02748	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	3/11/2007	Compliance Achieved
LAKE VISTA SUBDIVISION	141	JOHNSON	IA5282302	CWS	2006-03299	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	3/11/2007	Compliance Achieved
LAKE VISTA SUBDIVISION	141	JOHNSON	IA5282302	CWS	2006-03516	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	3/11/2007	Compliance Achieved
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2006-01777	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	6/19/2006	Compliance Achieved
LAND O LAKES RESEARCH FARM	78	HAMILTON	IA4063102	NTNC	2006-01829	Nitrate nitrogen	3/31/2006	Routine Major	MON	6/19/2006	Compliance Achieved
LARCHWOOD WATER SUPPLY	791	LYON	IA6050059	CWS	2006-02636	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/12/2006	Compliance Achieved
LARCHWOOD WATER SUPPLY	791	LYON	IA6050059	CWS	2006-02813	Chlorine	7/31/2006	Monitoring (DBP), Major	MON	7/27/2006	NOV issued
LARRABEE MUNICIPAL WATER WORKS	149	CHEROKEE	IA1833060	CWS	2007-00798	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	10/24/2006	NOV issued
LARRABEE MUNICIPAL WATER WORKS	149	CHEROKEE	IA1833060	CWS	2007-00799	Total Trihalomethanes	8/31/2006	Routine Major	MON	10/24/2006	NOV issued
LAZY ACRES RV PARK	120	BENTON	IA0680401	TNC	2007-00950	Nitrate nitrogen	9/30/2006	Routine Major	MON	4/3/2007	Compliance Achieved
LAZY ACRES RV PARK	120	BENTON	IA0680401	TNC	2007-00951	Nitrite nitrogen	9/30/2006	Routine Major	MON	4/3/2007	Compliance Achieved
LEDYARD WATER SUPPLY	147	KOSSUTH	IA5543069	CWS	2007-01408	Gross Alpha, excluding Rn & U	9/30/2006	Routine Major	MON	10/3/2006	Compliance Achieved
LEGRAND STONEFRONT RESTAURANT	30	DUBUQUE	IA3130731	TNC	2006-02903	Coliform Bacteria, Total	7/31/2006	Repeat Major	MON	3/28/2007	Compliance Achieved
LEGRAND STONEFRONT RESTAURANT	30	DUBUQUE	IA3130731	TNC	2006-02904	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	3/28/2007	Compliance Achieved
LEGRAND STONEFRONT RESTAURANT	30	DUBUQUE	IA3130731	TNC	2007-01107	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	3/28/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
LEHIGH CEMENT COMPANY	155	CERRO GORDO	IA1750196	NTNC	2006-02884	Lead	9/30/2006	AL, 90th Percentile	MCL	8/15/2006	NOV issued
LEMKE FUNERAL HOME - ANDOVER	25	CLINTON	IA2307201	TNC	2006-03103	Nitrate nitrogen	7/31/2006	Routine Major	MON	8/31/2006	Compliance Achieved
LEMKE FUNERAL HOME - ANDOVER	25	CLINTON	IA2307201	TNC	2007-00899	Nitrate nitrogen	9/30/2006	Routine Major	MON	8/31/2006	Compliance Achieved
LEMKE FUNERAL HOME - ANDOVER	25	CLINTON	IA2307201	TNC	2007-01500	Nitrate nitrogen	10/31/2006	Routine Major	MON	8/31/2006	Compliance Achieved
LETT'S UNITED METHODIST CHURCH	26	LOUISA	IA5847820	TNC	2007-01133	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	10/11/2006	Compliance Achieved
LIBERTY DOORS	32	JOHNSON	IA5252101	TNC	2006-02463	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	8/28/2006	Compliance Achieved
LIBERTY DOORS	32	JOHNSON	IA5252101	TNC	2006-03272	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	8/28/2006	Compliance Achieved
LIBERTYVILLE WATER WORKS	452	JEFFERSON	IA5148079	CWS	2007-01217	Copper	9/30/2006	Routine Tap	MON	11/28/2006	NOV issued
LIBERTYVILLE WATER WORKS	452	JEFFERSON	IA5148079	CWS	2007-01218	Lead	9/30/2006	Routine Tap	MON	11/28/2006	NOV issued
LIBERTYVILLE WATER WORKS	452	JEFFERSON	IA5148079	CWS	2007-03556	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/9/2007	Compliance Achieved
LINN COUNTY REC	58	LINN	IA5751101	NTNC	2006-02715	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/16/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-01364	Coliform Bacteria, Total	1/31/2006	Routine Major	MON	3/14/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-01787	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-01833	Nitrate nitrogen	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02001	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02123	Arsenic	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02124	Barium	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02125	Cadmium	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02126	Chromium	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02127	Fluoride	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02128	Mercury	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02129	Antimony	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02130	Thallium	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02131	Selenium	3/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02332	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02632	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-02988	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN CREST HEIGHTS	52	LINN	IA5758301	CWS	2006-03453	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	10/24/2006	Compliance Achieved
LINN HOLLOW MHP	60	WASHINGTON	IA9200601	CWS	2006-01377	Coliform Bacteria, Total	1/31/2006	Routine Major	MON	2/1/2006	Compliance Achieved
LINN HOLLOW MHP	60	WASHINGTON	IA9200601	CWS	2007-03557	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/24/2007	NOV issued
LISBON WATER SUPPLY	1898	LINN	IA5748086	CWS	2007-01093	Benzene	12/31/2006	MCL, Average	MCL	11/14/2006	NOV issued
LISCOMB WATER SUPPLY	272	MARSHALL	IA6462087	CWS	2006-03263	Chlorine	7/31/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
LITTLE ANGELS CHILD CARE CENTER	29	JOHNSON	IA5285501	NTNC	2006-03302	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	2/19/2007	Compliance Achieved
LITTLE ROCK WATER SUPPLY	493	LYON	IA6060006	CWS	2006-02783	Lead	6/30/2006	AL, 90th Percentile	MCL	7/18/2006	BCA issued
LITTLE SIOUX SCOUT RANCH	25	HARRISON	IA7820431	TNC	2006-01874	Nitrite nitrogen	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
LITTLE SIOUX SCOUT RANCH	25	HARRISON	IA7820431	TNC	2006-01875	Nitrate nitrogen	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
LITTLE SIOUX SCOUT RANCH	25	HARRISON	IA7820431	TNC	2006-02496	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	9/19/2006	Compliance Achieved
LITTLE SIOUX WATER DEPARTMENT	217	HARRISON	IA4333089	CWS	2007-01010	Di(2-Ethylhexyl) Phthalate	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
LITTLE SIOUX WATER DEPARTMENT	217	HARRISON	IA4333089	CWS	2007-01011	Xylenes	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
LOGAN-MISSOURI VALLEY COUNTRY CLUB	105	HARRISON	IA4337201	TNC	2007-01958	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/26/2006	Compliance Achieved
LOHRVILLE WATER SUPPLY	431	CALHOUN	IA1389001	CWS	2007-00794	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/3/2006	Compliance Achieved
LOHRVILLE WATER SUPPLY	431	CALHOUN	IA1389001	CWS	2007-01043	Chlorine	9/30/2006	Monitoring (DBP), Major	MON	10/24/2006	NOV issued
LOHRVILLE WATER SUPPLY	431	CALHOUN	IA1389001	CWS	2007-01913	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/11/2006	Compliance Achieved
LOHRVILLE WATER SUPPLY	431	CALHOUN	IA1389001	CWS	2007-01990	Chlorine	11/30/2006	Monitoring (DBP), Major	MON	12/21/2006	NOV issued
LOMBARDIS	54	DUBUQUE	IA4910861	TNC	2006-01779	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	8/15/2006	Compliance Achieved
LOMBARDIS	54	DUBUQUE	IA4910861	TNC	2006-02628	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/15/2006	Compliance Achieved
LOMBARDIS	54	DUBUQUE	IA4910861	TNC	2006-03384	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	1/16/2007	Compliance Achieved
LOMBARDIS	54	DUBUQUE	IA4910861	TNC	2007-00074	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	1/16/2007	Compliance Achieved
LOMBARDIS	54	DUBUQUE	IA4910861	TNC	2007-03387	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/16/2007	Compliance Achieved
LONG BRANCH MAINTENANCE CORP.	350	GUTHRIE	IA3900300	CWS	2006-03095	Selenium	6/30/2006	Routine Major	MON	7/14/2006	Compliance Achieved
LONG BRANCH MAINTENANCE CORP.	350	GUTHRIE	IA3900300	CWS	2006-03096	Barium	6/30/2006	Routine Major	MON	7/14/2006	Compliance Achieved
LONG BRANCH MAINTENANCE CORP.	350	GUTHRIE	IA3900300	CWS	2006-03097	Cadmium	6/30/2006	Routine Major	MON	7/14/2006	Compliance Achieved
LONG BRANCH MAINTENANCE CORP.	350	GUTHRIE	IA3900300	CWS	2006-03098	Chromium	6/30/2006	Routine Major	MON	7/14/2006	Compliance Achieved
LONG BRANCH MAINTENANCE CORP.	350	GUTHRIE	IA3900300	CWS	2006-03099	Mercury	6/30/2006	Routine Major	MON	7/14/2006	Compliance Achieved
LONG BRANCH MAINTENANCE CORP.	350	GUTHRIE	IA3900300	CWS	2006-03100	Antimony	6/30/2006	Routine Major	MON	7/14/2006	Compliance Achieved
LONG BRANCH MAINTENANCE CORP.	350	GUTHRIE	IA3900300	CWS	2006-03101	Thallium	6/30/2006	Routine Major	MON	7/14/2006	Compliance Achieved
LONG BRANCH MAINTENANCE CORP.	350	GUTHRIE	IA3900300	CWS	2007-01045	Chlorine	9/30/2006	Non-Reported Type	RPT	3/29/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
LOWELLS LANDING HOA	78	CLAYTON	IA2268837	TNC	2006-03376	Coliform Bacteria, Total	8/31/2006	Repeat Major	MON	9/5/2006	Compliance Achieved
LOYAL ORDER OF THE MOOSE LODGE/C RAPIDS	70	LINN	IA5715209	TNC	2006-02579	Coliform Bacteria, Total	7/31/2006	Repeat Major	MON	11/7/2006	Compliance Achieved
LOYAL ORDER OF THE MOOSE LODGE/C RAPIDS	70	LINN	IA5715209	TNC	2006-02939	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	11/7/2006	Compliance Achieved
LYN-DEN HEIGHTS HOMEOWNERS ASSOC.	84	JOHNSON	IA5225301	CWS	2007-03559	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/14/2007	Compliance Achieved
LYNNVILLE WATER DEPT	366	JASPER	IA5047008	CWS	2007-00831	Total Trihalomethanes	8/31/2006	Routine Major	MON	10/20/2006	NOV issued
LYNNVILLE WATER DEPT	366	JASPER	IA5047008	CWS	2007-00832	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	10/20/2006	NOV issued
LYON-SIOUX RWS-BIG SIOUX	1202	LYON	IA6000755	CWS	2007-01068	Copper	9/30/2006	Routine Tap	MON	11/6/2006	BCA issued
LYON-SIOUX RWS-BIG SIOUX	1202	LYON	IA6000755	CWS	2007-01069	Lead	9/30/2006	Routine Tap	MON	11/6/2006	BCA issued
MAGGIES DINER	41	CLAYTON	IA2258201	TNC	2007-03713	Failure to Obtain Construction Permit	9/30/2006	Construction without a permit	STA	7/29/2006	NOV issued
MANCHESTER GOLF CLUB INC	50	DELAWARE	IA2839898	TNC	2007-00814	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/10/2006	Compliance Achieved
MANCHESTER GOLF CLUB INC	50	DELAWARE	IA2839898	TNC	2007-00907	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/10/2006	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2006-01668	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	4/25/2006	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2006-01772	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/25/2006	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2006-01844	Nitrate nitrogen	3/31/2006	Routine Major	MON	4/25/2006	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2006-02326	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	7/31/2006	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2006-02619	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/31/2006	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2006-03090	Nitrate nitrogen	7/31/2006	Routine Major	MON	8/22/2006	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2006-03449	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	10/30/2006	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2007-00813	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/30/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2007-01922	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	1/22/2007	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2007-01955	Nitrate nitrogen	11/30/2006	Routine Major	MON	1/22/2007	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2007-03378	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/22/2007	Compliance Achieved
MANCHESTER LIVESTOCK AUCTION/COUNTRY CAF	123	DELAWARE	IA2839202	TNC	2007-03404	Nitrate nitrogen	12/31/2006	Routine Major	MON	1/22/2007	Compliance Achieved
MAPLEWOOD ESTATES MHP	245	MUSCATINE	IA7000601	CWS	2006-01328	Coliform Bacteria, Total	2/28/2006	MCL (TCR), Monthly	MCL	8/7/2006	Compliance Achieved
MAPLEWOOD ESTATES MHP	245	MUSCATINE	IA7000601	CWS	2006-01335	Coliform Bacteria, Fecal	2/28/2006	MCL (TCR), Acute	MCL	8/7/2006	Compliance Achieved
MAPLEWOOD ESTATES MHP	245	MUSCATINE	IA7000601	CWS	2006-03346	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	4/30/2007	Compliance Achieved
MAPLEWOOD ESTATES MHP	245	MUSCATINE	IA7000601	CWS	2007-00036	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	4/30/2007	Compliance Achieved
MAPLEWOOD ESTATES MHP	245	MUSCATINE	IA7000601	CWS	2007-01017	Coliform Bacteria, Fecal	10/31/2006	MCL (TCR), Acute	MCL	4/30/2007	Compliance Achieved
MAPLEWOOD ESTATES MHP	245	MUSCATINE	IA7000601	CWS	2007-03560	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/26/2007	Compliance Achieved
MARATHON LIGHT & WATER DEPARTMENT	309	BUENA VISTA	IA1150030	CWS	2006-02784	Arsenic	6/30/2006	MCL, Average	MCL	12/12/2006	BCA issued
MARATHON LIGHT & WATER DEPARTMENT	309	BUENA VISTA	IA1150030	CWS	2006-03350	Arsenic	9/30/2006	MCL, Average	MCL	12/12/2006	BCA issued
MARATHON LIGHT & WATER DEPARTMENT	309	BUENA VISTA	IA1150030	CWS	2007-01857	Arsenic	12/31/2006	MCL, Average	MCL	12/12/2006	BCA issued
MARENGO WATER SUPPLY	2535	IOWA	IA4843033	CWS	2007-00009	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	4/2/2007	Compliance Achieved
MARR PARK	148	WASHINGTON	IA9203461	TNC	2006-02226	Coliform Bacteria, Total	5/31/2006	MCL (TCR), Monthly	MCL	5/24/2007	Compliance Achieved
MARR PARK	148	WASHINGTON	IA9203461	TNC	2006-03283	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	5/24/2007	Compliance Achieved
MAYNARD WATER SUPPLY	500	FAYETTE	IA3350059	CWS	2006-02208	Arsenic	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
MAYNARD WATER SUPPLY	500	FAYETTE	IA3350059	CWS	2006-02209	Barium	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
MAYNARD WATER SUPPLY	500	FAYETTE	IA3350059	CWS	2006-02210	Cadmium	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
MAYNARD WATER SUPPLY	500	FAYETTE	IA3350059	CWS	2006-02211	Chromium	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
MAYNARD WATER SUPPLY	500	FAYETTE	IA3350059	CWS	2006-02212	Fluoride	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
MAYNARD WATER SUPPLY	500	FAYETTE	IA3350059	CWS	2006-02213	Mercury	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
MAYNARD WATER SUPPLY	500	FAYETTE	IA3350059	CWS	2006-02214	Sodium	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
MAYNARD WATER SUPPLY	500	FAYETTE	IA3350059	CWS	2006-02215	Antimony	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
MAYNARD WATER SUPPLY	500	FAYETTE	IA3350059	CWS	2006-02216	Thallium	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
MAYNARD WATER SUPPLY	500	FAYETTE	IA3350059	CWS	2006-02217	Selenium	3/31/2006	Routine Major	MON	5/24/2006	Compliance Achieved
MCCARTY CREEK HOMEOWNERS ASSN #8	85	SCOTT	IA8245323	CWS	2006-01685	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/20/2006	Compliance Achieved
MCCARTY CREEK HOMEOWNERS ASSN #8	85	SCOTT	IA8245323	CWS	2006-02997	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/28/2006	Compliance Achieved
MCCARTY CREEK HOMEOWNERS ASSN #8	85	SCOTT	IA8245323	CWS	2007-03562	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/26/2007	Compliance Achieved
MELBOURNE WATER SUPPLY	794	MARSHALL	IA6471063	CWS	2007-01257	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	11/10/2006	Compliance Achieved
MELODY OAKS SUBDIVISION	40	HARRISON	IA4344301	CWS	2006-01935	Failure to meet Certified Operator Requirement	5/31/2006	Certified Operator Requirement	STA	7/28/2006	Compliance Achieved
MICKEYS VALLEY HALL	35	SCOTT	IA8271202	TNC	2006-02486	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	1/27/2007	Compliance Achieved
MICKEYS VALLEY HALL	35	SCOTT	IA8271202	TNC	2006-02740	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/13/2006	Compliance Achieved
MICKEYS VALLEY HALL	35	SCOTT	IA8271202	TNC	2007-03459	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/27/2007	Compliance Achieved
MID RIVER MARINA	31	JOHNSON	IA5252202	TNC	2006-02716	Nitrate nitrogen	6/30/2006	Routine Major	MON	9/27/2006	Compliance Achieved
MID RIVER MARINA	31	JOHNSON	IA5252202	TNC	2007-03442	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/24/2007	NOV issued
MIDAMERICAN ENERGY CO. NEAL NORTH	134	WOODBURY	IA9778105	NTNC	2006-02811	Lead	9/30/2006	AL, 90th Percentile	MCL	7/27/2006	BCA issued
MIDDLETOWN WATER SUPPLY	535	DES MOINES	IA2952075	CWS	2006-01745	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	9/14/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
MIDDLETOWN WATER SUPPLY	535	DES MOINES	IA2952075	CWS	2006-02883	Total Trihalomethanes	6/30/2006	MCL, Average	MCL	9/14/2006	Compliance Achieved
MIDWAY WATER AND LIGHTING	72	LINN	IA5784302	CWS	2007-01084	Chlorine	9/30/2006	Non-Reported Type	RPT	10/30/2006	NOV issued
MIDWAY WATER AND LIGHTING	72	LINN	IA5784302	CWS	2007-03511	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/14/2007	Compliance Achieved
MIDWAY WATER AND LIGHTING	72	LINN	IA5784302	CWS	2007-03597	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
MILLERSBURG WATER DEPT	184	IOWA	IA4852082	CWS	2007-00828	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/27/2006	Compliance Achieved
MILLVILLE STEAKHOUSE	38	CLAYTON	IA2242786	TNC	2007-03409	Nitrate nitrogen	12/31/2006	Routine Major	MON	1/22/2007	Compliance Achieved
MILLVILLE STEAKHOUSE	38	CLAYTON	IA2242786	TNC	2007-03596	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
MILO PUBLIC WATER SUPPLY	839	WARREN	IA9155083	CWS	2006-03364	Total Trihalomethanes	9/30/2006	MCL, Average	MCL	9/12/2006	NOV issued
MINBURN WATERWORKS	391	DALLAS	IA2547085	CWS	2006-03267	Chlorine	5/31/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
MINBURN WATERWORKS	391	DALLAS	IA2547085	CWS	2006-03268	Chlorine	3/31/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
MINBURN WATERWORKS	391	DALLAS	IA2547085	CWS	2006-03269	Chlorine	4/30/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
MINBURN WATERWORKS	391	DALLAS	IA2547085	CWS	2007-03530	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
MINGO WATER DEPARTMENT	269	JASPER	IA5052087	CWS	2006-03264	Chlorine	7/31/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
MISSOURI VALLEY WATER SUPPLY	2992	HARRISON	IA4344088	CWS	2006-02978	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/16/2006	Compliance Achieved
MITCHELL COUNTY NATURE CENTER	30	MITCHELL	IA6663905	TNC	2007-03470	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/3/2007	Compliance Achieved
MITCHELL DAM BAR	84	MITCHELL	IA6642201	TNC	2006-01741	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	5/8/2006	Compliance Achieved
MITCHELL DAM BAR	84	MITCHELL	IA6642201	TNC	2006-01742	Failure to submit Monthly Operation Report	3/31/2006	Monthly Operation Report	RPT	5/8/2006	Compliance Achieved
MITCHELL TOWN PUMP	102	MITCHELL	IA6642773	TNC	2006-01365	Coliform Bacteria, Total	1/31/2006	Routine Major	MON	4/5/2006	Compliance Achieved
MITCHELL TOWN PUMP	102	MITCHELL	IA6642773	TNC	2006-01534	Nitrate nitrogen	1/31/2006	Routine Major	MON	4/5/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
MITCHELL TOWN PUMP	102	MITCHELL	IA6642773	TNC	2006-01680	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/24/2006	Compliance Achieved
MITCHELL TOWN PUMP	102	MITCHELL	IA6642773	TNC	2006-01702	Nitrate nitrogen	2/28/2006	Routine Major	MON	4/5/2006	Compliance Achieved
MONTICELLO WATER SUPPLY	3607	JONES	IA5343098	CWS	2006-02782	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	7/24/2006	NOV issued
MONTICELLO WATER SUPPLY	3607	JONES	IA5343098	CWS	2006-02803	Coliform Bacteria, Fecal	7/31/2006	MCL (TCR), Acute	MCL	7/24/2006	NOV issued
MONTI-VIEW MOBILE HOME PARK	60	JONES	IA5300688	CWS	2007-01083	Chlorine	9/30/2006	Non-Reported Type	RPT	10/30/2006	NOV issued
MONTI-VIEW MOBILE HOME PARK	60	JONES	IA5300688	CWS	2007-03703	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	4/11/2006	NOV issued
MONTI-VIEW MOBILE HOME PARK	60	JONES	IA5300688	CWS	2007-03707	Chlorine	12/31/2006	Monitoring (DBP), Major	MON	1/22/2007	NOV issued
MOONSHINE TAP	30	CHICKASAW	IA1974222	TNC	2006-02898	Coliform Bacteria, Total	7/31/2006	Repeat Major	MON	9/14/2006	Compliance Achieved
MOONSHINE TAP	30	CHICKASAW	IA1974222	TNC	2006-02899	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	9/14/2006	Compliance Achieved
MORGAN CREEK PARK	30	LINN	IA5715973	TNC	2006-03396	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	10/5/2006	Compliance Achieved
MORWOOD CAMPGROUND & RESORT	27	BUCHANAN	IA1031403	TNC	2007-03457	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	5/7/2007	Compliance Achieved
MOUNT AUBURN WATER SUPPLY	160	BENTON	IA0650001	CWS	2006-02767	Xylenes	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
MOUNT VERNON COMMUNITY BIBLE CHURCH	43	LINN	IA5758801	TNC	2006-01788	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	12/18/2006	Compliance Achieved
MOUNT VERNON COMMUNITY BIBLE CHURCH	43	LINN	IA5758801	TNC	2006-02633	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	12/18/2006	Compliance Achieved
MOUNT VERNON COMMUNITY BIBLE CHURCH	43	LINN	IA5758801	TNC	2007-00848	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	12/18/2006	Compliance Achieved
MOUNT VERNON COMMUNITY BIBLE CHURCH	43	LINN	IA5758801	TNC	2007-00947	Nitrate nitrogen	9/30/2006	Routine Major	MON	12/18/2006	Compliance Achieved
MT JOY MOBILE HOME PARK	173	SCOTT	IA8222603	CWS	2007-03563	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/13/2007	Compliance Achieved
MURRAY WATER WORKS	766	CLARKE	IA2032023	CWS	2006-02431	Chlorine	1/31/2006	Monitoring (DBP), Major	MON	6/13/2006	NOV issued
MURRAY WATER WORKS	766	CLARKE	IA2032023	CWS	2006-02432	Chlorine	2/28/2006	Monitoring (DBP), Major	MON	6/13/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2006-01670	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	4/28/2006	Compliance Achieved
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2006-01774	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/28/2006	Compliance Achieved
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2006-03450	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	9/26/2006	Compliance Achieved
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2007-01103	Failure to meet Certified Operator Requirement	11/30/2006	Certified Operator Requirement	STA	12/22/2006	Compliance Achieved
NAVAL RESERVE CENTER	35	DUBUQUE	IA3126902	TNC	2007-03595	Chlorine	6/30/2006	Non-Reported Type	RPT	12/22/2006	Compliance Achieved
NEW HAMPTON GOLF & COUNTRY CLUB	57	CHICKASAW	IA1970202	TNC	2007-00805	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	11/13/2006	Compliance Achieved
NEW HAMPTON GOLF & COUNTRY CLUB	57	CHICKASAW	IA1970202	TNC	2007-03594	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
NEW HAMPTON RED POWER INC	75	CHICKASAW	IA1970101	TNC	2007-00804	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/3/2006	Compliance Achieved
NEW HORIZON RESIDENTIAL	30	CEDAR	IA1600901	NTNC	2006-02114	Barium	3/31/2006	Routine Major	MON	6/28/2006	Compliance Achieved
NEW HORIZON RESIDENTIAL	30	CEDAR	IA1600901	NTNC	2006-02115	Cadmium	3/31/2006	Routine Major	MON	6/28/2006	Compliance Achieved
NEW HORIZON RESIDENTIAL	30	CEDAR	IA1600901	NTNC	2006-02116	Chromium	3/31/2006	Routine Major	MON	6/28/2006	Compliance Achieved
NEW HORIZON RESIDENTIAL	30	CEDAR	IA1600901	NTNC	2006-02117	Fluoride	3/31/2006	Routine Major	MON	6/28/2006	Compliance Achieved
NEW HORIZON RESIDENTIAL	30	CEDAR	IA1600901	NTNC	2006-02118	Mercury	3/31/2006	Routine Major	MON	6/28/2006	Compliance Achieved
NEW HORIZON RESIDENTIAL	30	CEDAR	IA1600901	NTNC	2006-02119	Sodium	3/31/2006	Routine Major	MON	6/28/2006	Compliance Achieved
NEW HORIZON RESIDENTIAL	30	CEDAR	IA1600901	NTNC	2006-02120	Antimony	3/31/2006	Routine Major	MON	6/28/2006	Compliance Achieved
NEW HORIZON RESIDENTIAL	30	CEDAR	IA1600901	NTNC	2006-02121	Thallium	3/31/2006	Routine Major	MON	6/28/2006	Compliance Achieved
NEW HORIZON RESIDENTIAL	30	CEDAR	IA1600901	NTNC	2006-02122	Selenium	3/31/2006	Routine Major	MON	6/28/2006	Compliance Achieved
NEW MARKET WATER SUPPLY	456	TAYLOR	IA8758061	CWS	2006-01319	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	1/31/2006	NOV issued
NEW MARKET WATER SUPPLY	456	TAYLOR	IA8758061	CWS	2006-01690	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/16/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
NEW MARKET WATER SUPPLY	456	TAYLOR	IA8758061	CWS	2006-01724	Chlorine	2/28/2006	Monitoring (DBP), Major	MON	3/16/2006	Compliance Achieved
NEW MARKET WATER SUPPLY	456	TAYLOR	IA8758061	CWS	2006-02231	Total Trihalomethanes	6/30/2006	MCL, Average	MCL	7/13/2006	NOV issued
NEW MARKET WATER SUPPLY	456	TAYLOR	IA8758061	CWS	2006-02834	Total Trihalomethanes	9/30/2006	MCL, Average	MCL	7/31/2006	NOV issued
NEW MARKET WATER SUPPLY	456	TAYLOR	IA8758061	CWS	2007-01849	Total Trihalomethanes	12/31/2006	MCL, Average	MCL	11/28/2006	NOV issued
NEW VIRGINIA WATER SUPPLY	469	WARREN	IA9159067	CWS	2006-01753	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	4/11/2006	NOV issued
NEW VIRGINIA WATER SUPPLY	469	WARREN	IA9159067	CWS	2006-02436	Total Trihalomethanes	6/30/2006	MCL, Average	MCL	7/6/2006	NOV issued
NEW WINE PARK	105	DUBUQUE	IA3126940	TNC	2006-02270	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	2/21/2007	Compliance Achieved
NEW WINE PARK	105	DUBUQUE	IA3126940	TNC	2007-00905	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/10/2006	Compliance Achieved
NISHNA VALLEY RECREATION CLUB	43	CASS	IA1528809	TNC	2006-02614	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	4/10/2007	Compliance Achieved
NISHNA VALLEY RECREATION CLUB	43	CASS	IA1528809	TNC	2006-02690	Nitrate nitrogen	6/30/2006	Routine Major	MON	4/10/2007	Compliance Achieved
NISHNA VALLEY RECREATION CLUB	43	CASS	IA1528809	TNC	2007-00795	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/20/2006	NOV issued
NOB HILL SUPPER CLUB	65	WINNESHIEK	IA9630780	TNC	2006-01577	Failure to meet Certified Operator Requirement	2/28/2006	Certified Operator Requirement	STA	5/25/2006	Compliance Achieved
NOB HILL SUPPER CLUB	65	WINNESHIEK	IA9630780	TNC	2006-02156	Nitrate nitrogen	4/30/2006	Routine Major	MON	5/17/2006	Compliance Achieved
NOB HILL SUPPER CLUB	65	WINNESHIEK	IA9630780	TNC	2007-01968	Nitrate nitrogen	11/30/2006	Routine Major	MON	11/15/2006	Compliance Achieved
NORTH AMERICAN MOBILE HOME PARK	234	WARREN	IA9133601	CWS	2007-03531	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
NORTH CEDAR PARK	25	BREMER	IA0975914	TNC	2006-01925	Nitrate nitrogen	4/30/2006	MCL, Single	MCL	10/20/2006	Compliance Achieved
NORTH TWIN VIEW HEIGHTS	180	JOHNSON	IA5200813	CWS	2006-02451	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	1/5/2007	Compliance Achieved
NORTHWOOD COUNTRY CLUB	42	WORTH	IA9855201	TNC	2006-02647	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/23/2006	Compliance Achieved
OAK HILLS PAR 30 GOLF COURSE	60	CERRO GORDO	IA1716820	TNC	2006-01953	Coliform Bacteria, Total	5/31/2006	Repeat Major	MON	7/25/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
OAK HILLS PAR 30 GOLF COURSE	60	CERRO GORDO	IA1716820	TNC	2006-02283	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	8/15/2006	Compliance Achieved
OAK HILLS PAR 30 GOLF COURSE	60	CERRO GORDO	IA1716820	TNC	2006-02664	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/15/2006	Compliance Achieved
OAK RIDGE LAKE ESTATES	88	JOHNSON	IA5225302	CWS	2006-02461	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	1/9/2007	Compliance Achieved
OAK VALLEY	154	LINN	IA5784311	CWS	2006-02003	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	3/28/2007	Compliance Achieved
OAK VALLEY	154	LINN	IA5784311	CWS	2006-02236	Chlorine	4/30/2006	Monitoring (DBP), Major	MON	5/25/2006	NOV issued
OAK VALLEY	154	LINN	IA5784311	CWS	2007-01038	Chlorine	5/31/2006	Non-Reported Type	RPT	5/26/2006	NOV issued
OAKVILLE WATER SUPPLY	439	LOUISA	IA5868085	CWS	2006-01789	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/3/2006	Compliance Achieved
OHKIYU VILLAGE MHC	55	LEE	IA5600685	CWS	2006-01592	Failure to meet Certified Operator Requirement	2/28/2006	Certified Operator Requirement	STA	1/10/2007	Compliance Achieved
OHKIYU VILLAGE MHC	55	LEE	IA5600685	CWS	2007-01232	Copper	9/30/2006	Routine Tap	MON	12/13/2006	Compliance Achieved
OHKIYU VILLAGE MHC	55	LEE	IA5600685	CWS	2007-01233	Lead	9/30/2006	Routine Tap	MON	12/13/2006	Compliance Achieved
OHKIYU VILLAGE MHC	55	LEE	IA5600685	CWS	2007-03564	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/7/2007	NOV issued
OLIN WATER SUPPLY	716	JONES	IA5355094	CWS	2006-02630	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/16/2006	Compliance Achieved
ONAWA KOA	302	MONONA	IA6739434	TNC	2006-02007	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/22/2006	Compliance Achieved
ORAN TAP & CAFE	51	FAYETTE	IA3357769	TNC	2006-02401	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	7/7/2006	NOV issued
ORAN TAP & CAFE	51	FAYETTE	IA3357769	TNC	2007-03382	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	3/15/2007	Compliance Achieved
ORCHARD HEIGHTS SUBDIVISION	73	JOHNSON	IA5285303	CWS	2006-01848	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/4/2006	Compliance Achieved
ORCHARD HEIGHTS SUBDIVISION	73	JOHNSON	IA5285303	CWS	2007-03565	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/14/2007	Compliance Achieved
ORIENT MUNICIPAL WATER SUPPLY	402	ADAIR	IA0160099	CWS	2006-01722	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	10/24/2006	Compliance Achieved
ORR ADDITION	40	LINN	IA5784317	CWS	2007-01075	Copper	9/30/2006	Routine Tap	MON	11/6/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ORR ADDITION	40	LINN	IA5784317	CWS	2007-01076	Lead	9/30/2006	Routine Tap	MON	11/6/2006	NOV issued
OSCEOLA WATER WORKS	4659	CLARKE	IA2038038	CWS	2007-04031	Total Organic Carbon	12/31/2006	Monitoring (DBP), Major	MON	1/9/2007	Compliance Achieved
OSTERDOCK STORE	26	CLAYTON	IA2242203	TNC	2007-03593	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
OWASA TAP	27	HARDIN	IA4213203	TNC	2006-02279	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	2/1/2007	Compliance Achieved
OWASA TAP	27	HARDIN	IA4213203	TNC	2006-02457	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	2/1/2007	Compliance Achieved
OWASA TAP	27	HARDIN	IA4213203	TNC	2006-02947	Coliform Bacteria, Total	7/31/2006	Repeat Major	MON	8/28/2006	Compliance Achieved
OWASA TAP	27	HARDIN	IA4213203	TNC	2006-02948	Coliform Bacteria, Total	7/31/2006	Repeat Major	MON	8/28/2006	Compliance Achieved
OWASA TAP	27	HARDIN	IA4213203	TNC	2007-03607	Coliform Bacteria, Total	7/31/2006	Non-Reported Type	PN	1/26/2007	NOV issued
OWASA TAP	27	HARDIN	IA4213203	TNC	2007-03608	Coliform Bacteria, Total	6/30/2006	Non-Reported Type	PN	1/26/2007	NOV issued
OXFORD WATER SUPPLY	705	JOHNSON	IA5260017	CWS	2006-01928	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	11/21/2006	Compliance Achieved
OXFORD WATER SUPPLY	705	JOHNSON	IA5260017	CWS	2006-02983	Copper	6/30/2006	Routine Tap	MON	7/28/2006	Compliance Achieved
OXFORD WATER SUPPLY	705	JOHNSON	IA5260017	CWS	2006-02984	Lead	6/30/2006	Routine Tap	MON	7/28/2006	Compliance Achieved
OXFORD WATER SUPPLY	705	JOHNSON	IA5260017	CWS	2007-00840	Total Trihalomethanes	8/31/2006	Routine Major	MON	11/1/2006	NOV issued
OXFORD WATER SUPPLY	705	JOHNSON	IA5260017	CWS	2007-00841	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	11/1/2006	NOV issued
PAGE I RURAL WATER DISTRICT (CLARINDA)	2092	PAGE	IA7383901	CWS	2006-01320	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	1/31/2006	NOV issued
PAGE I RURAL WATER DISTRICT (CLARINDA)	2092	PAGE	IA7383901	CWS	2006-02833	Total Trihalomethanes	9/30/2006	MCL, Average	MCL	7/31/2006	NOV issued
PAGE I RURAL WATER DISTRICT (CLARINDA)	2092	PAGE	IA7383901	CWS	2006-03287	Total Trihalomethanes	6/30/2006	MCL, Average	MCL	8/23/2006	NOV issued
PAGE I RURAL WATER DISTRICT (CLARINDA)	2092	PAGE	IA7383901	CWS	2007-03502	Total Trihalomethanes	12/31/2006	MCL, Average	MCL	1/22/2007	NOV issued
PALMER WATER SUPPLY	214	POCAHONTAS	IA7622024	CWS	2007-01273	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	11/8/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
PALMER WATER SUPPLY	214	POCAHONTAS	IA7622024	CWS	2007-01845	Chlorine	10/31/2006	Monitoring (DBP), Major	MON	11/27/2006	NOV issued
PALO SAVINGS BANK	70	LINN	IA5765204	TNC	2006-03166	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/24/2006	Compliance Achieved
PARADISE VALLEY CAMPGROUND	55	CLAYTON	IA2234601	TNC	2006-02616	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/5/2006	Compliance Achieved
PARADISE VALLEY CAMPGROUND	55	CLAYTON	IA2234601	TNC	2006-02694	Nitrate nitrogen	6/30/2006	Routine Major	MON	7/5/2006	Compliance Achieved
PARK HILLS UTILITY	141	MARION	IA6361301	CWS	2006-03265	Chlorine	7/31/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
PARKSIDE MOBILE HOME PARK	147	WARREN	IA9133650	CWS	2007-03532	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
PEOSTA WATER SUPPLY	1052	DUBUQUE	IA3170001	CWS	2007-01199	Copper	9/30/2006	Routine Tap	MON	11/28/2006	NOV issued
PEOSTA WATER SUPPLY	1052	DUBUQUE	IA3170001	CWS	2007-01200	Lead	9/30/2006	Routine Tap	MON	11/28/2006	NOV issued
PEOSTA WATER SUPPLY	1052	DUBUQUE	IA3170001	CWS	2007-03704	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	4/11/2006	NOV issued
PERSIA MUNICIPAL WATER SUPPLY	363	HARRISON	IA4360038	CWS	2007-01933	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	1/2/2007	Compliance Achieved
PHAT CATS ROADHOUSE	31	FAYETTE	IA3383203	TNC	2006-01331	Nitrate nitrogen	12/31/2006	MCL, Average	MCL	2/20/2006	BCA issued
PHAT CATS ROADHOUSE	31	FAYETTE	IA3383203	TNC	2006-01870	Nitrate nitrogen	3/31/2006	Routine Major	MON	6/14/2006	Compliance Achieved
PHAT CATS ROADHOUSE	31	FAYETTE	IA3383203	TNC	2006-02170	Nitrate nitrogen	4/30/2006	Routine Major	MON	6/14/2006	Compliance Achieved
PHAT CATS ROADHOUSE	31	FAYETTE	IA3383203	TNC	2006-02278	Nitrate nitrogen	6/30/2006	MCL, Single	MCL	2/20/2006	BCA issued
PHAT CATS ROADHOUSE	31	FAYETTE	IA3383203	TNC	2006-02373	Nitrate nitrogen	5/31/2006	Routine Major	MON	6/14/2006	Compliance Achieved
PICTURED ROCKS METHODIST CAMP	29	JONES	IA5343413	TNC	2006-01809	Nitrate nitrogen	3/31/2006	Routine Major	MON	4/12/2006	Compliance Achieved
PICTURED ROCKS METHODIST CAMP	29	JONES	IA5343413	TNC	2007-03592	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
PINE BLUFF 4H CAMP	41	WINNESHIEK	IA9630405	TNC	2006-02747	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/31/2006	NOV issued
PINE BLUFF 4H CAMP	41	WINNESHIEK	IA9630405	TNC	2007-00948	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/20/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
PINE BLUFF 4H CAMP	41	WINNESHIEK	IA9630405	TNC	2007-00949	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/20/2006	NOV issued
PINEO GROVE WATER COMPANY	53	SCOTT	IA8273062	CWS	2006-01689	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/20/2006	Compliance Achieved
PINEO GROVE WATER COMPANY	53	SCOTT	IA8273062	CWS	2006-02999	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/24/2006	Compliance Achieved
PINEO GROVE WATER COMPANY	53	SCOTT	IA8273062	CWS	2007-02023	Copper	9/30/2006	AL, 90th Percentile	MCL	1/10/2007	BCA issued
PINEO GROVE WATER COMPANY	53	SCOTT	IA8273062	CWS	2007-03566	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/26/2007	Compliance Achieved
PINICON RIDGE C	150	LINN	IA5720907	TNC	2006-01633	Coliform Bacteria, Total	3/31/2006	MCL (TCR), Monthly	MCL	4/4/2006	NOV issued
PINICON RIDGE C	150	LINN	IA5720907	TNC	2006-01973	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/1/2006	Compliance Achieved
PINICON RIDGE C	150	LINN	IA5720907	TNC	2006-02668	Nitrate nitrogen	6/30/2006	Routine Major	MON	7/31/2006	NOV issued
PINICON RIDGE C	150	LINN	IA5720907	TNC	2006-02838	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	8/17/2006	NOV issued
PINICON RIDGE C	150	LINN	IA5720907	TNC	2006-03419	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	9/25/2006	NOV issued
PINICON RIDGE C	150	LINN	IA5720907	TNC	2007-00042	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	10/26/2006	NOV issued
PINICON RIDGE C	150	LINN	IA5720907	TNC	2007-01896	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/21/2006	NOV issued
PINICON RIDGE CAMPGROUNDS	150	LINN	IA5720905	TNC	2006-03418	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	9/25/2006	NOV issued
PINICON RIDGE CAMPGROUNDS	150	LINN	IA5720905	TNC	2007-00043	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	10/23/2006	NOV issued
PIT STOP	42	MITCHELL	IA6634202	TNC	2006-02809	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	1/8/2007	Compliance Achieved
PLA-MOR BOWL OF IOWA FALLS, INC.	173	HARDIN	IA4260210	TNC	2007-00824	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/2/2006	Compliance Achieved
PLA-MOR BOWL OF IOWA FALLS, INC.	173	HARDIN	IA4260210	TNC	2007-00891	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/2/2006	Compliance Achieved
PLEASANT CREEK PUBLIC AREA 2	26	DUBUQUE	IA4910402	TNC	2006-01961	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/15/2006	Compliance Achieved
PLEASANT CREEK PUBLIC AREA 2	26	DUBUQUE	IA4910402	TNC	2007-00893	Nitrate nitrogen	9/30/2006	Routine Major	MON	5/8/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
PLEASANT VIEW LODGE	53	JOHNSON	IA5252719	TNC	2007-00039	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	4/17/2007	Compliance Achieved
PLOVER WATER SUPPLY	95	POCAHONTAS	IA7628047	CWS	2006-02868	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	2/13/2007	Compliance Achieved
POET BIOREFINING (COON RAPIDS)	49	GUTHRIE	IA3907801	NTNC	2006-01311	Nitrate nitrogen	1/31/2006	MCL, Single	MCL	7/31/2006	Compliance Achieved
POMEROY WATER SUPPLY	710	CALHOUN	IA1363051	CWS	2006-03525	Failure to meet Certified Operator Requirement	9/30/2006	Certified Operator Requirement	STA	9/8/2006	NOV issued
POMEROY WATER SUPPLY	710	CALHOUN	IA1363051	CWS	2007-01178	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	11/27/2006	Compliance Achieved
POMEROY WATER SUPPLY	710	CALHOUN	IA1363051	CWS	2007-01844	Chlorine	10/31/2006	Monitoring (DBP), Major	MON	11/27/2006	NOV issued
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-00982	Coliform Bacteria, Total	1/31/2006	Non-Reported Type	PN	1/10/2006	NOV issued
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-01902	Chlorine	1/31/2006	Monitoring (DBP), Major	MON	3/31/2007	Compliance Achieved
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-01903	Chlorine	2/28/2006	Monitoring (DBP), Major	MON	3/31/2007	Compliance Achieved
PRAIRIE HILLS	45	WOODBURY	IA9700901	CWS	2006-01904	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	3/31/2007	Compliance Achieved
PRAIRIE VILLAGE MOBILE HOME PK	200	DALLAS	IA2500600	CWS	2006-01615	Failure to meet Certified Operator Requirement	3/31/2006	Certified Operator Requirement	STA	5/27/2007	Compliance Achieved
PRAIRIES EDGE NATURE CENTER	150	HOWARD	IA4515902	TNC	2006-01946	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	5/18/2006	NOV issued
PRESTON MUNI WATER SUPPLY	949	JACKSON	IA4965057	CWS	2007-03590	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
PRINCETON WATER SUPPLY	946	SCOTT	IA8273061	CWS	2006-01688	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/20/2006	Compliance Achieved
PRINCETON WATER SUPPLY	946	SCOTT	IA8273061	CWS	2006-02019	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/3/2006	Compliance Achieved
RABINER TREATMENT CENTER	156	WEBSTER	IA9433801	CWS	2006-03170	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/31/2006	Compliance Achieved
RABINER TREATMENT CENTER	156	WEBSTER	IA9433801	CWS	2007-03450	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/10/2007	Compliance Achieved
RALEIGH HILLS GOLF COURSE	66	CHICKASAW	IA1946201	TNC	2006-01838	Nitrate nitrogen	3/31/2006	Routine Major	MON	4/5/2006	Compliance Achieved
RALEIGH HILLS GOLF COURSE	66	CHICKASAW	IA1946201	TNC	2006-02802	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	4/5/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
RALEIGH HILLS GOLF COURSE	66	CHICKASAW	IA1946201	TNC	2006-03417	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	12/29/2006	Compliance Achieved
RAPID CREEK RIDGE	70	JOHNSON	IA5225387	CWS	2006-01674	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/31/2006	Compliance Achieved
RAPID CREEK RIDGE	70	JOHNSON	IA5225387	CWS	2006-02710	Nitrate nitrogen	6/30/2006	Routine Major	MON	7/19/2006	Compliance Achieved
RAPID CREEK RIDGE	70	JOHNSON	IA5225387	CWS	2007-01223	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	11/30/2006	Compliance Achieved
RAPID CREEK RIDGE	70	JOHNSON	IA5225387	CWS	2007-03567	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/7/2007	NOV issued
RED MAN 2, LLC	37	MITCHELL	IA6634201	TNC	2007-00908	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/16/2006	Compliance Achieved
REDFIELD WATER WORKS	833	DALLAS	IA2564074	CWS	2007-00811	Total Trihalomethanes	8/31/2006	Routine Major	MON	10/20/2006	NOV issued
REDFIELD WATER WORKS	833	DALLAS	IA2564074	CWS	2007-00812	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	10/20/2006	NOV issued
REDWING ESTATES HOA	25	JOHNSON	IA5225313	CWS	2006-01621	Failure to meet Certified Operator Requirement	3/31/2006	Certified Operator Requirement	STA	6/9/2006	Compliance Achieved
REDWING ESTATES HOA	25	JOHNSON	IA5225313	CWS	2006-02981	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/16/2006	Compliance Achieved
REDWING ESTATES HOA	25	JOHNSON	IA5225313	CWS	2007-01934	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/5/2006	Compliance Achieved
RENWICK MUNIC WATER SUPPLY	306	HUMBOLDT	IA4669080	CWS	2007-01018	Lead	9/30/2006	AL, 90th Percentile	MCL	10/19/2006	NOV issued
RHODES WATER SUPPLY	294	MARSHALL	IA6480081	CWS	2007-03533	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/12/2007	Compliance Achieved
RHODYS	42	DUBUQUE	IA3126203	TNC	2006-01827	Nitrate nitrogen	3/31/2006	Routine Major	MON	5/30/2006	Compliance Achieved
RICHLAND WATER SUPPLY	587	KEOKUK	IA5470083	CWS	2006-01619	Failure to meet Certified Operator Requirement	3/31/2006	Certified Operator Requirement	STA	3/13/2006	Compliance Achieved
RIVER CITY LANES	110	LEE	IA5625217	TNC	2006-02725	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/14/2006	Compliance Achieved
RIVER CITY LANES	110	LEE	IA5625217	TNC	2007-00928	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
RIVER CITY LANES	110	LEE	IA5625217	TNC	2007-00929	Nitrate nitrogen	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
RIVERTON WATER WORKS	304	FREMONT	IA3655071	CWS	2007-00821	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/11/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
RIVERVIEW SUBDIVISION	37	MUSCATINE	IA7038301	CWS	2006-02878	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	2/22/2007	Compliance Achieved
RIVERVIEW SUBDIVISION	37	MUSCATINE	IA7038301	CWS	2007-01639	Copper	9/30/2006	Routine Tap	MON	1/8/2007	BCA issued
RIVERVIEW SUBDIVISION	37	MUSCATINE	IA7038301	CWS	2007-01640	Lead	9/30/2006	Routine Tap	MON	1/8/2007	BCA issued
RIVERVIEW SUBDIVISION	37	MUSCATINE	IA7038301	CWS	2007-03568	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/24/2007	NOV issued
ROBERT OLLENBURG WELL	40	CERRO GORDO	IA1716303	TNC	2006-03362	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	9/28/2006	NOV issued
ROCK VALLEY RURAL WATER DISTRICT	1650	SIoux	IA8482701	CWS	2006-01731	Failure to Obtain Construction Permit	1/31/2006	Construction without a permit	STA	5/23/2006	NOV issued
ROCK VALLEY RURAL WATER DISTRICT	1650	SIoux	IA8482701	CWS	2006-03290	Failure to meet Certified Operator Requirement	8/31/2006	Certified Operator Requirement	STA	5/1/2007	Compliance Achieved
ROCKY KNOLL MHP	65	WINNEBAGO	IA9525601	CWS	2007-03521	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
ROLLING ACRES GOLF COURSE	50	LINN	IA5718202	TNC	2006-02427	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	7/5/2006	NOV issued
ROLLING ACRES GOLF COURSE	50	LINN	IA5718202	TNC	2006-02428	Coliform Bacteria, Fecal	6/30/2006	MCL (TCR), Acute	MCL	7/5/2006	NOV issued
ROLLING ACRES GOLF COURSE	50	LINN	IA5718202	TNC	2007-03475	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	3/19/2007	Compliance Achieved
ROLLING ACRES SUBDIVISION	115	MUSCATINE	IA7048310	CWS	2006-01583	Arsenic	3/31/2006	MCL, Average	MCL	6/23/2006	Compliance Achieved
ROLLING ACRES SUBDIVISION	115	MUSCATINE	IA7048310	CWS	2006-02251	Arsenic	6/30/2006	MCL, Average	MCL	6/23/2006	Compliance Achieved
ROLLING ACRES SUBDIVISION	115	MUSCATINE	IA7048310	CWS	2006-02383	Copper	6/30/2006	AL, 90th Percentile	MCL	1/17/2007	BCA issued
ROLLING ACRES SUBDIVISION	115	MUSCATINE	IA7048310	CWS	2007-02026	Copper	12/31/2006	AL, 90th Percentile	MCL	1/11/2007	BCA issued
ROLLING KNOLLS GOLF COURSE	118	DUBUQUE	IA3130886	TNC	2006-02816	Coliform Bacteria, Fecal	9/30/2006	MCL (TCR), Acute	MCL	11/6/2006	BCA issued
ROLLING KNOLLS GOLF COURSE	118	DUBUQUE	IA3130886	TNC	2006-02817	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	11/6/2006	BCA issued
ROLLING KNOLLS GOLF COURSE	118	DUBUQUE	IA3130886	TNC	2006-03365	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	11/6/2006	BCA issued
ROLLING KNOLLS GOLF COURSE	118	DUBUQUE	IA3130886	TNC	2007-00071	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	4/30/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ROLLING KNOLLS GOLF COURSE	118	DUBUQUE	IA3130886	TNC	2007-01878	Coliform Bacteria, Total	11/30/2006	Repeat Major	MON	4/30/2007	Compliance Achieved
ROLLING KNOLLS GOLF COURSE	118	DUBUQUE	IA3130886	TNC	2007-03599	Chlorine	6/30/2006	Non-Reported Type	RPT	6/28/2006	NOV issued
ROME WATER SUPPLY	113	HENRY	IA4475001	CWS	2007-01208	Copper	9/30/2006	Routine Tap	MON	1/9/2007	NOV issued
ROME WATER SUPPLY	113	HENRY	IA4475001	CWS	2007-01209	Lead	9/30/2006	Routine Tap	MON	1/9/2007	NOV issued
RS TAVERN	35	JACKSON	IA4955725	TNC	2007-00830	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	3/27/2007	Compliance Achieved
RUMORS II	35	JACKSON	IA3113200	TNC	2007-00815	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/31/2006	Compliance Achieved
RURAL WATER SYSTEM #1	3020	SIOUX	IA8400722	CWS	2006-01597	Failure to Obtain Construction Permit	1/31/2006	Construction without a permit	STA	2/3/2006	NOV issued
RURAL WATER SYSTEM #1	3020	SIOUX	IA8400722	CWS	2006-02867	Failure to Obtain Construction Permit	6/30/2006	Construction without a permit	STA	6/13/2006	NOV issued
SAINT CHARLES WATER SUPPLY	694	MADISON	IA6161031	CWS	2006-01726	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	12/20/2006	Compliance Achieved
SAINT CHARLES WATER SUPPLY	694	MADISON	IA6161031	CWS	2006-02435	Total Trihalomethanes	6/30/2006	MCL, Average	MCL	12/20/2006	Compliance Achieved
SAINT CHARLES WATER SUPPLY	694	MADISON	IA6161031	CWS	2007-01044	Total Trihalomethanes	9/30/2006	MCL, Average	MCL	12/20/2006	Compliance Achieved
SAINT MARYS WATER CORPORATION	134	WARREN	IA9176019	CWS	2006-01754	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	4/11/2006	NOV issued
SAINTS AVENUE APARTMENTS	125	BREMER	IA0990990	CWS	2006-01570	Failure to meet Certified Operator Requirement	2/28/2006	Certified Operator Requirement	STA	3/21/2006	Compliance Achieved
SAINTS PETER & PAUL LUTHERAN CHURCH	45	JONES	IA5343805	TNC	2006-01868	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	6/8/2006	Compliance Achieved
SAINTS PETER & PAUL LUTHERAN CHURCH	45	JONES	IA5343805	TNC	2006-01869	Nitrate nitrogen	3/31/2006	Routine Major	MON	6/8/2006	Compliance Achieved
SAINTS PETER & PAUL LUTHERAN CHURCH	45	JONES	IA5343805	TNC	2006-03436	Coliform Bacteria, Total	8/31/2006	Repeat Major	MON	1/4/2007	Compliance Achieved
SAINTS PETER & PAUL LUTHERAN CHURCH	45	JONES	IA5343805	TNC	2006-03437	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	1/4/2007	Compliance Achieved
SAINTS PETER & PAUL LUTHERAN CHURCH	45	JONES	IA5343805	TNC	2007-01165	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	1/4/2007	Compliance Achieved
SAINTS PETER & PAUL LUTHERAN CHURCH	45	JONES	IA5343805	TNC	2007-01166	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	1/4/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SAINTS PETER & PAUL LUTHERAN CHURCH	45	JONES	IA5343805	TNC	2007-03464	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/4/2007	Compliance Achieved
SAPP BROS TRUCK STOPS	1074	FREMONT	IA3643202	NTNC	2006-02721	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-01310	Nitrate nitrogen	1/31/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-01336	Nitrate nitrogen	2/28/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-01635	Nitrate nitrogen	3/31/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-01919	Nitrate nitrogen	4/30/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-01948	Nitrate nitrogen	5/31/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-02381	Nitrate nitrogen	6/30/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-02789	Nitrate nitrogen	7/31/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-03289	Nitrate nitrogen	8/31/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2006-03546	Nitrate nitrogen	9/30/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2007-01016	Nitrate nitrogen	10/31/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2007-01096	Nitrate nitrogen	11/30/2006	MCL, Single	MCL	1/27/2006	BCA issued
SARATOGA PRESBYTERIAN CHURCH	82	HOWARD	IA4535801	TNC	2007-01994	Nitrate nitrogen	12/31/2006	MCL, Single	MCL	1/27/2006	BCA issued
SCALES POINTE	71	JOHNSON	IA5200830	TNC	2007-00836	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	11/1/2006	NOV issued
SCALES POINTE	71	JOHNSON	IA5200830	TNC	2007-00903	Nitrate nitrogen	9/30/2006	Routine Major	MON	11/1/2006	NOV issued
SCALES POINTE	71	JOHNSON	IA5200830	TNC	2007-00904	Nitrate nitrogen	9/30/2006	Routine Major	MON	11/1/2006	NOV issued
SCALES POINTE	71	JOHNSON	IA5200830	TNC	2007-00918	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	11/1/2006	NOV issued
SCATTERGOOD FRIENDS SCH-DORM	48	CEDAR	IA1694561	NTNC	2006-03338	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	9/8/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SCATTERGOOD FRIENDS SCH-DORM	48	CEDAR	IA1694561	NTNC	2006-03520	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	9/25/2006	NOV issued
SCATTERGOOD FRIENDS SCH-DORM	48	CEDAR	IA1694561	NTNC	2007-00023	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	10/16/2006	NOV issued
SCATTERGOOD FRIENDS SCH-DORM	48	CEDAR	IA1694561	NTNC	2007-01848	Coliform Bacteria, Total	11/30/2006	MCL (TCR), Monthly	MCL	11/27/2006	NOV issued
SCATTERGOOD FRIENDS SCH-DORM	48	CEDAR	IA1694561	NTNC	2007-01997	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	12/22/2006	NOV issued
SCATTERGOOD FRIENDS SCH-DORM	48	CEDAR	IA1694561	NTNC	2007-03496	Arsenic	12/31/2006	Routine Major	MON	1/30/2007	Compliance Achieved
SCENIC VIEW CAMPGROUND	25	ALLAMAKEE	IA0385401	TNC	2006-02166	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/1/2006	Compliance Achieved
SCENIC VIEW CAMPGROUND	25	ALLAMAKEE	IA0385401	TNC	2006-02743	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/7/2006	Compliance Achieved
SCENIC VIEW CAMPGROUND	25	ALLAMAKEE	IA0385401	TNC	2006-03236	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/7/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03038	Atrazine	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03039	Alachlor (Lasso)	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03040	2,4-D	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03041	2,4,5-TP (Silvex)	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03042	Benzo (a) Pyrene	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03043	Pentachlorophenol	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03044	Dalapon	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03045	Di(2-Ethylhexyl) Adipate	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03046	Simazine	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03047	Di(2-Ethylhexyl) Phthalate	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03048	Picloram	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SCENIC VIEW ESTATES	75	WINNESHIEK	IA9630307	CWS	2006-03049	Dinoseb	6/30/2006	Routine Major	MON	8/30/2006	Compliance Achieved
SCHAEFF BUILDING	35	WOODBURY	IA9778107	NTNC	2006-03345	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	5/4/2007	Compliance Achieved
SCHAEFF BUILDING	35	WOODBURY	IA9778107	NTNC	2007-01840	Coliform Bacteria, Total	11/30/2006	MCL (TCR), Monthly	MCL	5/4/2007	Compliance Achieved
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-01629	Coliform Bacteria, Total	3/31/2006	MCL (TCR), Monthly	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-01749	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-01915	Coliform Bacteria, Fecal	6/30/2006	MCL (TCR), Acute	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-01944	Coliform Bacteria, Fecal	5/31/2006	MCL (TCR), Acute	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-01945	Coliform Bacteria, Total	5/31/2006	MCL (TCR), Monthly	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-02255	Coliform Bacteria, Fecal	6/30/2006	MCL (TCR), Acute	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-02256	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-02359	Nitrate nitrogen	5/31/2006	Routine Major	MON	7/10/2006	Compliance Achieved
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-02442	Coliform Bacteria, Fecal	7/31/2006	MCL (TCR), Acute	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-02443	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-02609	Nitrate nitrogen	7/31/2006	MCL, Single	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-02706	Nitrate nitrogen	6/30/2006	Routine Major	MON	7/10/2006	Compliance Achieved
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-02844	Coliform Bacteria, Fecal	8/31/2006	MCL (TCR), Acute	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-02845	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-02854	Nitrate nitrogen	8/31/2006	MCL, Single	MCL	12/18/2006	BCA issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-03344	Nitrate nitrogen	9/30/2006	MCL, Single	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-03352	Coliform Bacteria, Fecal	9/30/2006	MCL (TCR), Acute	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2006-03353	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2007-00012	Coliform Bacteria, Fecal	10/31/2006	MCL (TCR), Acute	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2007-00013	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2007-00034	Nitrate nitrogen	10/31/2006	MCL, Single	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2007-01086	Coliform Bacteria, Total	11/30/2006	MCL (TCR), Monthly	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2007-01092	Nitrate nitrogen	11/30/2006	MCL, Single	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2007-01099	Coliform Bacteria, Fecal	11/30/2006	MCL (TCR), Acute	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2007-01859	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	12/18/2006	BCA issued
SCHERRMANN'S IMPLEMENT AND APPLIANCE INC	48	DUBUQUE	IA3130863	TNC	2007-01987	Nitrate nitrogen	12/31/2006	MCL, Single	MCL	12/18/2006	BCA issued
SCOTT CO PK - WEST LAKE-PARK TERRACE	150	SCOTT	IA8251901	TNC	2006-02853	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	8/14/2006	NOV issued
SEED SAVERS EXCHANGE	62	WINNESHIEK	IA9630206	TNC	2006-02751	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/5/2006	Compliance Achieved
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01544	Atrazine	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01545	Alachlor (Lasso)	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01546	2,4-D	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01547	2,4,5-TP (Silvex)	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01548	Benzo (a) Pyrene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01549	Pentachlorophenol	9/30/2006	Routine Major	MON	11/29/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01550	Dalapon	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01551	Di(2-Ethylhexyl) Adipate	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01552	Simazine	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01553	Di(2-Ethylhexyl) Phthalate	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01554	Picloram	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01555	Dinoseb	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01556	1,2,4-Trichlorobenzene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01557	cis-1,2-Dichloroethylene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01558	Xylenes	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01559	Dichloromethane	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01560	o-Dichlorobenzene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01561	p-Dichlorobenzene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01562	Vinyl Chloride	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01563	1,1-Dichloroethylene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01564	trans-1,2-Dichloroethylene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01565	1,2-Dichloroethane	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01566	1,1,1-Trichloroethane	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01567	Carbon Tetrachloride	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01568	1,2-Dichloropropane	9/30/2006	Routine Major	MON	11/29/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01569	Trichloroethylene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01570	1,1,2-Trichloroethane	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01571	Tetrachloroethylene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01572	Monochlorobenzene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01573	Benzene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01574	Toluene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01575	Ethylbenzene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-01576	Styrene	9/30/2006	Routine Major	MON	11/29/2006	NOV issued
SHADY ACRES	39	CHICKASAW	IA1900638	CWS	2007-03513	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
SHARON BETHEL CHURCH/SCHOOL	195	JOHNSON	IA5221501	NTNC	2006-02735	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	11/20/2006	Compliance Achieved
SHARON BETHEL CHURCH/SCHOOL	195	JOHNSON	IA5221501	NTNC	2006-02736	Nitrite nitrogen	6/30/2006	Routine Major	MON	11/20/2006	Compliance Achieved
SHARON BETHEL CHURCH/SCHOOL	195	JOHNSON	IA5221501	NTNC	2006-02737	Nitrate nitrogen	6/30/2006	Routine Major	MON	11/20/2006	Compliance Achieved
SHARON BETHEL CHURCH/SCHOOL	195	JOHNSON	IA5221501	NTNC	2006-03178	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	11/20/2006	Compliance Achieved
SHARON BETHEL CHURCH/SCHOOL	195	JOHNSON	IA5221501	NTNC	2006-03497	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	11/15/2006	Compliance Achieved
SHARON BETHEL CHURCH/SCHOOL	195	JOHNSON	IA5221501	NTNC	2007-00058	Failure to submit Operation Permit Application	5/31/2006	Permit Application Submittal	RPT	5/12/2006	Compliance Achieved
SHELL ROCK PRODUCTS, INC (PK BLDG WELL)	25	BUTLER	IA1286107	TNC	2006-01497	Nitrate nitrogen	1/31/2006	Routine Major	MON	2/24/2006	Compliance Achieved
SHELL ROCK PRODUCTS, INC (PK BLDG WELL)	25	BUTLER	IA1286107	TNC	2006-02785	Nitrate nitrogen	7/31/2006	MCL, Single	MCL	11/1/2006	Compliance Achieved
SHERMANS WATER & ROAD, INC.	73	WINNESHIEK	IA9630303	CWS	2007-03514	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
SHUEYVILLE UNITED METHODIST CHURCH	135	JOHNSON	IA5280801	NTNC	2006-01784	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/4/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SILVER CITY WATER SUPPLY	259	MILLS	IA6575052	CWS	2007-01262	Copper	9/30/2006	Routine Tap	MON	3/7/2007	BCA issued
SILVER CITY WATER SUPPLY	259	MILLS	IA6575052	CWS	2007-01263	Lead	9/30/2006	Routine Tap	MON	3/7/2007	BCA issued
SIRWA - CORNING/BROOKS	2049	ADAMS	IA0207704	CWS	2006-01743	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	10/24/2006	Compliance Achieved
SIRWA #1 (GREENFIELD)	639	ADAIR	IA0140701	CWS	2006-01720	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	10/24/2006	Compliance Achieved
SKY LINE INN	40	DUBUQUE	IA3100720	TNC	2007-03598	Chlorine	6/30/2006	Non-Reported Type	RPT	6/28/2006	NOV issued
SKYLINE SPORTSMAN CLUB	30	FREMONT	IA3671201	TNC	2006-02164	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/3/2006	Compliance Achieved
SLEEPY HOLLOW CAMPGROUND & RV PARK	55	JOHNSON	IA5260601	CWS	2006-01585	Coliform Bacteria, Total	2/28/2006	MCL (TCR), Monthly	MCL	9/29/2006	Compliance Achieved
SLIPPERY ELM GOLF COURSE	50	HANCOCK	IA4155201	TNC	2007-00047	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	4/23/2007	NOV issued
SMOKEYS RESTAURANT AND GRILL	42	WINNESHIEK	IA9644202	TNC	2007-03447	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	2/12/2007	Compliance Achieved
SMOKEYS RESTAURANT AND GRILL	42	WINNESHIEK	IA9644202	TNC	2007-03643	Chlorine	12/31/2006	Monitoring (MOR)	MON	2/12/2007	Compliance Achieved
SOFTTAILS LLC	75	DUBUQUE	IA3126211	TNC	2006-01853	Nitrate nitrogen	3/31/2006	Routine Major	MON	5/31/2006	Compliance Achieved
SOFTTAILS LLC	75	DUBUQUE	IA3126211	TNC	2007-03446	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	3/20/2007	Compliance Achieved
SOLON WATER DEPT	1500	JOHNSON	IA5282062	CWS	2007-02014	Copper	9/30/2006	AL, 90th Percentile	MCL	1/5/2007	BCA issued
SOME PLACE BAR & GRILL	30	CLAYTON	IA2268785	TNC	2006-02395	Coliform Bacteria, Fecal	6/30/2006	MCL (TCR), Acute	MCL	3/20/2007	Compliance Achieved
SOME PLACE BAR & GRILL	30	CLAYTON	IA2268785	TNC	2006-02396	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	3/20/2007	Compliance Achieved
SOME PLACE BAR & GRILL	30	CLAYTON	IA2268785	TNC	2006-02491	Coliform Bacteria, Total	7/31/2006	Repeat Major	MON	8/21/2006	Compliance Achieved
SOME PLACE BAR & GRILL	30	CLAYTON	IA2268785	TNC	2006-03295	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	3/20/2007	Compliance Achieved
SOME PLACE BAR & GRILL	30	CLAYTON	IA2268785	TNC	2006-03374	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	3/20/2007	Compliance Achieved
SOME PLACE BAR & GRILL	30	CLAYTON	IA2268785	TNC	2006-03375	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	3/20/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SOME PLACE BAR & GRILL	30	CLAYTON	IA2268785	TNC	2007-00064	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	3/20/2007	Compliance Achieved
SOME PLACE BAR & GRILL	30	CLAYTON	IA2268785	TNC	2007-03376	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	3/20/2007	Compliance Achieved
SORBO FAMILY CAMPGROUND	26	WORTH	IA9855403	TNC	2006-02224	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	7/1/2006	Compliance Achieved
SORBO FAMILY CAMPGROUND	26	WORTH	IA9855403	TNC	2006-02273	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	6/15/2006	NOV issued
SORBO FAMILY CAMPGROUND	26	WORTH	IA9855403	TNC	2006-03293	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	8/31/2006	NOV issued
SORBO FAMILY CAMPGROUND	26	WORTH	IA9855403	TNC	2006-03326	Coliform Bacteria, Fecal	8/31/2006	MCL (TCR), Acute	MCL	8/31/2006	NOV issued
SOUTH CEDAR	25	LINN	IA5720910	TNC	2006-02262	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	6/19/2006	NOV issued
SOUTH CEDAR	25	LINN	IA5720910	TNC	2006-02448	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	7/10/2006	NOV issued
SOUTHDALE HOME OWNERS ASSN	72	KOSSUTH	IA5500822	CWS	2006-01676	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/24/2006	Compliance Achieved
SOUTHDALE HOME OWNERS ASSN	72	KOSSUTH	IA5500822	CWS	2006-01719	Chlorine	2/28/2006	Monitoring (DBP), Major	MON	6/5/2006	Compliance Achieved
SPARBOE AGRICULTURAL CORPORATION	30	HANCOCK	IA4103801	NTNC	2006-02821	Lead	9/30/2006	AL, 90th Percentile	MCL	7/28/2006	NOV issued
SPARBOE FARMS (EGG BREAKING)	50	WRIGHT	IA9926802	NTNC	2007-01660	Copper	9/30/2006	Routine Tap	MON	11/20/2006	NOV issued
SPARBOE FARMS (EGG BREAKING)	50	WRIGHT	IA9926802	NTNC	2007-01661	Lead	9/30/2006	Routine Tap	MON	11/20/2006	NOV issued
SPICE WATER CAFE	25	HOWARD	IA4564201	TNC	2007-01090	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	4/25/2007	Compliance Achieved
SPLIT ROCK PARK	52	CHICKASAW	IA1970928	TNC	2006-03542	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	10/4/2006	NOV issued
SPORTSTERS STEAKHOUSE & LOUNGE	221	BENTON	IA0680202	TNC	2006-01863	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	5/30/2006	Compliance Achieved
SPRING GREEN	52	LINN	IA5784306	CWS	2007-01039	Chlorine	5/31/2006	Non-Reported Type	RPT	5/26/2006	NOV issued
SPRING LAKE CAMPGROUND	35	DES MOINES	IA2909461	TNC	2006-02620	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/2/2006	Compliance Achieved
SPRING LAKE CAMPGROUND	35	DES MOINES	IA2909461	TNC	2006-02688	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/2/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SPRING LAKE CAMPGROUND	35	DES MOINES	IA2909461	TNC	2006-02689	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/2/2006	Compliance Achieved
SPRING LAKE CAMPGROUND	35	DES MOINES	IA2909461	TNC	2006-02702	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/2/2006	Compliance Achieved
SPRING LAKE CAMPGROUND	35	DES MOINES	IA2909461	TNC	2006-02703	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/2/2006	Compliance Achieved
SPRING LAKE CAMPGROUND	35	DES MOINES	IA2909461	TNC	2006-02730	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/2/2006	Compliance Achieved
SPRING LAKE CAMPGROUND	35	DES MOINES	IA2909461	TNC	2007-03379	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/23/2007	NOV issued
SPRING LAKE CAMPGROUND	35	DES MOINES	IA2909461	TNC	2007-03436	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/23/2007	NOV issued
SPRING LAKE CAMPGROUND	35	DES MOINES	IA2909461	TNC	2007-03437	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/23/2007	NOV issued
SPRINGBROOK COUNTRY CLUB	270	CLINTON	IA2330847	TNC	2006-01895	Nitrate nitrogen	6/30/2006	MCL, Single	MCL	4/14/2006	BCA issued
SPRINGBROOK COUNTRY CLUB	270	CLINTON	IA2330847	TNC	2006-02346	Nitrate nitrogen	5/31/2006	Routine Major	MON	7/12/2006	Compliance Achieved
SPRINGBROOK COUNTRY CLUB	270	CLINTON	IA2330847	TNC	2006-02682	Nitrate nitrogen	6/30/2006	Routine Major	MON	7/12/2006	Compliance Achieved
SPRINGBROOK COUNTRY CLUB	270	CLINTON	IA2330847	TNC	2006-02863	Nitrate nitrogen	8/31/2006	MCL, Single	MCL	8/10/2006	NOV issued
SPRINGBROOK COUNTRY CLUB	270	CLINTON	IA2330847	TNC	2006-03553	Nitrate nitrogen	9/30/2006	MCL, Single	MCL	9/29/2006	NOV issued
SPRINGBROOK COUNTRY CLUB	270	CLINTON	IA2330847	TNC	2007-02003	Nitrate nitrogen	12/31/2006	MCL, Single	MCL	12/28/2006	NOV issued
SPRUCE CREEK PARK # 5	43	JACKSON	IA4910404	TNC	2006-02794	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	7/27/2006	NOV issued
SQUAW CREEK A	153	LINN	IA5720903	TNC	2006-02446	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	1/4/2007	Compliance Achieved
ST JOHN LUTHERAN CHURCH	98	HANCOCK	IA4130801	TNC	2006-03499	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	10/5/2006	Compliance Achieved
ST JOHN LUTHERAN CHURCH	98	HANCOCK	IA4130801	TNC	2007-00946	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/5/2006	Compliance Achieved
ST JOHN LUTHERAN CHURCH	98	HANCOCK	IA4130801	TNC	2007-01975	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	1/3/2007	Compliance Achieved
ST JOHN LUTHERAN CHURCH	98	HANCOCK	IA4130801	TNC	2007-03463	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/3/2007	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2006-02440	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	10/3/2006	BCA issued
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2006-03288	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	10/3/2006	BCA issued
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2006-03488	Nitrate nitrogen	8/31/2006	Routine Major	MON	10/17/2006	Compliance Achieved
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2006-03537	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	10/3/2006	BCA issued
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2007-00051	Failure to Obtain Construction Permit	10/31/2006	Construction without a permit	STA	10/6/2006	NOV issued
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2007-00919	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/17/2006	Compliance Achieved
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2007-01021	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	10/3/2006	BCA issued
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2007-01839	Coliform Bacteria, Total	11/30/2006	MCL (TCR), Monthly	MCL	10/3/2006	BCA issued
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2007-02000	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	10/3/2006	BCA issued
ST JOHNS LUTHERAN CHURCH	62	JONES	IA5343815	NTNC	2007-03677	Chlorine	12/31/2006	Monitoring (MOR)	MON	1/26/2007	NOV issued
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2006-02405	Coliform Bacteria, Fecal	6/30/2006	MCL (TCR), Acute	MCL	7/10/2006	BCA issued
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2006-02406	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	7/10/2006	BCA issued
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2006-03325	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	7/10/2006	BCA issued
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2006-03540	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	7/10/2006	BCA issued
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2007-00776	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	10/19/2006	Compliance Achieved
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2007-00777	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	10/19/2006	Compliance Achieved
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2007-00778	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	10/19/2006	Compliance Achieved
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2007-01025	Coliform Bacteria, Fecal	10/31/2006	MCL (TCR), Acute	MCL	7/10/2006	BCA issued
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2007-01026	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	7/10/2006	BCA issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
ST PETER LUTHERAN CHURCH	306	MITCHELL	IA6682801	TNC	2007-01027	Coliform Bacteria, Fecal	9/30/2006	MCL (TCR), Acute	MCL	7/10/2006	BCA issued
ST PETERS RECTORY	180	MITCHELL	IA6653801	TNC	2007-03462	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/2/2007	Compliance Achieved
STARLITE MOBILE HOME PARK	150	MARSHALL	IA6469602	CWS	2006-03259	Chlorine	7/31/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
STERLING WOODS ASSOCIATION	43	SCOTT	IA8209306	CWS	2006-02452	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	4/17/2007	Compliance Achieved
STERLING WOODS ASSOCIATION	43	SCOTT	IA8209306	CWS	2006-03533	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	4/17/2007	Compliance Achieved
STERLING WOODS ASSOCIATION	43	SCOTT	IA8209306	CWS	2007-00038	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	4/17/2007	Compliance Achieved
STERLING WOODS ASSOCIATION	43	SCOTT	IA8209306	CWS	2007-00092	Coliform Bacteria, Total	10/31/2006	Repeat Major	MON	11/27/2006	Compliance Achieved
STOCKPORT WATER SUPPLY	284	VAN BUREN	IA8973095	CWS	2007-00873	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	11/1/2006	NOV issued
STOCKPORT WATER SUPPLY	284	VAN BUREN	IA8973095	CWS	2007-00874	Total Trihalomethanes	8/31/2006	Routine Major	MON	11/1/2006	NOV issued
STOCKTON MUNI WATER SUPPLY	182	MUSCATINE	IA7063096	CWS	2007-03569	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/24/2007	NOV issued
STONEY CREEK SUBDIVISION	70	SCOTT	IA8271301	CWS	2007-01870	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	1/2/2007	NOV issued
STORY CITY WATER DEPT	3228	STORY	IA8584000	CWS	2006-02456	Lead	6/30/2006	AL, 90th Percentile	MCL	2/26/2001	BCA issued
STORY CITY WATER DEPT	3228	STORY	IA8584000	CWS	2007-03504	Lead	12/31/2006	AL, 90th Percentile	MCL	1/23/2007	NOV issued
STRATFORD MUNI WATER DEPT	746	HAMILTON	IA4051002	CWS	2006-02685	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/17/2006	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-01354	Coliform Bacteria, Total	1/31/2006	Routine Major	MON	9/28/2006	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-01660	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	9/28/2006	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-01766	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	9/28/2006	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-01818	Nitrate nitrogen	3/31/2006	Routine Major	MON	9/28/2006	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-01982	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	9/28/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-02322	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	9/28/2006	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-02612	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	9/28/2006	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-02971	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	9/28/2006	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2006-03445	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	9/28/2006	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2007-01177	Coliform Bacteria, Total	10/31/2006	Routine Major	MON	2/4/2007	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2007-01912	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	2/4/2007	Compliance Achieved
SUES FRIENDLY TAVERN	77	BUCHANAN	IA1074833	TNC	2007-03371	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	2/4/2007	Compliance Achieved
SUMNER WATER SUPPLY	2106	BREMER	IA0970006	CWS	2006-03444	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	9/6/2006	Compliance Achieved
SUNNY BRAE GOLF & COUNTRY CLUB	63	MITCHELL	IA6663201	TNC	2006-02672	Nitrate nitrogen	6/30/2006	Routine Major	MON	8/16/2006	Compliance Achieved
SUNNYSIDE VILLAGE MOBILE PARK	204	HARRISON	IA4300600	CWS	2007-01932	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/5/2006	Compliance Achieved
SUNSET VILLAGE	520	MARSHALL	IA6469601	CWS	2006-03266	Chlorine	7/31/2006	Non-Reported Type	RPT	8/17/2006	NOV issued
SUPER 8 MOTEL (I80 EXIT 225)	30	IOWA	IA4884202	TNC	2007-00959	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	3/30/2007	Compliance Achieved
SUPER BOWL	110	WINNEBAGO	IA9525202	TNC	2006-02723	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/23/2006	Compliance Achieved
SUTLIFF STORE INC	27	JOHNSON	IA5282309	TNC	2006-03554	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	10/5/2006	NOV issued
SUTLIFF STORE INC	27	JOHNSON	IA5282309	TNC	2007-01031	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	10/23/2006	NOV issued
SWISHER TRUST & SAVINGS BANK	36	JOHNSON	IA5285206	TNC	2006-02849	Nitrate nitrogen	9/30/2006	MCL, Single	MCL	3/13/2007	Compliance Achieved
SWISHER TRUST & SAVINGS BANK	36	JOHNSON	IA5285206	TNC	2006-03550	Nitrate nitrogen	9/30/2006	MCL, Single	MCL	3/13/2007	Compliance Achieved
SWISS VALLEY PARK	183	DUBUQUE	IA3126942	TNC	2006-02700	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	9/12/2006	Compliance Achieved
SYLVIA ROPP HOME	47	WASHINGTON	IA9233204	TNC	2006-01704	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/2/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
TABLE MOUND PARK	600	DUBUQUE	IA3100600	CWS	2006-01572	Failure to meet Certified Operator Requirement	2/28/2006	Certified Operator Requirement	STA	3/21/2006	Compliance Achieved
TALKING PARROT MHC	50	BUCHANAN	IA1074601	CWS	2006-01569	Failure to meet Certified Operator Requirement	2/28/2006	Certified Operator Requirement	STA	7/1/2006	Compliance Achieved
TALKING PARROT MHC	50	BUCHANAN	IA1074601	CWS	2007-03515	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
TERRY WATER ASSOCIATION	46	BENTON	IA0690303	CWS	2007-01866	Failure to meet Certified Operator Requirement	12/31/2006	Certified Operator Requirement	STA	1/12/2007	Compliance Achieved
THE BEACH FRONT	42	LEE	IA5694201	TNC	2006-02724	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	1/9/2007	Compliance Achieved
THE BEACH FRONT	42	LEE	IA5694201	TNC	2007-00927	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	1/9/2007	Compliance Achieved
THE BEACH FRONT	42	LEE	IA5694201	TNC	2007-03448	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/9/2007	Compliance Achieved
THE BROILER	122	STORY	IA8503202	TNC	2007-03421	Nitrate nitrogen	12/31/2006	Routine Major	MON	2/11/2007	Compliance Achieved
THE CATFISH PLACE	174	MUSCATINE	IA7052204	TNC	2006-02369	Nitrate nitrogen	5/31/2006	Routine Major	MON	6/14/2006	Compliance Achieved
THE CATFISH PLACE	174	MUSCATINE	IA7052204	TNC	2006-03492	Nitrate nitrogen	8/31/2006	Routine Major	MON	9/20/2006	Compliance Achieved
THE CATFISH PLACE	174	MUSCATINE	IA7052204	TNC	2007-01970	Nitrate nitrogen	11/30/2006	Routine Major	MON	12/6/2006	Compliance Achieved
THE PINICON	187	CHICKASAW	IA1970203	TNC	2007-03591	Chlorine	6/30/2006	Non-Reported Type	RPT	6/23/2006	NOV issued
THE PLAYHOUSE THEATRE	55	MILLS	IA6525203	TNC	2007-00943	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/9/2006	Compliance Achieved
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2006-01769	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	7/27/2006	AG Case Referred
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2006-03447	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	7/27/2006	AG Case Referred
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2007-00797	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	7/27/2006	AG Case Referred
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2007-01917	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	7/27/2006	AG Case Referred
THE ROSE BOWL	110	CERRO GORDO	IA1750708	TNC	2007-03373	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	7/27/2006	AG Case Referred
THE SPORTSMEN	187	FAYETTE	IA3300770	TNC	2006-02623	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	9/27/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
THE SPORTSMEN	187	FAYETTE	IA3300770	TNC	2006-02651	Nitrate nitrogen	6/30/2006	Routine Major	MON	9/27/2006	Compliance Achieved
THE ZIPPER	35	WINNESHIEK	IA9637201	TNC	2006-01800	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	6/12/2006	Compliance Achieved
THE ZIPPER	35	WINNESHIEK	IA9637201	TNC	2007-00885	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	1/16/2007	Compliance Achieved
THE ZIPPER	35	WINNESHIEK	IA9637201	TNC	2007-03400	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/16/2007	Compliance Achieved
THOR WATER WORKS	174	HUMBOLDT	IA4680018	CWS	2007-03429	Nitrate nitrogen	12/31/2006	Routine Major	MON	2/8/2007	Compliance Achieved
THOR WATER WORKS	174	HUMBOLDT	IA4680018	CWS	2007-03522	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/21/2007	Compliance Achieved
THORPE PARK-WINNEBAGO CONSERVATION	60	WINNEBAGO	IA9525901	TNC	2006-02390	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	6/30/2006	NOV issued
THUNDER RIDGE ESTATES	36	DUBUQUE	IA3170303	CWS	2006-02459	Copper	6/30/2006	AL, 90th Percentile	MCL	7/13/2006	NOV issued
TIMBER LAKE ESTATES HOA	83	SCOTT	IA8215306	CWS	2007-03570	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/6/2007	Compliance Achieved
TIMBER RIDGE	238	BENTON	IA0600600	CWS	2006-02850	Nitrite nitrogen	8/31/2006	MCL, Single	MCL	5/2/2007	Compliance Achieved
TIMBER RIDGE	238	BENTON	IA0600600	CWS	2006-03351	Nitrite nitrogen	9/30/2006	MCL, Single	MCL	5/2/2007	Compliance Achieved
TIMBER TRAIL HOMEOWNERS ASSOCIATION	78	JOHNSON	IA5200303	CWS	2006-02879	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	2/10/2007	Compliance Achieved
TIMBER VALLEY ESTATES (1ST & 2ND ADD)	169	SCOTT	IA8215384	CWS	2007-03571	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/26/2007	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01288	Copper	9/30/2006	Routine Tap	MON	1/11/2007	BCA issued
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01289	Lead	9/30/2006	Routine Tap	MON	1/11/2007	BCA issued
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01467	1,2,4-Trichlorobenzene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01468	cis-1,2-Dichloroethylene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01469	Xylenes	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01470	Dichloromethane	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01471	o-Dichlorobenzene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01472	p-Dichlorobenzene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01473	Vinyl Chloride	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01474	1,1-Dichloroethylene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01475	trans-1,2-Dichloroethylene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01476	1,2-Dichloroethane	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01477	1,1,1-Trichloroethane	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01478	Carbon Tetrachloride	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01479	1,2-Dichloropropane	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01480	Trichloroethylene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01481	1,1,2-Trichloroethane	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01482	Tetrachloroethylene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01483	Monochlorobenzene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01484	Benzene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01485	Toluene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01486	Ethylbenzene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01487	Styrene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01488	Atrazine	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01489	Alachlor (Lasso)	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01490	2,4-D	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01491	2,4,5-TP (Silvex)	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01492	Benzo (a) Pyrene	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01493	Pentachlorophenol	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01494	Dalapon	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01495	Di(2-Ethylhexyl) Adipate	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01496	Simazine	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01497	Di(2-Ethylhexyl) Phthalate	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01498	Picloram	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-01499	Dinoseb	9/30/2006	Routine Major	MON	12/20/2006	Compliance Achieved
TIMBER VALLEY ESTATES (THIRD ADDITION)	65	SCOTT	IA8215385	CWS	2007-03572	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/26/2007	Compliance Achieved
TIMBERLAKE	52	JOHNSON	IA5200810	CWS	2006-01781	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	4/4/2006	Compliance Achieved
TIMBERLAKE	52	JOHNSON	IA5200810	CWS	2007-03573	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/14/2007	Compliance Achieved
TIMBERLINE ESTATES	25	WASHINGTON	IA9260302	CWS	2007-02018	Copper	12/31/2006	AL, 90th Percentile	MCL	1/8/2007	BCA issued
TIMBERLINE ESTATES, LTD.	280	DES MOINES	IA2900626	CWS	2006-01622	Failure to meet Certified Operator Requirement	3/31/2006	Certified Operator Requirement	STA	11/29/2006	Compliance Achieved
TIMBERLINE GOLF COURSE INC.	130	DUBUQUE	IA3126883	TNC	2007-03600	Chlorine	6/30/2006	Non-Reported Type	RPT	6/28/2006	NOV issued
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2006-03448	Coliform Bacteria, Total	8/31/2006	Routine Major	MON	9/28/2006	Compliance Achieved
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2007-01079	Chlorine	9/30/2006	Non-Reported Type	RPT	10/30/2006	NOV issued
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2007-01185	Copper	9/30/2006	Routine Tap	MON	11/28/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2007-01186	Lead	9/30/2006	Routine Tap	MON	11/28/2006	NOV issued
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2007-03516	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2007-03611	Chlorine	12/31/2006	Non-Reported Type	RPT	1/22/2007	NOV issued
TOWN & COUNTRY MOBILE HOME PK	26	CHICKASAW	IA1900669	CWS	2007-03706	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	4/11/2006	NOV issued
TRACY WATER SUPPLY	300	MARION	IA6382029	CWS	2007-03536	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/31/2007	NOV issued
TROY STORE	502	LINN	IA5786201	TNC	2007-01066	Failure to meet Compliance Schedule	11/30/2006	Compliance Schedule	V/E	11/21/2006	BCA issued
TRUCK COUNTRY OF IOWA	55	DUBUQUE	IA3126209	NTNC	2006-01862	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	1/3/2006	Compliance Achieved
TRURO WATERWORKS	427	MADISON	IA6167036	CWS	2006-01942	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	5/8/2006	NOV issued
TRURO WATERWORKS	427	MADISON	IA6167036	CWS	2006-02425	Total Trihalomethanes	6/30/2006	MCL, Average	MCL	7/5/2006	NOV issued
TURKEY CREEK DEVELOPMENT	65	JOHNSON	IA5225316	CWS	2007-03574	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/24/2007	NOV issued
TWIN KNOLLS FOURTH/FIFTH ADDITION	144	LINN	IA5784326	CWS	2007-01042	Chlorine	5/31/2006	Non-Reported Type	RPT	5/26/2006	NOV issued
TWIN OAK CAMP GROUND	32	CERRO GORDO	IA1716424	TNC	2006-03521	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	9/18/2006	NOV issued
TWIN PONDS WEST - CHICKASAW CCB	75	CHICKASAW	IA1970403	TNC	2007-01056	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	11/8/2006	NOV issued
TWIN T MOBILE HOME PARK, INC.	67	DUBUQUE	IA3100603	CWS	2006-01573	Failure to meet Certified Operator Requirement	2/28/2006	Certified Operator Requirement	STA	2/22/2006	Compliance Achieved
TYSON FRESH MEATS INC (PERRY PLANT)	1100	DALLAS	IA2561101	NTNC	2006-02815	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	3/27/2007	Compliance Achieved
TYSON FRESH MEATS INC (PERRY PLANT)	1100	DALLAS	IA2561101	NTNC	2007-01920	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/6/2006	Compliance Achieved
UNITED STATES GYPSUM-FORT DODGE	36	WEBSTER	IA9433101	NTNC	2006-01877	Nitrate nitrogen	3/31/2006	Routine Major	MON	5/5/2006	Compliance Achieved
UNITED STATES GYPSUM-FORT DODGE	36	WEBSTER	IA9433101	NTNC	2006-01878	Nitrite nitrogen	3/31/2006	Routine Major	MON	12/12/2006	Compliance Achieved
UNITED STATES GYPSUM-FORT DODGE	36	WEBSTER	IA9433101	NTNC	2006-01879	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	5/5/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
UNITED STATES GYPSUM-FORT DODGE	36	WEBSTER	IA9433101	NTNC	2006-01966	Coliform Bacteria, Total	5/31/2006	Repeat Major	MON	9/11/2006	Compliance Achieved
UNITED STATES GYPSUM-FORT DODGE	36	WEBSTER	IA9433101	NTNC	2006-02293	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	9/11/2006	Compliance Achieved
UPPER DEER CREEK CHURCH	200	IOWA	IA9233802	TNC	2007-01874	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	12/21/2006	NOV issued
US BIO ENERGY - ALBERT CITY	45	BUENA VISTA	IA1103101	NTNC	2007-03474	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/31/2007	Compliance Achieved
VAIL WATER SUPPLY	452	CRAWFORD	IA2452044	CWS	2007-04073	Copper	9/30/2006	AL, 90th Percentile	MCL	11/29/2006	BCA issued
VALLEY HIGH SCHOOL	675	FAYETTE	IA3338500	NTNC	2006-01574	Failure to meet Certified Operator Requirement	2/28/2006	Certified Operator Requirement	STA	4/6/2006	Compliance Achieved
VALLEY HIGH SCHOOL	675	FAYETTE	IA3338500	NTNC	2007-01924	Coliform Bacteria, Total	11/30/2006	Routine Major	MON	12/4/2006	Compliance Achieved
VAN HORNE WATER WORKS	716	BENTON	IA0685045	CWS	2007-00027	Lead	9/30/2006	AL, 90th Percentile	MCL	10/9/2006	NOV issued
VERDE INVESTMENTS - SPRING VALLEY PARK	135	DUBUQUE	IA3100606	CWS	2006-02846	Coliform Bacteria, Total	8/31/2006	MCL (TCR), Monthly	MCL	2/7/2007	Compliance Achieved
VERDE INVESTMENTS - SPRING VALLEY PARK	135	DUBUQUE	IA3100606	CWS	2007-03712	Failure to Obtain Construction Permit	9/30/2006	Construction without a permit	STA	2/17/2007	NOV issued
VERN ACRES (OLIPHANT ADDITION)	150	LINN	IA5784303	CWS	2007-01041	Chlorine	5/31/2006	Non-Reported Type	RPT	5/26/2006	NOV issued
VERNON WATER CO	125	DUBUQUE	IA3126315	CWS	2006-02263	Coliform Bacteria, Fecal	6/30/2006	MCL (TCR), Acute	MCL	5/16/2007	Compliance Achieved
VERNON WATER CO	125	DUBUQUE	IA3126315	CWS	2006-02264	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	5/16/2007	Compliance Achieved
VERNON WATER CO	125	DUBUQUE	IA3126315	CWS	2006-02426	Lead	6/30/2006	AL, 90th Percentile	MCL	7/5/2006	NOV issued
VERNON WATER CO	125	DUBUQUE	IA3126315	CWS	2007-00030	Coliform Bacteria, Fecal	10/31/2006	MCL (TCR), Acute	MCL	5/16/2007	Compliance Achieved
VERNON WATER CO	125	DUBUQUE	IA3126315	CWS	2007-00031	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	5/16/2007	Compliance Achieved
VERNON WATER CO	125	DUBUQUE	IA3126315	CWS	2007-01091	Coliform Bacteria, Total	11/30/2006	MCL (TCR), Monthly	MCL	5/16/2007	Compliance Achieved
VIBRATIONS	100	CERRO GORDO	IA1750761	TNC	2006-01663	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	5/30/2006	Compliance Achieved
VIBRATIONS	100	CERRO GORDO	IA1750761	TNC	2006-01770	Coliform Bacteria, Total	3/31/2006	Routine Major	MON	5/30/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
VIBRATIONS	100	CERRO GORDO	IA1750761	TNC	2006-01987	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/30/2006	Compliance Achieved
VIBRATIONS	100	CERRO GORDO	IA1750761	TNC	2007-03374	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	1/30/2007	Compliance Achieved
VILLAGE CREEK BIBLE CAMP-LODGE	124	ALLAMAKEE	IA0345481	TNC	2006-02604	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	8/7/2006	Compliance Achieved
VILLAGE CREEK BIBLE CAMP-LODGE	124	ALLAMAKEE	IA0345481	TNC	2007-03444	Nitrate nitrogen	12/31/2006	Routine Major	MON	2/20/2007	Compliance Achieved
VILLAGE CREEK BIBLE CAMP-LODGE	124	ALLAMAKEE	IA0345481	TNC	2007-03645	Chlorine	12/31/2006	Monitoring (MOR)	MON	1/26/2007	NOV issued
VINGIE PUB	48	WINNEBAGO	IA9580203	TNC	2007-01998	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	1/5/2007	NOV issued
WAHKONSA COUNTRY CLUB	60	CEDAR	IA7078815	TNC	2006-02638	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	9/26/2006	Compliance Achieved
WAHPETON WATER SUPPLY	572	DICKINSON	IA3087057	CWS	2007-02010	Failure to meet Certified Operator Requirement	12/31/2006	Certified Operator Requirement	STA	12/22/2006	NOV issued
WALDENBURG COMMUNITY WATER SYSTEM	90	IOWA	IA4802301	CWS	2007-03575	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	3/20/2007	Compliance Achieved
WALLACE FOUNDATION LEARNING CENTER	28	POTTAWATTAMIE	IA7856901	TNC	2007-00861	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/4/2006	Compliance Achieved
WALLACE FOUNDATION LEARNING CENTER	28	POTTAWATTAMIE	IA7856901	TNC	2007-00898	Nitrate nitrogen	9/30/2006	Routine Major	MON	10/4/2006	Compliance Achieved
WALNUT ACRES CAMPGROUND	50	JONES	IA5343203	TNC	2006-02790	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	8/2/2006	NOV issued
WAPELLO RURAL WATER ASSOC.	10690	WAPELLO	IA9000742	CWS	2006-02410	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	12/13/2006	Compliance Achieved
WAPSIE VALLEY COM SCH-FAIRBANK	285	BUCHANAN	IA1025554	NTNC	2006-01575	Failure to meet Certified Operator Requirement	2/28/2006	Certified Operator Requirement	STA	2/24/2006	Compliance Achieved
WAPSIE VALLEY COM SCH-FAIRBANK	285	BUCHANAN	IA1025554	NTNC	2006-02267	Copper	6/30/2006	AL, 90th Percentile	MCL	6/13/2006	NOV issued
WATERLOO IMPLEMENT	130	BLACK HAWK	IA0737201	NTNC	2006-02468	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	5/25/2007	BCA issued
WATERVILLE BAR & GRILL	27	ALLAMAKEE	IA0397201	TNC	2007-01164	Coliform Bacteria, Total	11/30/2006	Repeat Major	MON	1/22/2007	Compliance Achieved
WAYNE ZION LUTHERAN CHURCH	52	JONES	IA5343801	TNC	2006-02372	Coliform Bacteria, Total	5/31/2006	Routine Major	MON	6/8/2006	Compliance Achieved
WAYNE ZION LUTHERAN CHURCH	52	JONES	IA5343801	TNC	2006-03237	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/28/2006	Compliance Achieved

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
WAYNE ZION LUTHERAN CHURCH	52	JONES	IA5343801	TNC	2007-00773	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/31/2006	Compliance Achieved
WAYNE ZION LUTHERAN CHURCH	52	JONES	IA5343801	TNC	2007-00774	Coliform Bacteria, Total	9/30/2006	Repeat Major	MON	10/31/2006	Compliance Achieved
WAYNE ZION LUTHERAN CHURCH	52	JONES	IA5343801	TNC	2007-03460	Coliform Bacteria, Total	12/31/2006	Routine Major	MON	10/31/2006	Compliance Achieved
WAYNE ZION LUTHERAN CHURCH	52	JONES	IA5343801	TNC	2007-03675	Chlorine	12/31/2006	Monitoring (MOR)	MON	1/31/2007	Compliance Achieved
WEBB WATER SUPPLY	175	CLAY	IA2178092	CWS	2006-01356	Coliform Bacteria, Total	1/31/2006	Routine Major	MON	2/8/2006	Compliance Achieved
WEBSTER MUNICIPAL WATER WORKS	110	KEOKUK	IA5491093	CWS	2007-03576	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	6/21/2006	Compliance Achieved
WELLMAN MUNICIPAL WATERWORKS	1393	WASHINGTON	IA9276096	CWS	2006-01926	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	4/11/2006	NOV issued
WELLSBURG WATER SUPPLY	716	GRUNDY	IA3890097	CWS	2006-01565	Radium 226 & Radium 228	3/31/2006	MCL, Single	MCL	11/1/2006	Compliance Achieved
WELLSBURG WATER SUPPLY	716	GRUNDY	IA3890097	CWS	2006-01949	Radium 226 & Radium 228	6/30/2006	MCL, Average	MCL	11/1/2006	Compliance Achieved
WELLSBURG WATER SUPPLY	716	GRUNDY	IA3890097	CWS	2006-02855	Radium 226 & Radium 228	9/30/2006	MCL, Average	MCL	11/1/2006	Compliance Achieved
WEST BURLINGTON MUNI. WATER SUPPLY	3161	DES MOINES	IA2985002	CWS	2006-01591	Total Trihalomethanes	3/31/2006	MCL, Average	MCL	8/23/2005	BCA issued
WEST BURLINGTON MUNI. WATER SUPPLY	3161	DES MOINES	IA2985002	CWS	2006-02249	Total Trihalomethanes	6/30/2006	MCL, Average	MCL	8/23/2005	BCA issued
WEST CENTRAL RWA-BOYER SYSTEM	1330	SAC	IA1400903	CWS	2007-00996	Sodium	9/30/2006	Routine Major	MON	10/16/2006	Compliance Achieved
WEST LAKE-SUMMIT CAMPGROUND	150	SCOTT	IA8251900	TNC	2006-02674	Nitrate nitrogen	6/30/2006	Routine Major	MON	7/26/2006	NOV issued
WESTFIELD WATER SUPPLY	195	PLYMOUTH	IA7589008	CWS	2006-01828	Nitrate nitrogen	3/31/2006	Routine Major	MON	5/15/2006	Compliance Achieved
WHEATLAND CITY WATER SUPPLY	770	CLINTON	IA2394017	CWS	2007-00900	Nitrate nitrogen	9/30/2006	Routine Major	MON	11/14/2006	Compliance Achieved
WHITE SPRINGS	70	CLAYTON	IA2258788	TNC	2006-02617	Coliform Bacteria, Total	6/30/2006	Routine Major	MON	7/31/2006	NOV issued
WILDCAT DEN STATE PK-FAIRPORT STATION	600	MUSCATINE	IA7048477	TNC	2006-03357	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	9/21/2006	NOV issued
WIND & FIRE MINISTRIES INC	59	LINN	IA5751802	TNC	2006-02424	Coliform Bacteria, Total	6/30/2006	MCL (TCR), Monthly	MCL	8/3/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
WIND & FIRE MINISTRIES INC	59	LINN	IA5751802	TNC	2006-02968	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	12/29/2006	Compliance Achieved
WINDING BROOK MOBILE HOME PARK	150	CLINTON	IA2300607	CWS	2006-02479	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	7/24/2006	NOV issued
WINDING BROOK MOBILE HOME PARK	150	CLINTON	IA2300607	CWS	2006-02804	Coliform Bacteria, Fecal	7/31/2006	MCL (TCR), Acute	MCL	7/24/2006	NOV issued
WINDING BROOK MOBILE HOME PARK	150	CLINTON	IA2300607	CWS	2007-03577	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	1/7/2007	NOV issued
WINDRIDGE IMPLEMENTS L.L.C.	45	WINNESHIEK	IA9630101	TNC	2006-03370	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	9/18/2006	NOV issued
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2006-01584	Nitrate nitrogen	2/28/2006	MCL, Single	MCL	5/14/2007	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2006-01701	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/29/2006	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2006-02155	Coliform Bacteria, Total	4/30/2006	Routine Major	MON	5/31/2006	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2006-02942	Coliform Bacteria, Total	7/31/2006	Repeat Major	MON	8/29/2006	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2006-03168	Nitrate nitrogen	7/31/2006	Routine Major	MON	8/29/2006	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2006-03311	Failure to submit Monthly Operation Report	5/31/2006	Monthly Operation Report	RPT	5/14/2007	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2007-00925	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/2/2006	Compliance Achieved
WINNERS CIRCLE	137	BREMER	IA0990208	TNC	2007-01623	Nitrate nitrogen	10/31/2006	Routine Major	MON	11/27/2006	Compliance Achieved
WINNESHIEK WILDBERRY WINERY	122	WINNESHIEK	IA9630210	TNC	2007-00968	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	12/26/2006	Compliance Achieved
WINNESHIEK WILDBERRY WINERY	122	WINNESHIEK	IA9630210	TNC	2007-00969	Nitrite nitrogen	9/30/2006	Routine Major	MON	12/26/2006	Compliance Achieved
WINNESHIEK WILDBERRY WINERY	122	WINNESHIEK	IA9630210	TNC	2007-00970	Nitrate nitrogen	9/30/2006	Routine Major	MON	12/26/2006	Compliance Achieved
WINNESHIEK WILDBERRY WINERY	122	WINNESHIEK	IA9630210	TNC	2007-02004	Coliform Bacteria, Total	12/31/2006	MCL (TCR), Monthly	MCL	1/5/2007	NOV issued
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2006-01576	Failure to meet Certified Operator Requirement	2/28/2006	Certified Operator Requirement	STA	10/3/2006	AG Case Referred
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2006-02874	Chlorine	6/30/2006	Monitoring (DBP), Major	MON	10/3/2006	AG Case Referred

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2006-03313	Failure to submit Monthly Operation Report	5/31/2006	Monthly Operation Report	RPT	10/3/2006	AG Case Referred
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2006-03318	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	10/3/2006	AG Case Referred
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2006-03333	Failure to submit Monthly Operation Report	3/31/2006	Monthly Operation Report	RPT	10/3/2006	AG Case Referred
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2007-00800	Total Trihalomethanes	8/31/2006	Routine Major	MON	10/3/2006	AG Case Referred
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2007-00801	Coliform Bacteria, Total	9/30/2006	Routine Major	MON	10/3/2006	AG Case Referred
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2007-00802	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	10/3/2006	AG Case Referred
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2007-01080	Chlorine	9/30/2006	Non-Reported Type	RPT	10/3/2006	AG Case Referred
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2007-03612	Chlorine	12/31/2006	Non-Reported Type	RPT	10/3/2006	AG Case Referred
WINTER MOBILE HOME PARK	50	CHICKASAW	IA1900601	CWS	2007-03705	Chlorine	3/31/2006	Monitoring (DBP), Major	MON	10/3/2006	AG Case Referred
WINTERSET MUNICIPAL WATERWORKS	4768	MADISON	IA6171029	CWS	2006-03529	Total Trihalomethanes	9/30/2006	MCL, Average	MCL	9/21/2006	NOV issued
WINTERSET MUNICIPAL WATERWORKS	4768	MADISON	IA6171029	CWS	2007-02022	Total Trihalomethanes	12/31/2006	MCL, Average	MCL	1/9/2007	NOV issued
WOODLAND ACRES	92	WEBSTER	IA9433600	CWS	2007-00881	Total Trihalomethanes	8/31/2006	Routine Major	MON	10/18/2006	NOV issued
WOODLAND ACRES	92	WEBSTER	IA9433600	CWS	2007-00882	Total Haloacetic Acids	8/31/2006	Monitoring (DBP), Major	MON	10/18/2006	NOV issued
WOODLAND HEIGHTS HOMEOWNERS ASSOC.	43	JOHNSON	IA5225309	CWS	2007-01098	Lead	9/30/2006	AL, 90th Percentile	MCL	11/15/2006	BCA issued
WOODS AND MEADOWS SUBDIVISION	132	SCOTT	IA8245357	CWS	2006-01686	Coliform Bacteria, Total	2/28/2006	Routine Major	MON	3/20/2006	Compliance Achieved
WOODS AND MEADOWS SUBDIVISION	132	SCOTT	IA8245357	CWS	2006-02998	Coliform Bacteria, Total	7/31/2006	Routine Major	MON	8/31/2006	Compliance Achieved
WOODS AND MEADOWS SUBDIVISION	132	SCOTT	IA8245357	CWS	2007-03578	Failure to Issue Consumer Confidence Report	7/31/2006	CCR	RPT	2/26/2007	Compliance Achieved
WOODWARD RESOURCE CENTER	400	BOONE	IA0800923	CWS	2007-00056	Lead	12/31/2006	AL, 90th Percentile	MCL	10/17/2006	NOV issued
XENIA RWD (AMES)	1095	STORY	IA8503704	CWS	2006-02261	Failure to submit Monthly Operation Report	4/30/2006	Monthly Operation Report	RPT	6/6/2006	NOV issued

Name of the Public Water Supply (Alphabetical Listing)	Minimum Population Served	County	PWSID	PWS Type	Violation Number	Analyte	Compliance End Date	Violation	Violation Type	Enforcement Action Date	Enforcement Action
YANKEE GROVE DEVELOPMENT	64	CEDAR	IA5784321	CWS	2006-02812	Coliform Bacteria, Total	7/31/2006	MCL (TCR), Monthly	MCL	4/25/2007	Compliance Achieved
YANKEE GROVE DEVELOPMENT	64	CEDAR	IA5784321	CWS	2006-03534	Coliform Bacteria, Total	9/30/2006	MCL (TCR), Monthly	MCL	4/25/2007	Compliance Achieved
YANKEE GROVE DEVELOPMENT	64	CEDAR	IA5784321	CWS	2007-00052	Coliform Bacteria, Total	10/31/2006	MCL (TCR), Monthly	MCL	4/25/2007	Compliance Achieved