


# Bob Lillenthal Test Results

Readings Taken Daily At 3:30 PM

1,200 Head Hog Barn

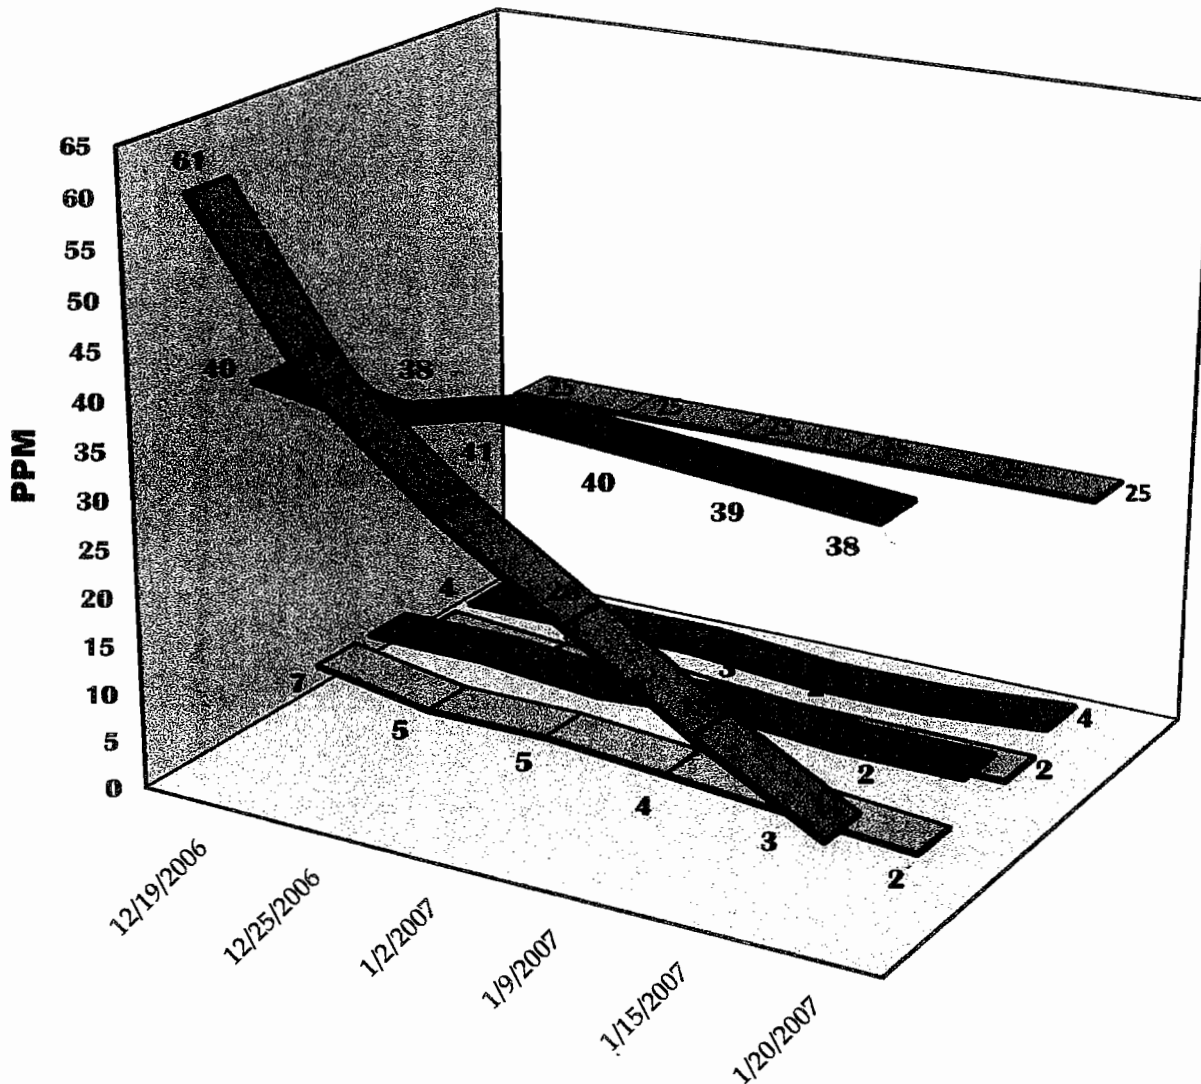

## Sample Dates

	12/19/2006	12/25/2006	1/2/2007	1/9/2007	1/15/2007	1/20/2007
Test Barn Ammonia	61	44	34	26	18	11
Control Barn Ammonia	40	38	41	40	39	38
Test Barn Methane	7	5	5	4	3	2
Control Barn Methane	7	7	6	7	6	6
Test Barn Hyd Sulfide	4	3	3	2	2	2
Control Barn Hyd Sulfide	4	4	4	3	3	4
ACGIH Ammonia Threshold	25	25	25	25	25	25

2007 American Conference of Governmental Industrial Hygienists (ACGIH) Threshold Limit Value for Ammonia is 25 PPM With a Short Term (15 minute) Exposure Limit of 35 PPM.